



# Draft Water Resources Management Plan 2024

Technical Appendix P - Options list tables

## Contents

Background and Introduction	2
Options list tables	3
Water resource options list.....	3
Generic screening of resource options.....	4
Unconstrained list of resource options .....	5
Demand options list tables .....	23

## Figures

Figure P- 1: Overview of draft WRMP24 Supply options reports .....	2
Figure P- 2: A phased approach to reviewing and assessing water resource options .....	4


## Tables

Table P - 1: Generic list of resource options .....	4
Table P - 2: Unconstrained list of resource elements.....	6
Table P - 3: Unconstrained demand management options .....	24

## Background and Introduction

P.1 Appendix P – Options list should be read in conjunction with the following reports as detailed in Figure P- 1.

Figure P- 1: Overview of draft WRMP24 Supply options reports

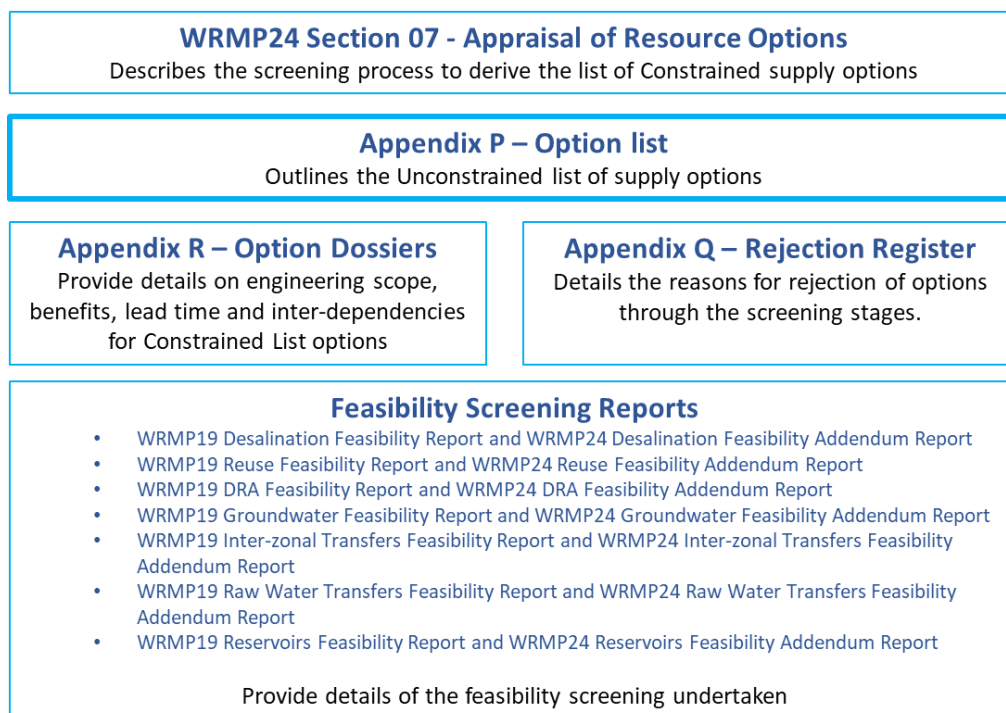

Appendix P: Options List provides:

- A summary of generic option screening
- List of Unconstrained Options which were identified for options screening
- For all Unconstrained Options, a summary of the option screening results and deployable output benefits is provided


## Options list tables

- P.2 Appendix P sets out the water resource options list and the demand options list.

### Water resource options list

- P.3 Following the principles of the Water Resource Planning Guideline (WRPG), a phased approach to developing water resource options for dWRMP24 has been undertaken so that effort on reducing uncertainties is focused on the issues that could reasonably be expected to influence option screening decisions. An overview of the approach to reviewing and assessing resource options in the preparation of dWRMP24 is shown in Figure P- 2. The approach comprises: option identification and definition; feasibility assessment; option screening; option development; and investment modelling. These are described in more detail below. Further information on the approach can be found in Section 7 Appraisal of Resource Options.
- P.4 Option identification and definition was undertaken in two stages. Stage 1 involves generic option screening of option types. Stage 2 involves identification of options within option types which passed Stage 1. The output of option identification and definition was the Unconstrained List of options.
- P.5 Feasibility Assessment: options on the Unconstrained List were assessed following the three-stage methodology in accordance with the WRMP19 approach. The output of this stage is the Feasible List of options.
- P.6 Option Screening: further screening was undertaken where options were subject to a combined limit or were mutually exclusive with another option. The output of this stage is the Constrained List of options.
- P.7 Option Development: Constrained List options were developed for inclusion in the investment model and dWRMP24 documentation.
- P.8 Options on the Constrained List have then been subject to programme appraisal/ investment modelling using the Water Resources South East (WRSE) investment model to determine the optimum best value programme of solutions to the water supply/demand deficit to ensure that supply balances demand, taking account of relevant future forecast water resource scenarios.

Figure P- 2: A phased approach to reviewing and assessing water resource options

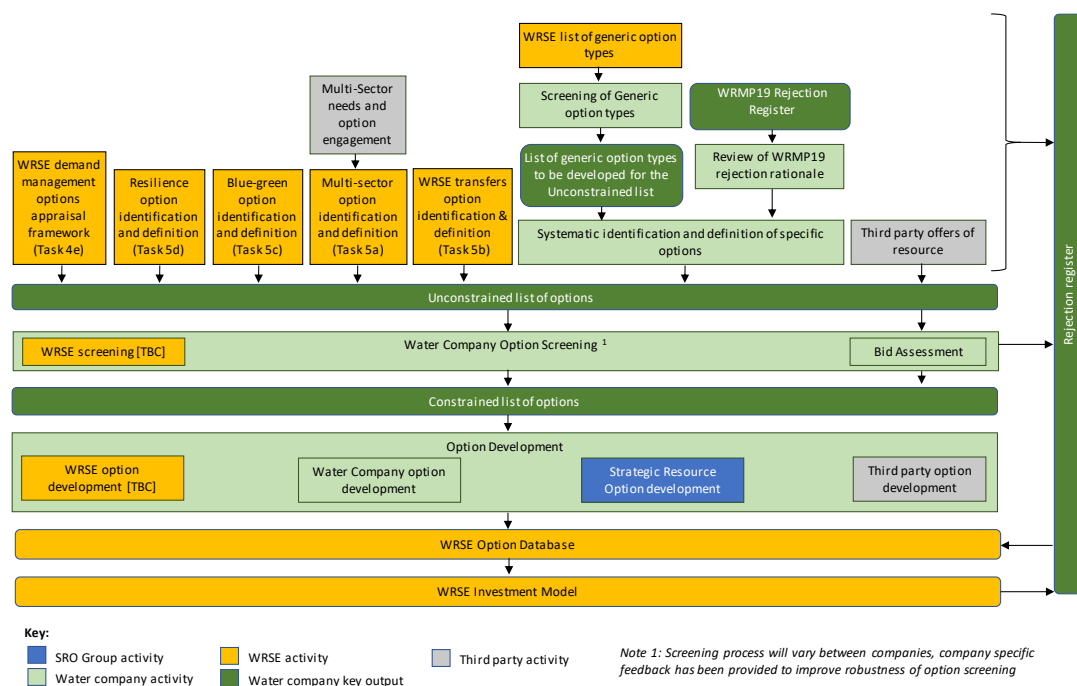

## Generic screening of resource options

P.9 The option types considered in the generic screening exercise were those listed in the UKWIR Water Resources Planning Tools report<sup>1</sup>. The generic water resource options list and a summary of the results of the screening are shown in Table P-1.

Table P - 1: Generic list of resource options

Scheme Type / Sub type	Screening decision
Catchment management schemes - Flow augmentation and licensing	✓
Catchment management schemes - Terrestrial habitat creation/management	✓
Catchment management schemes - Natural water retention measures	✓
Catchment management schemes - Fisheries management	✓
Catchment management schemes - River Restoration	✓
Catchment management schemes - Sustainable Urban Drainage Systems (SUDS)	✓
Catchment management schemes - Nutrient and sediment reduction	✓
Catchment management schemes - Pesticide reduction	✓
Catchment management schemes - Integrated catchment management	✓
Catchment management schemes - Knowledge exchange, education and agricultural activity	✓
Desalination	✓
Groundwater sources	✓
Artificial Storage and Recovery wells (or Aquifer Storage and Recovery (ASR))	✓
Aquifer recharge /Artificial recharge (AR)	✓

<sup>1</sup> UKWIR, Water Resources Planning Tools, EBSD Report, Ref. 12/WR/27/6. 2012.

Scheme Type / Sub type	Screening decision
Tidal barrage	✗
Conjunctive use operation of sources	✓
Joint ("shared asset") resource	✓
Asset Transfers	✓
Options to trade other (infrastructure) assets	✓
Abstraction licence trading	✓
Distribution capacity expansion	✓
Redevelopment of existing resources with increased yields	✗
Increase water treatment works (WTW) capacity	✓
New reservoir	✓
Reclaimed water, water re-use, effluent re-use	✓
Direct river abstraction	✓
Bulk transfers into region	✓
Bulk transfers within region	✓
Drought intervention - Drought order	✓
Drought intervention - Drought permit	✓
Change in Level of Service to enhance water available for use (WAFU)	✓
Imports (icebergs)	✗
Rain cloud seeding	✗
Drought intervention - recommission abandoned sources	✓
Tankering of water - Road Tankering	✗
Tankering of water - Sea Tankering	✗
Drought intervention - Temporary transfer	✗

#### Unconstrained list of resource options

- P.10 For option types that passed the generic screening exercise, option identification was conducted to identify an Unconstrained List of potential options. The feasibility of the options on the Unconstrained list was then assessed. These studies led to the production of the Feasible List of options of each resource type that has then been further evaluated at the Further Screening stage, which used the investment model to run different scenarios comparing options, to produce the Constrained List of specific options. The Unconstrained List is set out in Table P-2, indicating the screening status of each specific option identified. (Note: apart from raw water transfer conveyance elements, the table does not include system elements (e.g. water treatment, raw water system or network reinforcement elements) unless they are integral to a specific resource option).
- P.11 Where schemes are shown as having been screened out, the reasoning can be found in Appendix Q: Scheme Rejection Register.

Table P - 2: Unconstrained list of resource elements

Option		Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
type	Name	Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
London WRZ										
Reuse	Reuse Beckton - 380 MI/d <sup>3</sup>	✓	✓	✓	✓	✗	380 MI/d	316 MI/d	316 MI/d	316 MI/d
	Reuse Beckton - 300 MI/d <sup>4</sup>	✓	✓	✓	✓	✓	300 MI/d	252 MI/d	252 MI/d	252 MI/d
	Reuse Beckton - 200 MI/d <sup>4</sup>	✓	✓	✓	✓	✓	200 MI/d	172 MI/d	172 MI/d	172 MI/d
	Reuse Beckton - 150 MI/d <sup>4</sup>	✓	✓	✓	✓	✓	150 MI/d	130 MI/d	130 MI/d	130 MI/d
	Reuse Beckton - 100 MI/d <sup>4</sup>	✓	✓	✓	✓	✓	100 MI/d	89 MI/d	89 MI/d	89 MI/d
	Reuse Beckton - 50 MI/d	✓	✓	✓	✓	✓	50 MI/d	46 MI/d	46 MI/d	46 MI/d
	Abbey Mills PS Sewer Mining (Luxborough Lane) - 300 MI/d	✓	✗				300 MI/d	n/a	n/a	n/a
	Abbey Mills PS Sewer Mining (Luxborough Lane) - 200 MI/d	✓	✗				200 MI/d	n/a	n/a	n/a
	Abbey Mills PS Sewer Mining (Luxborough Lane) - 150 MI/d	✓	✗				150 MI/d	n/a	n/a	n/a
	Abbey Mills PS Sewer Mining (Luxborough Lane) - 100 MI/d	✓	✗				100 MI/d	n/a	n/a	n/a
	Abbey Mills PS Sewer Mining (Luxborough Lane) - 50 MI/d	✓	✗				50 MI/d	n/a	n/a	n/a
	Abbey Mills PS Sewer Mining (Lower Hall) – 300 MI/d	✓	✓	✗			300 MI/d	n/a	n/a	n/a
	Abbey Mills PS Sewer Mining (Lower Hall) – 200 MI/d	✓	✓	✗			200 MI/d	n/a	n/a	n/a
	Abbey Mills PS Sewer Mining (Lower Hall) – 150 MI/d	✓	✓	✗			150 MI/d	n/a	n/a	n/a
	Abbey Mills PS Sewer Mining (Lower Hall) – 100 MI/d	✓	✓	✗			100 MI/d	n/a	n/a	n/a
	Abbey Mills PS Sewer Mining (Lower Hall) – 50 MI/d	✓	✓	✗			50 MI/d	n/a	n/a	n/a

<sup>2</sup> Capacity is stated in MI/d unless stated otherwise.

<sup>3</sup> A WRMP19 review of cumulative effects of Thames Water WRMP19 options on the receptor environment in the Middle Thames Tideway identified that if there is more than a 15-20% decrease (275-366 MI/d) in freshwater inputs to the Middle Tideway normal salinity patterns could be substantially affected. The London Effluent Reuse SRO has therefore considered options up to 300 MI/d, however at WRMP19 a maximum capacity of 380 MI/d was assessed as feasible for Beckton Reuse. The 380 MI/d option remains on the Feasible List while further work is ongoing to review the cumulative impact of options on the Middle Tideway salinity.

<sup>4</sup> Option is phased in WRSE investment model option, see Appendix R for details of phasing.

Option type	Name	Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
		Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	Reuse Mogden - 200 MI/d <sup>5,6</sup>	✓	✓	✓	✓	✓	200 MI/d	169 MI/d	169 MI/d	169 MI/d
	Reuse Mogden - 150 MI/d <sup>5</sup>	✓	✓	✓	✓	✓	150 MI/d	130 MI/d	130 MI/d	130 MI/d
	Reuse Mogden - 100 MI/d <sup>5</sup>	✓	✓	✓	✓	✓	100 MI/d	88 MI/d MI/d	88 MI/d	88 MI/d
	Reuse Mogden - 50 MI/d	✓	✓	✓	✓	✓	50 MI/d	46 MI/d	46 MI/d	46 MI/d
	Mogden Reuse (Mogden STW) – 212 MI/d	✓	✓	✗			212 MI/d	n/a	n/a	n/a
	Deephams Reuse – 46.5 MI/d <sup>7</sup>	✓	✓	✓	✓	✓	46.5 MI/d	42 MI/d	42 MI/d	42 MI/d
	Deephams Reuse – 25 MI/d	✓	✓	✗			25 MI/d	n/a	25 MI/d (NC)	n/a
	Crossness Reuse - 190 MI/d	✓	✓	✓	✓	✗	190 MI/d	164 MI/d	164 MI/d	164 MI/d
	Crossness Reuse - 150 MI/d	✓	✓	✓	✓	✗	150 MI/d	130 MI/d	130 MI/d	130 MI/d
	Crossness Reuse - 100 MI/d	✓	✓	✓	✓	✗	100 MI/d	89 MI/d	89 MI/d	89 MI/d
	Crossness Reuse - 90 MI/d	✓	✓	✓	✓	✗	90 MI/d	79 MI/d	79 MI/d	79 MI/d
	Crossness Reuse - 50 MI/d	✓	✓	✓	✓	✗	50 MI/d	46 MI/d	46 MI/d	46 MI/d
	Reuse Mogden S Sewer <sup>8</sup>	✓	✓	✓	✓	✓	50 MI/d	46 MI/d	46 MI/d	46 MI/d
	Greenwich PS Sewer Mining (Lower Hall) - 150 MI/d	✓	✗				150 MI/d	n/a	n/a	n/a
	Greenwich PS Sewer Mining (Lower Hall) – 100 MI/d	✓	✗				100 MI/d	n/a	n/a	n/a
	Greenwich PS Sewer Mining (Lower Hall) – 50 MI/d	✓	✗				50 MI/d	n/a	n/a	n/a

<sup>5</sup> Option is phased in WRSE investment model option, see Appendix R for details of phasing.

<sup>6</sup> Further modelling has shown that a maximum capacity of 200 MI/d has a high risk of breaching Environment Agency guidance but does not risk breaching the Water Framework Directive (WFD) threshold, this option will therefore has a maximum of 150 MI/d in the Gate 2 Report. Further work will continue to develop an operational philosophy to mitigate this risk this may result in further changes to the maximum capacity. Any changes will be reflected in the final WRMP documents

<sup>7</sup> Following completion of the further studies by Thames Water, a joint review of the findings with the Environment Agency has established that a Deephams STW Reuse option is incompatible with the environmental ambition flow targets that the Environment Agency is seeking to deliver for the Lower River Lee through WRSE and the Environment Agency's Environmental Destination work. The option has been included on the Constrained List for implementation after 2060 as it could be considered following delivery of measures under the EA's Environmental Destination work.

<sup>8</sup> Dry Weather Flow (DWF) monitoring data was gathered during the London Effluent Reuse SRO Gate 2 stage, which showed DWF values of 33 to 36 MI/d. This is substantially below a DWF of 60 MI/d required to support a 50 MI/d Mogden South Sewer scheme. As a result only a smaller deployable output c.25 MI/d is possible; however the option is retained while the additional wastewater benefits of the option are reviewed.



Option		Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
type	Name	Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	Greenwich PS Sewer Mining (Hogsmill) – 150 MI/d	✓	✗				150 MI/d	n/a	n/a	n/a
	Greenwich PS Sewer Mining (Hogsmill) – 100 MI/d	✓	✗				100 MI/d	n/a	n/a	n/a
	Greenwich PS Sewer Mining (Hogsmill) – 50 MI/d	✓	✗				50 MI/d	n/a	n/a	n/a
	Millbrook Road PS Sewer Mining (Hogsmill) – 100 MI/d	✓	✓	✗			100 MI/d	n/a	n/a	n/a
	Millbrook Road PS Sewer Mining (Hogsmill) – 50 MI/d	✓	✓	✗			50 MI/d	n/a	n/a	n/a
	Wandle Valley PS Sewer Mining (Hogsmill) – 17 MI/d	✓	✓	✗			17 MI/d	n/a	n/a	n/a
	Long Reach STW Final Effluent Reuse (adjacent to site) – 80 MI/d	✓	✗				80 MI/d	n/a	n/a	n/a
	Long Reach STW Final Effluent Reuse (adjacent to site) – 50 MI/d	✓	✗				50 MI/d	n/a	n/a	n/a
	Riverside STW Final Effluent Reuse (adjacent to site) – 38 MI/d	✓	✗				38 MI/d	n/a	n/a	n/a
Desalination	Crossness Desalination (Unblended) - 65 MI/d	✓	✓	✓	✗		65 MI/d	n/a	n/a	n/a
	Crossness Desalination (Blended) – 300 MI/d <sup>9</sup>	✓	✓	✓	✓	✓	300 MI/d	267 MI/d	267 MI/d	267 MI/d
	Crossness Desalination (Blended) – 250 MI/d <sup>9</sup>	✓	✓	✓	✓	✓	250 MI/d	222 MI/d	222 MI/d	222 MI/d
	Crossness Desalination (Blended) – 200 MI/d <sup>9</sup>	✓	✓	✓	✓	✓	200 MI/d	178 MI/d	178 MI/d	178 MI/d
	Crossness Desalination (Blended) – 150 MI/d <sup>10</sup>	✓	✓	✓	✓	✓	150 MI/d	133 MI/d	133 MI/d	133 MI/d
	Crossness Desalination (Blended) – 100 MI/d	✓	✓	✓	✓	✓	100 MI/d	89 MI/d	89 MI/d	89 MI/d
	Crossness Desalination (Blended) –50 MI/d	✓	✓	✓	✓	✓	50 MI/d	44 MI/d	44 MI/d	44 MI/d
	Beckton Desalination - 150 MI/d	✓	✓	✓	✓	✓	150 MI/d	133 MI/d	133 MI/d	133 MI/d
	Beckton Desalination – 100 MI/d	✓	✓	✓	✓	✓	100 MI/d	89 MI/d	89 MI/d	89 MI/d
	Beckton Desalination – 50 MI/d	✓	✓	✓	✓	✓	50 MI/d	44 MI/d	44 MI/d	44 MI/d
	River Lee, Coppermills Water Treatment Works (WTW) (blended)	✓	✗				150 MI/d	n/a	n/a	n/a

<sup>9</sup> Option is phased in WRSE investment model option, see Appendix R for details of phasing.

<sup>10</sup> Option is phased in WRSE investment model option, see Appendix R for details of phasing.

Option		Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
type	Name	Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	Manor Road, Erith, Honor Oak, (blended)	✓	✗				150 MI/d	n/a	n/a	n/a
	Crossness (Erith Southern Grazing Marshes) -150 MI/d	✓	✓	✗			150 MI/d	n/a	n/a	n/a
	Crossness (Erith Southern Grazing Marshes) – 300 MI/d	✓	✓	✗			300 MI/d	n/a	n/a	n/a
	Tripcock Ness, Thamesmead Coppermills WTW (blended) - 150 MI/d	✓	✗				150 MI/d	n/a	n/a	n/a
	Tripcock Ness, Thamesmead Coppermills WTW (blended) – 300 MI/d	✓	✗				300 MI/d	n/a	n/a	n/a
Raw Water Transfer (Resource)	Kielder Reservoir	✓	✗				Not defined	n/a	n/a	n/a
	Great Spring	✗					Not defined	n/a	n/a	n/a
	Mythe abstraction reduction - 15 MI/d – STT resource	✓	✓	✓	✓	✗	15 MI/d <sup>3</sup>	10 MI/d	10 MI/d	14 MI/d
	Minworth STW effluent diversion Phase 2 – 115 MI/d <sup>11</sup> – STT resource	✓	✓	✓	✓	✓	115 MI/d <sup>13</sup>	70 MI/d	70 MI/d	99 MI/d
	Minworth STW effluent diversion Phase 1 – 58 MI/d– STT resource	✓	✓	✓	✓	✓	58 MI/d <sup>13</sup>	35 MI/d	35 MI/d	49 MI/d
	Minworth STW effluent for transfer through existing canal network – STT resource	✗					75 MI/d	n/a	n/a	n/a
	Netheridge STW effluent diversion - 35 MI/d – STT resource	✓	✓	✓	✓	✓	35 MI/d <sup>13</sup>	24 M/d	24 M/d	34 M/d
	Shrewsbury Redeployment – 25 MI/d – STT resource	✓	✓	✓	✓	✗	25 MI/d <sup>13</sup>	14 MI/d	14 MI/d	19 MI/d
	Lake Vyrnwy - 50 MI/d – STT resource <sup>12</sup>	✓	✓	✓	✓	✓	50 MI/d <sup>13</sup>	29 MI/d	29 MI/d	41 MI/d
	Lake Vyrnwy - 75 MI/d <sup>11</sup> – STT resource <sup>12</sup>	✓	✓	✓	✓	✓	75 MI/d <sup>13</sup>	43 MI/d	43 MI/d	61 MI/d
	Lake Vyrnwy - 100 MI/d <sup>11</sup> – STT resource <sup>12</sup>	✓	✓	✓	✓	✓	100 MI/d <sup>13</sup>	57 MI/d	57 MI/d	81 MI/d
	Lake Vyrnwy - 135 MI/d <sup>11</sup> – STT resource <sup>12</sup>	✓	✓	✓	✓	✓	135 MI/d <sup>13</sup>	77 MI/d	77 MI/d	110 MI/d
	Lake Vyrnwy - 155 MI/d <sup>11</sup> – STT resource <sup>12</sup>	✓	✓	✓	✓	✓	155 MI/d <sup>13</sup>	86 MI/d	86 MI/d	122 MI/d
	Lake Vyrnwy - 180 MI/d <sup>11</sup> – STT resource <sup>12</sup>	✓	✓	✓	✓	✓	180 MI/d <sup>13</sup>	103 MI/d	103 MI/d	146 MI/d

<sup>12</sup> The North West Transfer (Vyrnwy) options are being selected by both WRW and WRSE. Adaptive planning enables the use of 75 MI/d from the North West Transfer by Severn Trent until the year the scheme is selected by WRSE.

Option type	Name	Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
		Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	Craig Goch Reservoir expansion	✗					Not defined	n/a	n/a	n/a
	River Severn (independent unsupported River Severn resource option, without support options) <sup>13</sup> – STT resource	✓	✓	✓	✗		n/a	134 MI/d	134 MI/d	134 MI/d
	Longdon Marsh reservoir to support River Severn abstraction – 50 Mm <sup>3</sup> – STT resource	✓	✗				50 Mm <sup>3</sup>	n/a	n/a	n/a
	Longdon Marsh reservoir to support River Severn abstraction – 89 Mm <sup>3</sup> – STT resource	✓	✗				89 Mm <sup>3</sup>	n/a	n/a	n/a
	Longdon Marsh reservoir to support River Severn abstraction – 125 Mm <sup>3</sup> – STT resource	✓	✗				125 Mm <sup>3</sup>	n/a	n/a	n/a
	River Wye to Deerhurst – 60.3 MI/d – STT resource	Offer withdrawn by DCWW and not assessed					60.3 MI/d	n/a	n/a	n/a
	Use of a new Thames reservoir (as in reservoir report, if successfully promoted) to support River Severn abstraction and transfer <sup>14</sup>	✗					n/a	n/a	n/a	n/a
	Use of Farmoor Reservoir to support River Severn abstraction and transfer	✗					n/a	n/a	n/a	n/a
	Oxford Canal – Farmoor reservoir	n/a	✓	✓	✓	✓	15 MI/d	12 MI/d	12 MI/d	12 MI/d
	Oxford Canal - Cropredy resource <sup>15</sup>	✓	✓	✓	✓	✓	15 MI/d	10.3 MI/d	10.3 MI/d	10.3 MI/d
	Canal transfer Minworth STW to River Thames	n/a	✗				75 MI/d	n/a	n/a	n/a
	Oxford Canal – Farmoor reservoirs conveyance	n/a	✓	✓	✓	✓	15 MI/d	n/a	n/a	n/a

<sup>13</sup> DOs for the Severn Thames Transfer (STT) are based upon stochastic modelling including climate change, other abstractors using licenced amounts and assumed (where applicable) 15% losses in River Severn and 10% losses in the River Avon. Although the entirely unsupported STT option has been rejected, the DO benefit of the unsupported resource needs to be added to the DO benefit of the support elements to provide the overall DO benefit of the partially supported STT under the DYAA condition, but the unsupported benefit is not included within the DO for the ADPW condition as its availability during the peak week cannot be assured.

<sup>14</sup> SESRO SRO has modelled the potential DO benefit that could be achieved by providing a link between SESRO and STT, this is reported against SESRO / STT interconnector - Conjunctive Use Benefit under Inter-Company Transfers.

<sup>15</sup> Two Oxford Canal options have been identified. The Cropredy option supplies the London Water Resource zone by transfer of water to canal at Cropredy for discharge to River Cherwell and subsequent discharge to the River Thames. The Second option supplies SWOX through a conveyance pipeline from Duke's Cut on the Oxford Canal to the River Thames upstream of the existing Farmoor intake.

Option		Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
type	Name	Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
Raw Water Transfer <sup>16</sup> (Conveyance)	Pipeline from Kielder Reservoir	n/a	✓	✗			Up to 300 MI/d to LON; 40 MI/d to SWOX	n/a	n/a	n/a
	Canals from Kielder Reservoir	n/a	✗				45 MI/d	n/a	n/a	n/a
	Oxford Canal - Cropredy resource conveyance	✓	✓	✓	✓	✓	15 MI/d	n/a	n/a	n/a
	STT - Raw Water Transfer Deerhurst to Culham - 100 MI/d	n/a	✗				100 MI/d	n/a	n/a	n/a
	Deerhurst to Radcot - 300 MI/d	n/a	✗				300 MI/d	n/a	n/a	n/a
	Deerhurst to Radcot - 600 MI/d	n/a	✗				600 MI/d	n/a	n/a	n/a
	STT - Raw Water Transfer Deerhurst to Culham - 300 MI/d	n/a	✓	✓	✓	✓	300 MI/d	80 MI/d	80 MI/d	80 MI/d
	STT - Raw Water Transfer Deerhurst to Culham 400 MI/d	n/a	✓	✓	✓	✓	400 MI/d	107 MI/d	107 MI/d	107 MI/d
	STT - Raw Water Transfer Deerhurst to Culham - 500 MI/d	n/a	✓	✓	✓	✓	500 MI/d	134 MI/d	134 MI/d	134 MI/d
	STT - Raw Water Transfer Deerhurst to Culham - 600 MI/d	n/a	✓	✗			600 MI/d	n/a	n/a	n/a
	STT – Raw Water Transfer Deerhurst to Lechlade - 100 MI/d	n/a	✓	✓	✗		100 MI/d	n/a	n/a	n/a
	STT - Cotswold Canal - 100 MI/d	n/a	✓	✗			100 MI/d	n/a	n/a	n/a
	STT - Cotswold Canal - 300 MI/d	n/a	✓	✓	✓	✗	300 MI/d	78 MI/d	78 MI/d	78 MI/d
	Thames to Southern Transfer Spur to Fobney	✗					n/a	n/a	n/a	n/a
Reservoir <sup>17</sup>	SESRO / Abingdon Reservoir - 150 Mm <sup>3</sup>	✓	✓	✓	✓	✓	150 Mm <sup>3</sup>	271 MI/d	271 MI/d	271 MI/d
	SESRO / Abingdon Reservoir - 125 Mm <sup>3</sup>	✓	✓	✓	✓	✓	125 Mm <sup>3</sup>	230 MI/d	230 MI/d	230 MI/d
	SESRO / Abingdon Reservoir - 100 Mm <sup>3</sup>	✓	✓	✓	✓	✓	100 Mm <sup>3</sup>	185 MI/d	185 MI/d	185 MI/d
	SESRO / Abingdon Reservoir - 75 Mm <sup>3</sup>	✓	✓	✓	✓	✓	75 Mm <sup>3</sup>	149 MI/d	149 MI/d	149 MI/d
	SESRO / Abingdon Reservoir – 50 Mm <sup>3</sup>	✓	✓	✓	✓	✗	50 Mm <sup>3</sup>	103 MI/d	103 MI/d	103 MI/d

<sup>16</sup> For raw water transfers the raw water support and conveyance elements are provided separately in the table. The actual DO of transfer options will depend upon combinations of resource and conveyance elements.

<sup>17</sup> Reservoir options rejected prior to Stage 3 have not been assessed based on possible capacities but rather on land areas (size bands A,B,C).

Band A: sites with a development area between 200 and 399 hectares

Band B: sites with a development area between 400 and 699 hectares

Band C: sites with a development area of 700 hectares and greater

Option type	Name	Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
		Stage 1	Stage 2	Stage 3	Validation	Further screening	(Ml/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	SESRO / Abingdon Reservoir – 30 Mm <sup>3</sup>	✓	✓	✓	✓	✗	30 Mm <sup>3</sup>	66 Ml/d	66 Ml/d	66 Ml/d
	SESRO / Abingdon Reservoir Phased - 80 + 42 Mm <sup>3</sup>	✓	✓	✓	✓	✓	80 Mm <sup>3</sup> + 42 Mm <sup>3</sup>	224 Ml/d (155.1 + 68.9)	224 Ml/d (155.1 + 68.9)	224 Ml/d (155.1 + 68.9)
	SESRO / Abingdon Reservoir Phased – 30 + 100 Mm <sup>3</sup>	✓	✓	✓	✓	✓	30 Mm <sup>3</sup> + 100 Mm <sup>3</sup>	238 Ml/d (65.5 + 173.1)	238 Ml/d (65.5 + 173.1)	238 Ml/d (65.5 + 173.1)
	Site 41 - Chinnor Reservoir – 75 Mm <sup>3</sup>	✓	✓	✗			75 Mm <sup>3</sup>	149 Ml/d	149 Ml/d	149 Ml/d
	Site 41 - Chinnor Reservoir – 50 Mm <sup>3</sup>	✓	✓	✓	✗		50 Mm <sup>3</sup>	103 Ml/d	103 Ml/d	103 Ml/d
	Site 41 - Chinnor Reservoir 30 Mm <sup>3</sup>	✓	✓	✓	✓	✓	30 Mm <sup>3</sup>	66 Ml/d	66 Ml/d	66 Ml/d
	Site 36 - Marsh Gibbon Reservoir - 100 Mm <sup>3</sup>	✓	✓	✓	✗		100 Mm <sup>3</sup>	185 Ml/d	185 Ml/d	185 Ml/d
	Site 36 - Marsh Gibbon Reservoir - 75 Mm <sup>3</sup>	✓	✓	✓	✓	✓	75 Mm <sup>3</sup>	149 Ml/d	149 Ml/d	149 Ml/d
	Site 36 - Marsh Gibbon Reservoir - 50 Mm <sup>3</sup>	✓	✓	✓	✓	✓	50 Mm <sup>3</sup>	103 Ml/d	103 Ml/d	103 Ml/d
	Site 36 - Marsh Gibbon Reservoir - 30 Mm <sup>3</sup>	✓	✓	✓	✓	✓	30 Mm <sup>3</sup>	66 Ml/d	66 Ml/d	66 Ml/d
	Site 37 - Ludgershall - 50 Mm <sup>3</sup>	✓	✓	✓	✓	✗	50 Mm <sup>3</sup>	103 Ml/d	103 Ml/d	103 Ml/d
	Site 37 - Ludgershall - 30 Mm <sup>3</sup>	✓	✓	✓	✓	✗	30 Mm <sup>3</sup>	66 Ml/d	66 Ml/d	66 Ml/d
	Site 43 - Aylesbury -75 Mm <sup>3</sup>	✓	✓	✗			75 Mm <sup>3</sup>	149 Ml/d	149 Ml/d	149 Ml/d
	Site 43 - Aylesbury - 50 Mm <sup>3</sup>	✓	✓	✓	✓	✗	50 Mm <sup>3</sup>	103 Ml/d	103 Ml/d	103 Ml/d
	Site 43 - Aylesbury - 30 Mm <sup>3</sup>	✓	✓	✓	✓	✗	30 Mm <sup>3</sup>	66 Ml/d	66 Ml/d	66 Ml/d
	Site 42 - Haddenham - 30 Mm <sup>3</sup>	✓	✓	✓	✓	✗	30 Mm <sup>3</sup>	66 Ml/d	66 Ml/d	66 Ml/d
	Site 1 – Minety	✓	✗				A	n/a	n/a	n/a
	Site 2 - Leigh	✓	✗				A	n/a	n/a	n/a
	Site 3 - Cricklade	✗					C	n/a	n/a	n/a
	Site 4 - Swindon	✗					A	n/a	n/a	n/a
	Site 5 – Broad Blunsdon	✓	✗				C	n/a	n/a	n/a
	Site 6 - Highworth	✓	✗				B	n/a	n/a	n/a
	Site 7 - Wanborough	✓	✓	✗			A	n/a	n/a	n/a

Option type	Name	Feasibility Stage			Capacity <sup>2</sup>		(MI/d)	Deployable output		
		Stage 1	Stage 2	Stage 3	Validation	Further screening		1 in 2 average	1 in 500 average	1 in 500 peak
	Site 8 - Bishopstone	✓	✗				C	n/a	n/a	n/a
	Site 9 - Lechlade	✗					B	n/a	n/a	n/a
	Site 10 - Shrivenham	✓	✗				B	n/a	n/a	n/a
	Site 11 – Clanfield	✓	✗				A	n/a	n/a	n/a
	Site 12 - Faringdon	✓	✗				C	n/a	n/a	n/a
	Site 13 - Uffington	✗					B	n/a	n/a	n/a
	Site 14 – Brize Norton	✓	✗				B	n/a	n/a	n/a
	Site 15 - Bampton	✓	✗				B	n/a	n/a	n/a
	Site 16 - Witney	✓	✗				B	n/a	n/a	n/a
	Site 17 – Stanford in the Vale	✓	✗				B	n/a	n/a	n/a
	Site 18 - Longworth	✓	✗				B	n/a	n/a	n/a
	Site 19 – South Leigh	✓	✗				A	n/a	n/a	n/a
	Site 20 – West Hanney	✗					B	n/a	n/a	n/a
	Site 21 – Stanton Harcourt	✓	✗				A	n/a	n/a	n/a
	Site 23 - Wantage	✓	✗				B	n/a	n/a	n/a
	Site 24 - Kidlington	✗					B	n/a	n/a	n/a
	Site 25 - Oxford	✓	✗				A	n/a	n/a	n/a
	Site 26 - Didcot	✓	✗				A	n/a	n/a	n/a
	Site 27 - Beckley	✗					C	n/a	n/a	n/a
	Site 28 – Brightwell cum Sotwell	✗					B	n/a	n/a	n/a
	Site 29 - Ambrosden	✗					A	n/a	n/a	n/a
	Site 30 – Drayton St Leonard	✓	✗				A	n/a	n/a	n/a
	Site 31 - Wheatley	✗					B	n/a	n/a	n/a
	Site 32 – Benson	✗					B	n/a	n/a	n/a
	Site 33 – Chalgrove	✓	✗				B	n/a	n/a	n/a

Option		Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
type	Name	Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	Site 34 - Bicester	✗					B	n/a	n/a	n/a
	Site 35 – Chalgrove Airport	✓	✗				B	n/a	n/a	n/a
	Site 38 – Great Haseley	✓	✗				A	n/a	n/a	n/a
	Site 39 - Quainton	✓	✗				B	n/a	n/a	n/a
	Site 40 - Postcombe	✓	✓	✗			A	n/a	n/a	n/a
	Site 44 - Stone	✗					B	n/a	n/a	n/a
	Site 45 - Whitchurch	✗					A	n/a	n/a	n/a
	Site 46 - Stewkley	✗					B	n/a	n/a	n/a
	Site 47 - Birtton	✗					B	n/a	n/a	n/a
	Site 48 - Wingrave	✗					A	n/a	n/a	n/a
	Site 49 - Cheddington	✓	✗				A	n/a	n/a	n/a
	Site 50 - Kintbury	✓	✗				B	n/a	n/a	n/a
	Site 51 - Burghfield	✗					A	n/a	n/a	n/a
	Site 52 – Beech Hill	✓	✗				B	n/a	n/a	n/a
	Site 53 - Wokingham	✗					A	n/a	n/a	n/a
	Site 54 - Bracknell	✓	✓	✗			A	n/a	n/a	n/a
	Site 55 - Maidenhead	✗					A	n/a	n/a	n/a
Direct River Abstraction	Teddington DRA – 50 MI/d <sup>18</sup>	✓	✓	✓	✓	✓	50 MI/d	46 MI/d	46 MI/d	46 MI/d
	Teddington DRA – 75 MI/d	✓	✓	✓	✓	✓	75 MI/d	67 MI/d	67 MI/d	67 MI/d
	Teddington DRA – 100 MI/d	✗					100 MI/d	n/a	n/a	n/a
	Teddington DRA – 150 MI/d	✗					150 MI/d	n/a	n/a	n/a
	Teddington DRA - 300 MI/d	✗					300 MI/d	268 MI/d	268 MI/d	268 MI/d

<sup>18</sup> Since the WRMP24 feasibility assessment London Effluent Reuse SRO has continued to undertake environmental investigations and river modelling; any changes to option feasibility as a result of this work will be reflected in the final WRMP24

Option type	Name	Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
		Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	New river abstraction from River Lee at Three Mills Lock and transfer to Lockwood Thames-Lee Tunnel Extension	✓	✓	✓	✓	✗	35 MI/d	n/a	n/a	n/a
	River Lee abstraction at Three Mills Lock, transfer to North Woolwich Road site for treatment to potable quality, followed by transfer to service reservoir	✓	✗				35 MI/d	n/a	n/a	n/a
	Mogden effluent transfer to Teddington and new river abstraction at Teddington with transfer to Queen Mother Reservoir	✓	✓	✗			300 MI/d	n/a	n/a	n/a
	Mogden effluent transfer to Teddington and new river abstraction at Teddington for direct supply	✓	✗				300 MI/d	n/a	n/a	n/a
	Mogden effluent transfer to Teddington and increase of existing river abstraction upstream at Surbiton	✗					300 MI/d	n/a	n/a	n/a
	Beckton effluent transfer to Teddington and new river abstraction at Teddington connecting to Thames-Lee Tunnel	✗					300 MI/d	n/a	n/a	n/a
	Beckton effluent transfer to Teddington and new river abstraction at Teddington with transfer to Queen Mother Reservoir	✗					300 MI/d	n/a	n/a	n/a
	Beckton effluent transfer to Teddington and new river abstraction and treatment at Teddington for direct supply	✗					300 MI/d	n/a	n/a	n/a
	New river abstraction on Lower River Roding	✗					17.3 MI/d	n/a	n/a	n/a
	New river abstraction on River Mardyke	✗					3.7 MI/d	n/a	n/a	n/a
	New river abstraction on River Rom/Beam	✗					7.2 MI/d	n/a	n/a	n/a
	New river abstraction on River Ingrebourne	✗					4.2 MI/d	n/a	n/a	n/a
Raw Water Purchase	Didcot Raw Water Purchase	n/a	n/a	n/a	n/a	✓	22.6 MI/d	0 MI/d	22.6 MI/d	22.6 MI/d
	Chingford Raw Water Purchase <sup>19</sup>	n/a	n/a	n/a	n/a	✗	20 MI/d	n/a	n/a	n/a
Aquifer Recharge	Kidbrooke Aquifer Recharge/Aquifer Storage and Recovery (SLARS1)	✓	✓	✓	✓	✓	8 MI/d	8 MI/d	8 MI/d	8 MI/d

<sup>19</sup> Chingford Raw Water Purchase is included in the baseline for the period of the existing contract (up to 2035) however this option has been rejected as Essex and Suffolk cannot offer an extension beyond 2035 due to their Environmental Destination needs. The full rejection reasoning can be found in Appendix Q – Rejection Register.



Option type	Name	Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
		Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	South London Artificial Recharge Scheme (SLARS) – Merton Abbey	✓	✓	✓	✓	✓	6 MI/d	6 MI/d	6 MI/d	5 MI/d
	South London Artificial Recharge Scheme (SLARS) - Streatham	✓	✓	✓	✓	✓	5 MI/d	5 MI/d	5 MI/d	7 MI/d
	AR - HARS (Hornsey)	Option not assessed as WARMS2 modelling indicated that there was no Deployable Output benefit for this option								
Aquifer Storage and Recovery	South East London (Addington) Aquifer Storage and Recovery	✓	✓	✓	✓	✓	3 MI/d	3 MI/d	3 MI/d	5 MI/d
	Thames Valley Central Aquifer Storage and Recovery	✓	✓	✓	✓	✓	3 MI/d	3 MI/d	3 MI/d	5 MI/d
	ASR Horton Kirby <sup>20</sup>	✓	✓	✓	✓	✓	5 MI/d	5 MI/d	5 MI/d	5 MI/d
Groundwater <sup>21</sup>	Groundwater Addington	✓	✓	✓	✓	✓	2.7 MI/d	2.7 MI/d	2.7 MI/d	5.7 MI/d
	London Confined Chalk (north)	✓	✓	✓	✓	✓	2 MI/d	2 MI/d	2 MI/d	2 MI/d
	Southfleet/Greenhithe (new WTW) <sup>20</sup>	✓	✓	✓	✓	✓	8.8 MI/d	8.8 MI/d	8.8 MI/d	8.8 MI/d
	Merton Recommissioning	✓	✓	✓	✓	✓	2 MI/d	2 MI/d	2 MI/d	6 MI/d
	North London Licence Trading	✗					1 MI/d	n/a	n/a	n/a
	GW – Honor Oak	✓	✓	✓	✓	✓	1.4 MI/d	1.4 MI/d	1.4 MI/d	2.7 MI/d
	Honor Oak Increase DO	✓	✓	✓	✓	✓	1.7 MI/d	1.7 MI/d	1.7 MI/d	1.7 MI/d
	Nonsuch Increase DO	✗					1.27 MI/d	n/a	n/a	n/a
	GW – Epsom	✗					3.3 MI/d	n/a	n/a	n/a
	Shortlands	✓	✗				4.2 MI/d	n/a	n/a	n/a
	London confined Chalk (north-east)	✓	✗				0.5 MI/d	n/a	n/a	n/a
	Epsom Removal of Constraints	✓	✓	✓	✗		3 MI/d	3 MI/d	3 MI/d	2.8 MI/d

<sup>20</sup> ASR Horton Kirby and Southfleet & Greenhithe Groundwater schemes were included in the WRMP19 Preferred Programme for London for delivery in AMP7 (2020-25). Since WRMP19 the delivery of these options has been deferred beyond the end of AMP7 as the supply demand balance in the London WRZ is in surplus. They are therefore included as WRMP24 Options

<sup>21</sup> New River Head groundwater scheme was included in the WRMP19 Preferred Programme for London for delivery in AMP7 (2020-25). This option is therefore not included in the Draft WRMP plan however since this decision the option has been deferred beyond the end of AMP7 as the supply demand balance in the London WRZ is in surplus. The option will therefore be included in the Final WRMP24 options list.

Option		Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
type	Name	Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
Removal of Deployable Output Constraints	RC – Green St Green	Option not assessed as it is being delivered and therefore the additional deployable output is included in the baseline.								
	Queen Mary Reservoir – Removal of Outlet Constraint <sup>22</sup>	TBC					6 MI/d			
	Queen Mary Reservoir – Removal of Low-level Constraint <sup>21</sup>	TBC					8 MI/d			
	Queen Mary Reservoir – Removal of Baffle <sup>21</sup>	TBC					2 MI/d			
Catchment Management <sup>23</sup>	Bean Wellfield (Groundwater)	✓	✓	✓	✓	✓	n/a	0.1 MI/d	0.1 MI/d	0.1 MI/d
	Green Street Green (Groundwater)	✓	✓	✓	✓	✓	n/a	0.3 MI/d	0.3 MI/d	0.3 MI/d
	Wilmington (Groundwater)	✓	✓	✓	✓	✓	n/a	0.2 MI/d	0.2 MI/d	0.2 MI/d
Inter-Company Transfers <sup>24</sup>	Cheam to Merton Transfer	TBC <sup>25</sup>					15-200 MI/d			
	Woodmansterne WTW to Epsom Downs	TBC <sup>26</sup>					10 MI/d			
	Thames to Affinity Transfer - Conjunctive Use Benefit	Dependent on T2AT being implemented					n/a	25 MI/d per 50 MI/d of T2AT transfer capacity up to a maximum benefit of 50 MI/d		
	SESRO / STT interconnector - Conjunctive Use Benefit	Dependent on both SESRO and STT being implemented					n/a	At the time of uploading information to the WRSE investment model it was understood that there would be no DO benefit from the STT / SESRO link, however subsequent work has shown in that there is a small DO benefit of 11 MI/d, this is further reported in the SESRO Gate 2 Reports and will be included in the Final WRMP documents.		

<sup>22</sup> Work to understand the feasibility of this option as a supply option for WRMP has been paused due to limited evidence that this option could bring a meaningful DO benefit to the WRZ

<sup>23</sup> Only Catchment Management Options with a DO benefit have been included in Appendix P

<sup>24</sup> Modelling has been undertaken to understand the conjunctive use benefit from Thames to Southern Transfer (T2ST) this was not completed at the time of upload of information to the WRSE investment model, this is therefore not included in the draft WRMP24 documents. The T2ST conjunctive use benefit will be reflected in the final WRMP24.

<sup>25</sup> Cheam to Merton Transfer was identified late in the WRMP process and has therefore not been screened at the time of issuing the draft WRMP document. This will be further developed before the final issue of the WRMP.

<sup>26</sup> Woodmansterne WTW to Epsom Downs was identified late in the WRMP process and has therefore not been screened at the time of issuing the draft WRMP document. This will be further developed before the final issue of the WRMP.

Option		Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
type	Name	Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
SWOX WRZ										
Raw Water Transfer (resource)	Oxford Canal - Duke's Cut (SWOX) - Resource <sup>27</sup>	✓	✓	✓	✓	✓	15 MI/d	12 MI/d	12 MI/d	12 MI/d
	Oxford Canal (CRT BCN Surplus) - Farmoor Reservoir (SWOX)	✓	✓	✓	✓	✓	15 MI/d	n/a	n/a	n/a
Raw Water Transfer (conveyance)	Severn Thames Transfer, Deerhurst – Culham: see London WRZ for sizes	✓	✓	✓	✓	✓		n/a	n/a	n/a
	Oxford Canal - Duke's Cut (SWOX) – Conveyance	✓	✓	✓	✓	✓	15 MI/d	n/a	n/a	n/a
	Oxford Canal (CRT BCN Surplus) - Farmoor Reservoir (SWOX) - Conveyance	✓	✓	✓	✓	✓	15 MI/d	n/a	n/a	n/a
New Reservoir	Abingdon Reservoir: see London WRZs for sizes and DO <sup>28</sup>	✓	✓	✓	✓	✓	n/a	n/a	n/a	n/a
	Chinnor Reservoir: see London WRZs for sizes and DO <sup>28</sup>	✓	✓	✓	✓	✓	n/a	n/a	n/a	n/a
	Marsh Gibbon Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✓	n/a	n/a	n/a	n/a
	Ludgershall Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✗	n/a	n/a	n/a	n/a
	Aylesbury Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✗	n/a	n/a	n/a	n/a
	Haddenham Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✗	n/a	n/a	n/a	n/a
Direct River Abstraction	River Thames Culham abstraction - Abstraction at Culham and transfer to Farmoor Reservoir via a new pumping main	✗					4.5 MI/d	n/a	n/a	n/a
	River Thames Days Weir Abstraction - River Thames abstraction at Days Weir and transfer to Farmoor	✗					40 MI/d	n/a	n/a	n/a
	Recommission existing Direct River Abstraction and treatment at Culham and directly supply to SWOX	✓	✓	✗			4.5 MI/d	n/a	n/a	n/a
Aquifer recharge	AR – Cricklade	✓	✗				10.0 MI/d	n/a	n/a	n/a
Groundwater	Moulsford 1	✓	✓	✓	✓	✓	2 MI/d	2 MI/d	2 MI/d	3.5 MI/d

<sup>27</sup> Two Oxford Canal options have been identified. The Cropredy option supplies the London Water Resource zone by transfer of water to canal at Cropredy for discharge to River Cherwell and subsequent discharge to the River Thames. The second option supplies SWOX through a conveyance pipeline from Duke's Cut on the Oxford Canal to the River Thames upstream of the existing Farmoor intake.

<sup>28</sup> It is assumed that the DO benefit from reservoir options is the same for use in London, SWOX and SWA. DOs for non-SRO reservoirs (Marsh Gibbon, Chinnor, Haddenham, Ludgershall and Aylesbury) are based on the DO modelling completed for SESRO / Abingdon Reservoir.

Option type	Name	Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
		Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	Woods Farm Increase DO	✓	✓	✓	✓	✓	2.4 MI/d	2.4 MI/d	2.4 MI/d	2.9 MI/d
	Woods Farm licence increase	✗					3.5 MI/d	n/a	n/a	n/a
	GW - South Stoke 1	✓	✓	✓	✗		3.5 MI/d	n/a	n/a	n/a
	GW - South Stoke 2 (with treatment)	✗					10.0 MI/d	n/a	n/a	n/a
	GW - Moulsoford 2 (with treatment)	✗					7.5 MI/d	n/a	n/a	n/a
	River Marden	✓	✗				0.5 MI/d	n/a	n/a	n/a
	Cotswold Edge	✗					1.0 MI/d	n/a	n/a	n/a
Removal of Constraints to DO	Ashton Keynes borehole pumps - Removal of Constraints to DO	✓	✓	✓	✓	✓	2.0 MI/d	0 MI/d	0 MI/d	2.04 MI/d
	Witheridge Hill borehole pumps	✓	✗				0.6 MI/d	n/a	n/a	n/a
	Britwell Removal of Constraints	✓	✓	✓	✓	✓	1.3 MI/d	1.3 MI/d	1.3 MI/d	1.3 MI/d
Internal Inter-Zonal Transfer	Henley to SWOX – 2.4 MI/d	✓	✓	✓	✓	✓	2.4 MI/d	n/a	n/a	n/a
	Henley to SWOX – 5 MI/d	✓	✓	✓	✓	✓	5 MI/d	n/a	n/a	n/a
	Kennet Valley to SWOX - 6.7 MI/d	✓	✓	✓	✓	✓	4.5 MI/d	n/a	n/a	n/a
	Kennet Valley to SWOX - 2.3 MI/d	✓	✓	✓	✓	✓	2.3 MI/d	n/a	n/a	n/a
	Kennet Valley to SWOX - 8.31 MI/d	✓	✓	✗				n/a	n/a	n/a
	Transfer from Hambleden WTW to Long Crendon SR to an existing pipeline at Milton	✗					Not defined	n/a	n/a	n/a
	Transfer from Hambleden WTW to Long Crendon SR to an existing service reservoir at Shotover.	✗					Not defined	n/a	n/a	n/a
	Transfer from Hambleden WTW to Long Crendon SR to an existing pipeline at Marston	✗					Not defined	n/a	n/a	n/a
	Transfer from Hambleden WTW to Nettlebed service reservoir to Beggarbush service reservoir at South Oxford area.	✗					Not defined	n/a	n/a	n/a
Inter-Company Transfers	Wessex to SWOX Charlton WTW to Minety SR and from there to Flaxlands SR in South Swindon. Note earliest operational date for option is 2040.	✓	✓	✓	✓	✓	2.9 MI/d	2.9 MI/d	2.9 MI/d	2.9 MI/d

Option type	Name	Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
		Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
	Wessex to SWOX Charlton WTW to Minety SR and from there to Blunsdon SR in South Swindon	✓	✗				2.9 MI/d	n/a	n/a	n/a
	Wessex to SWOX Charlton WTW to Minety SR and from there to Ashton Keynes WTW in South Swindon	✓	✓	✗			2.9 MI/d	n/a	n/a	n/a
<b>SWA WRZ</b>										
<b>Aquifer storage and recovery</b>	Hampden Bottom-Wendover	✓	✗				7.5 MI/d	n/a	n/a	n/a
<b>Raw Water Transfer</b>	Severn Thames Transfer, Deerhurst – Culham: see London WRZs for sizes	✓	✓	✓	✓	✓				
<b>New Reservoir</b>	Abingdon Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✓	n/a	n/a	n/a	n/a
	Chinnor Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✓	n/a	n/a	n/a	n/a
	Marsh Gibbon Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✓	n/a	n/a	n/a	n/a
	Ludgershall Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✗	n/a	n/a	n/a	n/a
	Aylesbury Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✗	n/a	n/a	n/a	n/a
	Haddenham Reservoir: see London WRZs for sizes and DO	✓	✓	✓	✓	✗	n/a	n/a	n/a	n/a
<b>Groundwater</b>	Remenham	✗					10.0 MI/d	n/a	n/a	n/a
	GW – West Marlow	✗					15.0 MI/d	n/a	n/a	n/a
	Bourne End (Marlow East)	✗					9.3 MI/d	n/a	n/a	n/a
	Medmenham	✗					0.0 MI/d	n/a	n/a	n/a
	Taplow	✗					5.1 MI/d	n/a	n/a	n/a
	Taplow Increase DO	✓	✓	✓	✓	✓	5.7 MI/d	0 MI/d	0 MI/d	5.7 MI/d
	Datchet Increase DO	✓	✓	✓	✓	✓	1.6 MI/d	1.6 MI/d	1.6 MI/d	6.2 MI/d
	Dorney Increase DO	✓	✓	✓	✓	✓	4.3 MI/d	0 MI/d	0 MI/d	4.3 MI/d
<b>Removal of Constraints to DO</b>	Hampden Disinfection Upgrade	✗					0.8 MI/d	n/a	n/a	n/a
<b>Internal Inter-Zonal Transfer</b>	Henley to SWA - 2.4 MI/d	✓	✓	✓	✓	✓	2.4 MI/d	n/a	n/a	n/a
	Henley to SWA – 5 MI/d	✓	✓	✓	✓	✓	5 MI/d	n/a	n/a	n/a

Option		Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
type	Name	Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
Guildford WRZ										
Aquifer storage and recovery	ASR - Guildford (Abbotswood)	✓	✗				4.5 MI/d	n/a	n/a	n/a
Groundwater	Dapdune Licence Disaggregation	✓	✓	✓	✓	✓	2.2 MI/d	0 MI/d	0 MI/d	2.2 MI/d
	Mousehill & Rodborough Rehab	✗					0.18 MI/d	n/a	n/a	n/a
Removal of Constraints to DO	Dapdune Removal of constraints to DO	✓	✓	✓	✓	✓	1 MI/d	0 MI/d	0 MI/d	1 MI/d
	RC - Sturt Road Spring Capture	✓	✗				0.25 MI/d	n/a	n/a	n/a
Inter-Company Transfers	SEW to Guildford - Surrey Hills SR (SEW) to Hogsback SR (TW- Guildford)	✓	✗				10 MI/d	n/a	n/a	n/a
	SEW to Guildford Hogsback SR (SEW) to Mount SR (TW- Guildford)	✓	✓	✓	✓	✓	10 MI/d	10 MI/d	10 MI/d	10 MI/d
	Reigate to Guildford - 5 MI/d <sup>29</sup>			TBC		5 MI/d		n/a	n/a	n/a
	Reigate to Guildford - 20 MI/d <sup>29</sup>			TBC		20 MI/d		n/a	n/a	n/a
Henley WRZ										
Groundwater	Sheeplands licence disaggregation	✗					13.3 MI/d	n/a	n/a	n/a
Kennet Valley WRZ										
Raw Water Transfer	T2ST Spur: Culham to Fobney (Raw)	✗					n/a	n/a	n/a	n/a
Groundwater	Mortimer Disused Source (Recommission)	✓	✓	✓	✓	✓	4.5 MI/d	4.5 MI/d	4.5 MI/d	4.5 MI/d
	GW – Purley	✗					15 MI/d	n/a	n/a	n/a
	GW - Mapledurham	✗					15 MI/d	n/a	n/a	n/a
	GW - Mortimer (transfer peak licence from Arborfield)	✓	✗				6.8 MI/d	n/a	n/a	n/a
	GW – Hungerford	✗					1.4 MI/d	n/a	n/a	n/a
	GW - Playhatch (increased licence)	✗					1.3 MI/d	n/a	n/a	n/a

<sup>29</sup> Reigate to Guildford option included in investment modelling however due to reliance on demand reduction option is currently considered to be high risk. Option has therefore not been assessed against feasibility criteria at this time. This will be further developed before the final issue of the WRMP.

Option type	Name	Feasibility Stage			Capacity <sup>2</sup>		Deployable output			
		Stage 1	Stage 2	Stage 3	Validation	Further screening	(MI/d)	1 in 2 average	1 in 500 average	1 in 500 peak
Removal of Constraints to DO	East Woodhay borehole pumps Removal of Constraints to DO	✓	✓	✓	✓	✓	2.1 MI/d	0 MI/d	0 MI/d	2.1 MI/d
	SWA to Kennet Valley	✗					N/A	n/a	n/a	n/a
Internal inter-zonal transfers	Sheeplands WTW to Early SR	✓	✗				2.4 MI/d	n/a	n/a	n/a
	T2ST Spur: Culham to Newbury (Potable)			TBC <sup>30</sup>	n/a			n/a	n/a	n/a
	T2ST Spur: Reading to Fobney (Potable)			TBC	n/a			n/a	n/a	n/a

<sup>30</sup> T2ST spurs have been developed by the T2ST SRO as part of the Gate 2 process, these were identified too late in the process to complete the feasibility assessment in advance of dWRMP24. Options have therefore not been assessed against feasibility criteria at this time. This will be further developed before the final issue of the WRMP.

### Demand options list tables

- P.12 The unconstrained demand options list was comprised of all possible demand options that are considered technically feasible, but which may have not been free of environmental or planning constraints issues. The unconstrained demand options list was developed through the screening of options from the generic list of options identified by UKWIR in its Water Resources Planning Tools 2012 Report.<sup>31</sup>
- P.13 The generic water demand options identified by UKWIR are grouped into six categories:
- Leakage
  - Metering
  - Water efficiency
  - Incentive Schemes
  - Non-potable
  - WRSE Region-Wide
- P.14 Using these six categories as a base, we developed each generic option to include multiple potential sub-options and specific options. For example, the generic option, leakage, was broken into seven sub-options, advice and guidance, Active Leakage Control, pressure management, smart networks, mains rehabilitation, leakage innovation and regulation. These sub-options were then classified further as specific options that could be assessed in the screening process.

The sub-options and specific options identified under each generic option category form the unconstrained options List. In total, there are 216 demand management options for the draft WRMP24 that made up the full unconstrained options list.

Where options are shown as having been screened out at either the primary screening or secondary screening stage, the reason for rejection can be found in Appendix Q: Scheme Rejection Register.

---

<sup>31</sup> UKWIR (2012), Water Resources Planning Tools 2012, Economics of Balancing Supply and Demand Report



Table P - 3: Unconstrained demand management options

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
Generic Option type: Leakage			
Advice and Guidance	Advice and information on leakage detection and fixing techniques (Agriculture)	✓	✗
	Advice and information on leakage detection and fixing techniques (Industrial and Commercial Customers)	✓	✗
	In house awareness campaign to reduce internal losses	✓	✗
Active Leakage Control	ALC + 10% - Enhanced levels of 'Find and Fix' over and on top of that already being undertaken to maintain current levels of leakage to achieve a further 10% reduction in leakage.	✓	✗
	ALC + 20% - Enhanced levels of 'Find and Fix' over and on top of that already being undertaken to maintain current levels of leakage to achieve a further 20% reduction in leakage.	✓	✗
	Advanced District Metered Area (DMA) Intervention. Made up of the following components:	✓	
	<ul style="list-style-type: none"> <li>DMA Redesign – capital work to redesign DMAs to better identify leakage. Includes splitting DMA's, moving priority district meters etc.</li> <li>Acoustic logger installation</li> <li>Replacement of service pipes</li> <li>Pressure Management: install new pressure management schemes within individual DMAs at sub-DMA level.</li> <li>DMA Excellence – operational component of work following DMA Redesign. Includes assessment of demand in the DMA (incl. temporary logging of large customers) and using Find and Fix programmes to pinpoint leaks</li> <li>Fixing Leaks – the final stage of DMA Enhancement is capital work to fix the leaks identified.</li> </ul>		✓
	This option was re-named from 'Enhanced ALC' in WRMP19.		

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
	Improvements in systems to allow more easy reporting of visible leaks and analysis of social media for leak notification	✓	✗
	Be more operationally efficient	✓	✗
	Decreasing the time taken to fixing reported leaks	✓	✗
	Develop metrics and monitoring to quantify SR leakage	✓	✗
	Enhanced district meter verification - meter verification is an on-site check to determine the accuracy of flow being registered through a meter.	✓	✗
	Enhanced logger verification - logger verification is a simple on site check to ensure that the flow being registered by a meter matches the flow being recorded by the data logging device attached to the meter.	✓	✗
	Explore PRV noise reduction methods	✓	✗
	Household meter under /over registration analysis - meter verification as an on-site check to determine the accuracy of flow being registered through a meter.	✓	✗
	Improve quality of repairs	✓	✗
	Improving analytics to detect leak breakouts	✓	✗
	Increase pressure for leak detection	✓	✗
	Measuring performance of the ALC activity	✓	✗
	Non-household meter under /over registration analysis - meter verification as an on-site check to determine the accuracy of flow being registered through a meter.	✓	✗
	Remote sensing technologies - aircraft-based	✓	✗
	Remote sensing technologies - ground-based	✓	✗
	Remote sensing technologies - satellite-based	✓	✗
	Trunk main and service reservoir leakage reduction by improved metering	✓	✗
	Installation of through bore hydrants to allow for in-pipe leak detection/localisation	✓	✗
Pressure Management	Pressure Management 4 - further reduction of pressure on existing schemes that are made up of multiple DMAs. Requires the installation of additional tall building boosters.	✗	
	Pressure Management - install new pressure management schemes within individual DMAs at sub-DMA level.	✓	✗

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
	Pressure Management - install new zonal pressure management schemes	✓	✗
	CaLM Networks - this option includes a range of activities: targeted extension of pressure management, upgrade of controllers for PRVs and pumps, transient investigations, trunk mains expansion/extension, distribution mains expansion/extension. To include: design, construction, and commissioning of new pressure management schemes. Retrofit improved controllers to pumps and valves to enable more precise and responsive pressure profiles to be maintained that minimise leakage while providing adequate pressures at critical points at all times. Investigating the existence of pressure transience using transient loggers, tracing the sources of those transients and removing the causes.	✓	✗
Smart Networks	Smart Networks Programme to improve leakage targeting and detection	✓	✗
Mains Rehabilitation	Asset Replacement - replace individual pipes that have high burst rates	✓	✗
	Asset Replacement 100m - replace individual pipes that have high burst rates and must be above 100m in length	✓	✗
	Comms Only - replace communication pipes only	✓	✗
	Full DMA Mains Replacement of at least 90% of DMA - includes mains replacement, comm pipe replacement and boundary box install (does not include CSL repair)	✓	Feasible Option
	Partial DMA Mains Replacement - targets worst performing assets and includes mains replacement, comm pipe replacement and boundary box install (does not include CSL repair)	✓	Feasible Option
	Asset renewal - this option would involve the replacement and renewal of trunk mains. This option excludes replacement of communication pipes and Customer Supply Pipes (CSP) (from the property boundary to inside the property).	✗	
	Develop procedure for abandoned mains	✓	✗
	Minimise joints	✓	✗
	Replace rather than repair - household supply pipes. Includes a study to assess the impact on leakage if the supply pipes are replaced instead of repairing them.	✓	✗
Leakage Innovation	Innovative techniques improving speed and quality of repairs, such as:	✓	✓

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
	<ul style="list-style-type: none"> <li>• Adoption of keyhole repair techniques</li> <li>• Advanced technologies for precise and accurate leak location – acoustics</li> <li>• • Advanced technologies for precise and accurate leak location - tracer gases</li> <li>• Quality/Make joints leak free - product development</li> <li>• Use technologies for repairing pipes from the inside</li> <li>• Enhanced detection equipment/innovation in detection</li> <li>• Enhanced repair methods/innovation in repair methods</li> </ul>		
Regulation	Investigate and lobby for improved regulatory incentives for reducing leakage	✓	✗
Generic Option type: Metering			
Progressive Metering Programme (PMP) (previously Houses Only)	Meter all houses (AMI technology) and repair CSLs found	✓	✓
	Meter all houses (AMR technology) and repair CSLs found	✓	✓
	Meter all houses (Basic technology) and repair CSLs found	✓	✗
Bulk Metered Area (previously Blocks of Flats (Bulks) Only)	Bulk metering flats (AMI technology) and repair CSLs found	✓	✓
	Bulk metering flats (AMR technology) repair CSLs found	✓	✓
Houses and Bulks	Meter all houses and bulk meter (external) blocks of flats (AMI technology) and repair CSLs found	✓	✗
	Meter all houses and bulk meter (external) blocks of flats (AMR technology) and repair CSLs found	✓	✗
	Meter all houses and bulk meter (external) blocks of flats (Basic technology) and repair CSLs found	✓	✗
Houses, bulks and individual flats	Meter all houses (including CSL repair), individual flats (internal, no CSL repair) and bulk meter (including CSL repair) blocks of flats (AMI technology)	✓	✗
	Meter all houses (including CSL repair), individual flats (internal, no CSL repair) and bulk meter (including CSL repair) blocks of flats (AMR technology)	✓	✗

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
	Meter all houses (including CSL repair), individual flats (internal, no CSL repair) and bulk meter (including CSL repair) blocks of flats (Basic technology)	✓	✗
	Meter all houses (including CSL repair) and individual flats (internal, no CSL repair) with Basic technology and bulk metering (including CSL repair) blocks of flats with AMR technology	✓	✗
Mini Bulk Metered Area	Install small bulk meters on properties with multiple supplies (previously called Small Blocks Flats Bulks)	✓	✓
Progressive Smart Upgrade Programme - Household (PSUP) (previously Household meter upgrades)	Proactive replacement of basic meters with smart meters on household properties	✓	✓
Progressive Smart Upgrade Programme - Non-household (PSUP)	Proactive replacement of basic meters with smart meters on non-household properties	✓	✓
Selective metering	Selective metering (agricultural troughs)	✓	✗
Illegal connections	Target and meter illegal connections	✓	✗
Information	In-home display of real time consumption	✓	✗
Metering Innovation - new meter installations	Investigate innovative practices to install meters at no access and unmeterable properties. This includes a change in practice for no access and an investment/trial of alternative technology for unmeterables.	✓	✓
Metering Innovation - proactive meter upgrades	Investigate innovative practices to upgrade meters at no access and unmeterable properties. This includes a change in practice for no access and an investment/trial of alternative technology for unmeterables.	✓	✓
Generic option type: Water Efficiency			
Advice and Guidance	Benchmark to help drive water efficient behaviours (domestic)	✗	
	Social landlord audits and benchmarking	✗	
	Call Centre contact to customers giving water efficiency advice	✗	
	Intensive area based promotional campaigns	✗	
	Develop an AMR interface tool to help drive water efficiency behaviours	✗	
	Develop water certificates for customer properties	✗	

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
	Development and promotion of an online water use calculator	✗	
	Development of Smart Phone Applications	✗	
	Distribution of advice and guidance via Water Regs visits	✗	
	Distribution of self-audit packs	✗	
	Distribution of water saving information in customers' bills	✗	
	Distribution of water saving information via leaflet distribution	✗	
	Education in schools and provision of educational material	✗	
	Adolescents showering campaign	✗	
	Campaign to encourage customers to self-repair internal leaks	✗	
	Leaky Loos campaign	✗	
	Events and road shows	✗	
	Free water efficiency goods and advice to all newly metered customers	✓	✗
	Offer free water efficiency goods online	✓	✗
	Promotions via newspapers	✗	
	Water efficiency advice via an internet promotion	✗	
	Development of a multi-utility consumption web-portal	✗	
	Community/religious groups to promote water efficiency advice	✗	
	Council and community landscape redesign advice	✗	
	Use satellite technology to advise customer when to water their gardens	✗	
	Target water consumption at the community scale	✗	
	Target water consumption in university private rental sector	✗	
	Targeted information concerning the benefits of trickle irrigation compared to spray irrigation.	✓	✗
	Targeted water efficiency information to other abstractors	✓	✗
	Targeting perceptions and attitudes via shared spaces (urban environment)	✓	✗
	Digital engagement with all customers	✓	✓
	Tailored digital engagement with customers, targeted at high use households	✗	
	Targeted water efficiency communication based on supply demand pressures	✗	
	Targeted digital engagement based on presence of continuous flow	✗	

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
Self-Install	Distribution of aerated shower head	✓	✗
	Distribution of cistern displacement devices	✓	✗
	Distribution of hose guns for self-installation	✗	
	Distribution of Shower Timers	✓	✗
	Distribution of tap inserts for self-installation	✓	✗
	Distribution of water gels to gardeners for self-installation	✗	
	Distribution of water saving devices to businesses via Water Regs visits	✗	
	Distribution of innovative technologies / products	✗	
	Subsidy for water efficient white goods	✗	
	Subsidy for water butts	✗	
	Subsidising drought tolerant plants	✗	
	Rebate to replace old toilets	✗	
	Rebates on water efficient fixtures and fittings	✗	
	Installation of water butt	✓	✗
Direct Efficient Goods Plumber Installation	Installation of smart shower monitor	✗	
	Smarter Home Visits to newly metered Household Properties as part of the Progressive Metering Programme - involves water efficiency devices, water audit and water savings plan with customer (non-LAHAs only)	✓	✓
	Smarter Home Visits to newly metered optant Household Properties - involves water efficiency devices, water audit and water savings plan with customer (non-LAHAs only)	✓	✓
	Smarter Home Visits to newly metered Household Properties as part of the Progressive Smart Upgrade Programme - involves water efficiency devices, water audit and water savings plan with customer (non-LAHAs only)	✓	✓
	Smarter Home Visits to current unmeasured Household Properties - involves water efficiency devices, water audit and water savings plan with customer (non-LAHAs only)	✓	✗
	Virtual Smarter Home Visit (vSHV) – As above but the customer consultation is online. Any water saving devices are mailed to the customer.	✗	

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
	Household water efficiency visits and wastage repairs to mini bulk metered properties, targeted based on high use and continuous flow	✓	✗
	Household water efficiency visits and wastage repairs to bulk metered properties, targeted based on high use and continuous flow	✓	✗
	Housing Association fixes problems found at Household properties (LAHAs only)	✗	
	Wastage Fixes - Free leak fixes for all customers with internal leakage (i.e. leaky-loos and leaking taps)	✓	✓
	Appliance exchange programme	✗	
	Plumber assisted installation of tap inserts	✓	✗
	Replacement - installation of a dual flush toilet	✓	✗
	Replacement - installation of a low flush toilet	✓	✗
	Replacement - installation of self-closing taps	✓	✗
	Replacement - installation of a shallow trap toilet	✓	✗
	Replacement - installation of a composting toilet	✓	✗
	Retrofit - installation of a dual flush toilet device	✓	✗
	Retrofit - installation of 'smart devices' (such as taps) that can send data to the customer portal	✗	
	Replacement - installation of instantaneous water heaters/boilers	✗	
	Household Innovation and Tariffs	✓	✓
	Trial installation of whole house flow restrictors in high pressure areas	✓	✗
	Installation of water efficiency devices and internal leak repairs embedded into other internal visits such as internal meter repairs and CSL	✓	✗
Partner Efficiency Goods and Installation	Partner controlled domestic plumbing installs	✓	✗
	Partnership projects with national organisations	✓	✗
	Partnership projects with public and third sector organisations	✓	✗
	Partnership projects with utility companies	✓	✗
	Partnership with retailers for more efficient white goods	✓	✗
	Partnership working benefits	✓	✗
	Subsidy to appliance manufacturers	✗	
	Benchmark to help drive water efficient behaviours (non-domestic)	✗	



Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
Non-Domestic Advice and Assistance	Smarter Business Visits to Non Household Properties - company funded. Includes wastage repair offer for non-household customers with continuous flow	✓	✓
	Smarter Business Visits to Non Household Properties - customer funded	✗	
	Exploit retail and loan funding opportunities for non-domestic water saving	✗	
	Free water efficiency goods and advice to all newly metered businesses	✗	
	Introduce training for non-domestic customers about wise water use	✗	
	Non-Domestic water saving advice and assistance	✗	
	Provision of water butts	✗	
	Replacement - installation of a new toilet	✓	✗
	Replacement - installation of a waterless urinals	✓	✗
	Replacement - installation of self-closing taps	✓	✗
	Replacement - installation of a shallow trap toilet	✓	✗
	Replacement - installation of a composting toilet	✓	✗
	Replacement - installation of timing devices	✓	✗
	Optimising water using processes	✗	
	Whole farm water efficiency programme	✗	
	Trial installation of innovative water efficient products in non-household premises	✗	
	Discretionary Water use - using non potable water for large users such as golf courses	✓	✗
Research	Continue to support ongoing research projects	✓	✗
	Ofwat water efficiency research fund	✓	✗
	Save Water Swindon and other flagship research projects	✓	✗
	Whole-town water efficiency programme	✗	
	Support the leak toilet valves project phase 2	✓	✗
	Support the research undertaken by UKWIR	✓	✗
	Support the Waterwise evidence base	✓	✗
Regulation	Enforce use of water efficient fittings in new buildings	✗	
	Flow restrictor charging	✗	
	Ban high water use devices	✗	

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
	Preventing new development	✗	
	Legislate on water use	✗	
Generic options type: Incentive Schemes			
Green Redeem (previously Targeted Incentive Scheme)	Customers are incentivised through non-financial offers (vouchers, prize draws, community rewards) to be more efficient with their water consumption.	✓	✓
Innovative Tariffs	Financial Tariff implementation - only feasible post smart metering.	✓	✗
Generic options type: Non-potable			
Rainwater Harvesting	Individual Buildings (Typology 1) - Commercial Only. Individual commercial Buildings throughout Thames Water's supply area that are being redeveloped contain a non-potable treatment system.	✗	
	Individual Buildings (Typology 1) - Residential Only. Individual residential buildings throughout Thames Water's supply area that are being redeveloped contain a non-potable treatment system.	✗	
	Individual Buildings (Typology 1) - Commercial and Residential. Individual commercial and residential buildings throughout Thames Water's supply area that are being redeveloped contain a non-potable treatment system.	✗	
	Individual Buildings within a Development (Typology 2) - Commercial Only. A non-potable treatment system is delivered to individual commercial buildings on a new development.	✗	
	Individual Buildings within a Development (Typology 2) - Residential Only. A non-potable treatment system is delivered to individual residential buildings on a new development.	✗	
	Individual Buildings within a Development (Typology 2) - Commercial and Residential. A non-potable treatment system is delivered to individual commercial and/or residential buildings on a new development.	✗	
	Multiple Buildings within a Development (Typology 3) - Commercial only. A non-potable treatment system and network is delivered that serves multiple commercial buildings on new developments. i.e. multiple non-potable system can be delivered on the one development.	✗	
	Multiple Buildings within a Development (Typology 3) - Residential only. A non-potable treatment system and network is delivered that serves	✗	

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
Stormwater Harvesting	multiple residential buildings on new developments. i.e. multiple non-potable system can be delivered on the one development.		
	Multiple Buildings within a Development (Typology 3) - Commercial and Residential. A non-potable treatment system and network is delivered that serves multiple commercial buildings on new developments. i.e. there could be a number of these non-potable systems delivered on the one development.	✗	
	All Buildings within a Development (Typology 4) - Commercial and Residential. A non-potable central system and network is delivered that serves all buildings on a new development.	✗	
	Individual Buildings (Typology 1) - Commercial Only. Individual commercial Buildings throughout Thames Water's supply area that are being redeveloped contain a non-potable treatment system.	✗	
	Individual Buildings (Typology 1) - Residential Only. Individual residential buildings throughout Thames Water's supply area that are being redeveloped contain a non-potable treatment system.	✗	
	Individual Buildings (Typology 1) - Commercial and Residential. Individual commercial and residential buildings throughout Thames Water's supply area that are being redeveloped contain a non-potable treatment system.	✗	
	Individual Buildings within a Development (Typology 2) - Commercial Only. A non-potable treatment system is delivered to individual commercial buildings on a new development.	✗	
	Individual Buildings within a Development (Typology 2) - Residential Only. A non-potable treatment system is delivered to individual residential buildings on a new development.	✗	
	Individual Buildings within a Development (Typology 2) - Commercial and Residential. A non-potable treatment system is delivered to individual commercial and/or residential buildings on a new development.	✗	
	Multiple Buildings within a Development (Typology 3) - Commercial only. A non-potable treatment system and network is delivered that serves multiple commercial buildings on new developments. i.e. multiple non-potable system can be delivered on the one development.	✗	

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
Greywater Recycling	Multiple Buildings within a Development (Typology 3) - Residential only. A non-potable treatment system and network is delivered that serves multiple residential buildings on new developments. i.e. multiple non-potable system can be delivered on the one development.	✗	
	Multiple Buildings within a Development (Typology 3) - Commercial and Residential. A non-potable treatment system and network is delivered that serves multiple commercial buildings on new developments. i.e. there could be a number of these non-potable systems delivered on the one development.	✗	
	All Buildings within a Development (Typology 4) - Commercial and Residential. A non-potable central system and network is delivered that serves all buildings on a new development.	✗	
	Individual Buildings (Typology 1) - Commercial Only. Individual commercial Buildings throughout Thames Water's supply area that are being redeveloped contain a non-potable treatment system.	✗	
	Individual Buildings (Typology 1) - Residential Only. Individual residential buildings throughout Thames Water's supply area that are being redeveloped contain a non-potable treatment system.	✗	
	Individual Buildings (Typology 1) - Commercial and Residential. Individual commercial and residential buildings throughout Thames Water's supply area that are being redeveloped contain a non-potable treatment system.	✗	
	Individual Buildings within a Development (Typology 2) - Commercial Only. A non-potable treatment system is delivered to individual commercial buildings on a new development.	✗	
	Individual Buildings within a Development (Typology 2) - Residential Only. A non-potable treatment system is delivered to individual residential buildings on a new development.	✗	
	Individual Buildings within a Development (Typology 2) - Commercial and Residential. A non-potable treatment system is delivered to individual commercial and/or residential buildings on a new development.	✗	
	Multiple Buildings within a Development (Typology 3) - Commercial only. A non-potable treatment system and network is delivered that serves	✗	

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
	multiple commercial buildings on new developments. i.e. multiple non-potable system can be delivered on the one development.		
	Multiple Buildings within a Development (Typology 3) - Residential only. A non-potable treatment system and network is delivered that serves multiple residential buildings on new developments. i.e. multiple non-potable system can be delivered on the one development.	×	
	Multiple Buildings within a Development (Typology 3) - Commercial and Residential. A non-potable treatment system and network is delivered that serves multiple commercial buildings on new developments. i.e. there could be a number of these non-potable systems delivered on the one development.	×	
	All Buildings within a Development (Typology 4) - Commercial and Residential. A non-potable central system and network is delivered that serves all buildings on a new development.	×	
Wastewater (Blackwater) Recycling	Blackwater recycling at new developments	×	
Generic Option Type: WRSE Region-wide			
	Compulsory metering - Basic meters in 5 year rollout	×	
	Compulsory metering - Hosepipes	×	
Metering	Compulsory metering - walk-by meters with limited fixed network in 10 year rollout	×	
	Meter remaining unmetered swimming pool owners	×	
	Household water efficiency	×	
Advice and Guidance	Media campaigns to influence water use	×	
	Metered households proactive consumption support	×	
Direct Efficient Goods	Household water efficiency programme (Company led, home visit)	×	
Plumber Installation	Replacement -installation of a dual flush toilet	×	
Self-Install	Distribution of tap inserts for self-installation	×	
Self-Install	Free water efficiency goods and advice to all newly metered customers	×	
Partner Efficiency Goods and Installation	Partnership projects with utility companies	×	

Sub option	Specific option	WRMP24 Primary Screening Decision	WRMP24 Secondary Screening Decision
Non-Domestic Advice and Assistance	Non-household and commercial water efficiency	×	
Non-Domestic Advice and Assistance	Water Audits -Commercials (Non-process)	×	
Greywater Recycling	Treated greywater reuse in new households	×	

