



Groundwater Impacted System Management Plan

Wash Water, River Enborne

September 2021



Version control

Version	Date	Amendment	Author	Checked	Reviewed
1-d1	18/08/2021	Draft for EA	AJ	SE	DJ
1-d2	25/08/2021	Final Draft for EA	AJ	SE	DJ
1-V1	27/09/2021	Version 1	AJ	SE/JO	DJ
Annual Update 2022	October 2022	Addition of Annual Update 2022	MB/JH	DJ	DJ
Annual Update 2023	October 2023	Addition of Annual Update 2023	MB	DJ	DJ
Annual Update 2024	October 2024	Addition of Annual Update 2024	CW/MW	DJ	DJ
Annual Update	Nov 2025	Draft for EA	AF and PP	BT and JE	MH and DS

Table of contents

Introduction	4
Brief description of Wash Water catchment	6
Problem characterisation	9
General outline plan & timescale	10
Wash Water Infiltration Management Plan	13
High level approach statement	13
Investigations	14
Monitoring	14
Mitigation & Updates	14
Appendix	15
Groundwater infiltration potential analysis	15
Investigations & remedial work undertaken since 2019/20 and future plans	16
Glossary of terms	17
Addendum - Annual Update 2022	18
Addendum - Annual Update 2023	27
Addendum - Annual Update 2024	38
Addendum – Annual Update 2025	49

Introduction

This document sets out Thames Water's approach to the management of groundwater infiltration in sewerage systems where the influence of groundwater infiltration is viewed as significant likely leading to the sewerage system, on occasions, to become overwhelmed.

All sewerage systems combined and separate will experience some groundwater infiltration¹ and a nominal allowance in design will be made for this. However, in some catchments the impact of groundwater infiltration can be considerable leading to impacts on service during periods of high groundwater, typically during the winter.

Groundwater can enter the sewerage system through the pipes and manholes, this may occur at a defect (crack, hole, displaced joint) or on a normal joint on the sewer or in the manhole. A key point to note is that where infiltration occurs it is not necessarily an indicator that the sewer is in poor structural state simply that jointing techniques used are not completely watertight.

Ingress of groundwater is not limited to the public system that Thames Water owns and maintains but potentially the private drains, manholes and sewers that connect to our system.

Preventing and reducing the impact of groundwater infiltration is predominately achieved through the lining of sewers and

sealing of manholes. This entails the application of a synthetic liner within the pipe that creates a contiguous membrane for the length of the pipe or possibly section if the source of ingress can be narrowed down. For manholes it will typically entail sealing in a similar manner.

To line all sewers and manholes within most catchments would be prohibitively expensive to do so. Our approach to date has been centered on a 'find and fix' basis which has involved monitoring and investigating the networks in periods of high groundwater to identify sources of ingress and fix as we find them. This approach is constrained for the reason that investigations are typically limited to periods of high groundwater and when high groundwater occurs there are limited windows of time in which investigations can be successfully undertaken before flows either subside or the system is fully surcharged meaning CCTV surveys are not possible². Once sections of sewers have been lined, it will be a case of waiting until high groundwater levels reoccur to assess the effectiveness of the work undertaken, which may not be the subsequent winter but several years later.

It is recognised that the 'find & fix' approach to date lacks a degree of certainty of resolution and for this reason Thames Water in 2020 undertook a different approach for long term management of groundwater, which is covered within this

¹ Sewers for Adoption makes an allowance for 10% of peak wastewater flow to allow for unaccounted flows such as groundwater infiltration.

² On occasions it is possible to over-pump between manholes to isolate sections of sewer to survey, this is not always feasible when the flows involved are simply too great to over-pump or the location prohibits this approach.

document under the plan section. These plans require significant investment which Thames Water will seek to secure through the price review process as service enhancement. In the meantime, we will continue to investigate sources of infiltration when it occurs and where feasible, undertake the work through our capital maintenance budgets. We refer to these as 'minor works' opportunities i.e. where we have high degree of certainty of reducing point sources of infiltration and can do so with reasonable costs and time.

The structure of this document has been created with input from the Environment Agency. Sections covered in this document include our 'Outline Plan' with timescales, Mitigation i.e. how we intend to manage the risk until our plan is fully implemented and when we will publish future updates on progress against this plan.

Brief description of Wash Water catchment

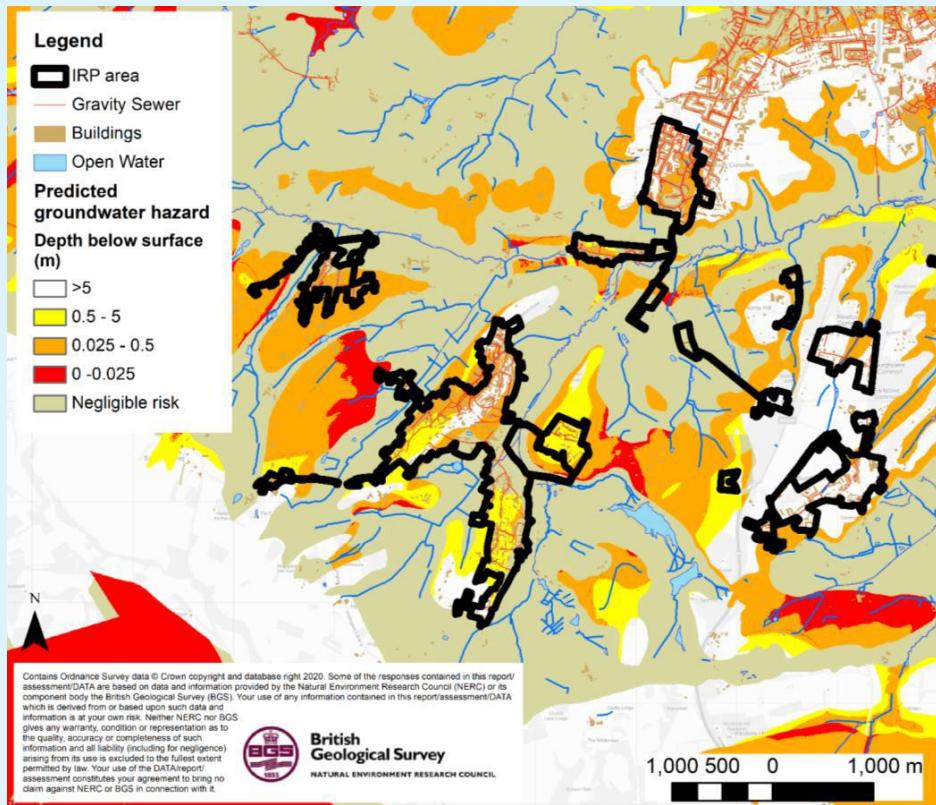


Figure 1.0 – Wash Water catchment

Wash Water is located in Berkshire, England, approximately 3 miles south-west of Newbury. Wash Water serves a population equivalent³ of 7,364 with a largely separate sewerage network totaling some 75 km in length excluding private drains and sewers. The extent of the catchment is shown in Figure 1.0 above.

Problem characterisation

Groundwater has potential to enter our sewers when levels are high and a positive head above the soffit of the sewer is created. Significant groundwater ingress can impact sewer capacity and increase the risk of the network becoming overwhelmed. There's a strong link between the rising river levels related to rising groundwater levels and the increased flows seen within the sewerage network and at the Sewage Treatment Works

³ Population equivalent based on unit per capita loading (PE), in waste-water treatment is the number expressing the ratio of the sum of the pollution load produced during 24 hours by industrial facilities and services to the individual pollution load in household sewage produced by one person in the same time.

Additionally, prolonged and heavy rainfall and raised groundwater levels have in some locations overwhelmed the sewer system causing surcharging of the local sewer network.

The sewerage system is identified on the public sewer records as being a largely separate foul system, rather than a combined system. We believe that significant volumes of surface water runoff from surrounding saturated fields and built-up land have entered the foul sewerage network during recent wet winters, causing the network to become overloaded and surcharged (mainly through submerged manholes).

We believe that there is unwanted flows in the foul sewer network when groundwater levels are high, and surface water inundation from highways, public spaces and properties and fluvial flooding from local watercourses.

Surface water misconnections (i.e. down pipes from roofs into the sewer network) are also suspected to be a contributing factor, hence further analysis is required to determine the extent to which this has contributed to sewer flooding.

A number of our sewerage systems include for overflows, these structures are there to protect against sewer flooding as a result of rainfall or equipment failure where appropriate. Discharges from these structures should not be impacted by excessive infiltration as detailed by the EA Regulatory Position Statement on groundwater impacted sewerage systems. The use of storm sewage overflows is accepted by our regulators, subject to conditions.

We believe it is likely that groundwater infiltration in the Wash Water catchment is the most probable cause of incidents of surcharging and where the sewage treatment works has not been able to cope with all incoming flows, triggering problems to homes and at the STW. The root causes of sewer surcharges require all stakeholders responsible for drainage in the catchment to resolve them together.

Our permit conditions for Wash Water STW state: *“The discharge shall only occur when and only for as long as the flow passed forward is equal to or greater than the overflow setting indicated due to rainfall and/or snow melt.”* and *“Off-line storm storage must be fully utilised before a discharge occurs. It shall only fill when the flow passed forward is equal to or greater than the overflow setting indicated due to rainfall and/or snow melt and shall be emptied and its contents returned to the continuation flow as soon as reasonably practicable.”*

The Flood and Water Management Act 2010 places a responsibility on Lead Local Flood Authorities (LLFAs), to manage flood risk from surface and groundwater, plus a duty on all Risk Management Authorities (RMAs), to cooperate regarding flood risk. In our role as an RMA, Thames Water will work with Basingstoke and Deane District Council as Lower Tier 1, and both Hampshire County Council and West Berkshire Council as Lead Local Flood Authority, Council and Planning Authority, and the Environment Agency to ensure that a collaborative approach can be developed to address the problems.

Thames Water also has a statutory obligation to comply with environmental legislation. The Water Framework

Directive establishes a strategic approach to managing the water environment, which the Environment Agency achieves through River Basin Management Plans and setting environmental objectives for groundwater and surface water. The environment is also protected from adverse effects of discharges of urban wastewater through the Urban Wastewater Treatment Directive, which requires us to improve and extend the sewerage system according to section 94 of the Water Industry Act (1991).

Anticipated unavoidable discharges

Within recent years there have been unavoidable sewage escapes in the network as a result of surcharging manholes causing pollution.

We anticipate that this situation may continue until such time we are able to implement a long-term solution.

No mitigation in the form of temporary overflows has been undertaken in this system.

General outline plan & timescale

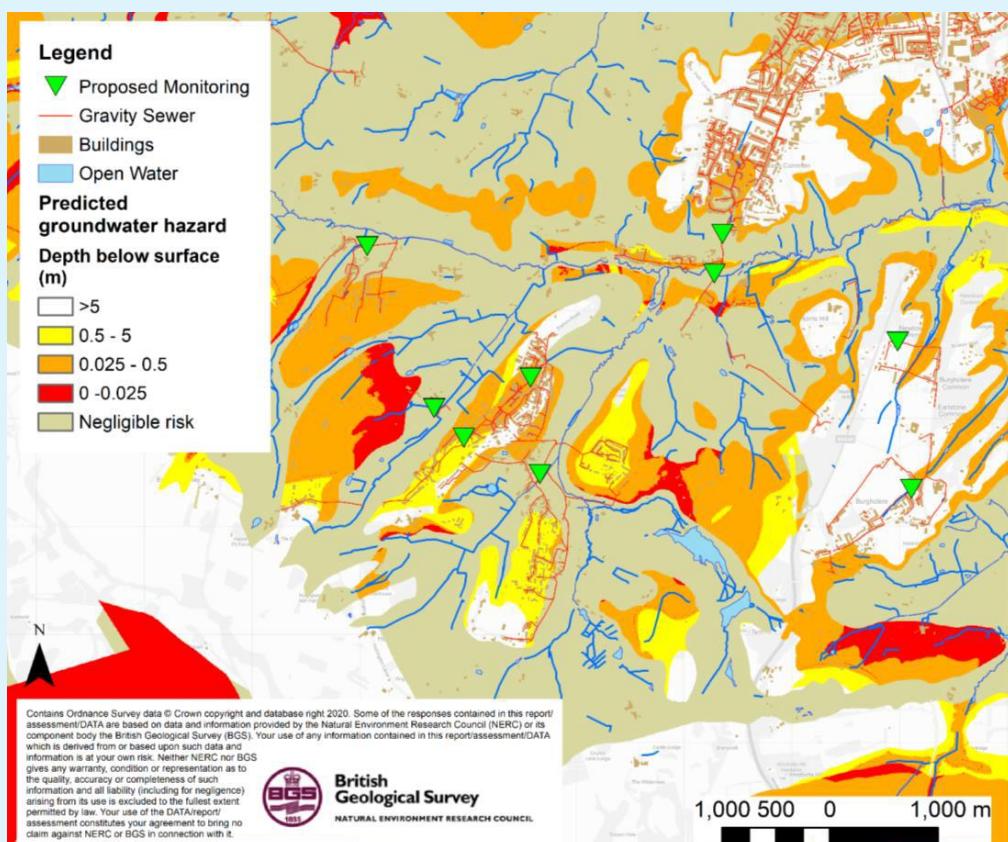


Figure 2.0 – Wash Water monitoring plan area and infiltration zones

Key to bringing the impact of groundwater infiltration under control is an enhanced monitoring regime. We have identified zones and areas over which telemetered depth monitoring will be installed. Figure 2.0 presents a plan of currently proposed installation locations.

Complimenting the flow [at the treatment works] and depth measurement [in the sewer network] we will use pumping station run time data, rainfall data, river level data, and groundwater level data to create a full picture of movement and source of flows around the catchment.

Zones of Groundwater Risk

We engaged with JBA Consulting to develop plans for Wash Water that identify zones of groundwater risk, see Figure 2.0. These zones are modelled areas where the groundwater has been determined to be above the sewer and hence pose a potential risk for groundwater ingress.

The sewer depth monitors referred to earlier will be sited in and around these zones to verify and calibrate the risk in each of the zones.

If following the proposal to the sealing in part or wholly⁴ of the high risk zones, should it be required, the system is found to be still experiencing excessive infiltration we would then look to potentially seal 'private' laterals and/or drains along with starting to seal the medium to low risk zones.

This document sets out an unconstrained approach to resolving the impact of groundwater infiltration within the system.

Investment to address infiltration will be assessed and prioritised against other drivers e.g. STW upgrades, both in the catchment and across the region at each price review.

With this plan we remain committed to minimising the impact of groundwater on the sewerage system in Wash Water.

Our general medium to long term plan is therefore to apply a hierarchy to sealing the sewer as follows:

Activity	When	Description
Model Zones	2020/21	JBA have been engaged to undertake modelling activities to identify the areas (zones) to be targeted for sealing in the 56 systems identified as being impacted by infiltration in the Thames Water region.
Install monitors	2021-2023	Monitor plans are being developed to help calibrate and validate the zones. Each year completeness / coverage monitors will be reviewed and added to / or modified as necessary.
Calibrate zones	Refined each year	Following each winter, we intend to review the data from the monitors and if necessary, redefine the zones.
Look & Lift	Each winter	The look & lift surveys have two purposes, firstly to compliment the monitoring and secondly to identify 'quick fixes' that we would address through our normal capital maintenance.
CCTV	2020-2023	Required to confirm sewer condition and provide information to assist with costing any sewer lining.

⁴ Decision of extent of sealing will be based on outcomes of works undertaken to date, result of monitoring and successful submission of our plans for investment.

Activity	When	Description
Minor works	2020-2023	As mentioned, if we detect minor works being required, we will look to resolve these as and when we find them.
PR24 / Price review	2023/24	Ideally through monitoring and on-going investigations work towards managing the infiltration risk, in AMP7, will be successful. However, in the absence of evidence justifying the need not to undertake sealing of the high-risk zone this is to be included as part of PR24 investment plan. This work will be subject to Cost Benefit Analysis and Best Technical Knowledge Not Entailing Excessive Cost (BTKNEC assessments).
High risk zone sealing	2025-30	Sealing of high-risk zone undertaken subject to need being demonstrated.

Wash Water Infiltration Management Plan

As detailed above the impact of infiltration is experienced in the network and at the STW.

Our approach to the resolution of infiltration impacting the Wash Water sewerage system is outlined below.

High level approach statement

For Wash Water our approach to tackling infiltration will be undertaken as follows:

1. We will investigate the network with a view to identifying sources of ingress of infiltration that are cost effective⁵ to address. To investigate the network, we have:
 - Undertaken a desktop analysis to determine infiltration high to low risk zones (October 2020);

To investigate the network, we will:

- Install monitoring to back up the analysis and to aide focusing of locations for identification of infiltration (2021 to 2023). Each year we will assess the completeness of monitoring and if required add to or modify the current locations.
- Undertake sample CCTV in the high to low risk zones to assess the general asset health of the sewers and manholes (ongoing).

We will also review results of Winter 2019/20 and 2020/21 with historic data to build up evidence to support interventions in the network (Autumn 2021).

2. Where interventions can be undertaken as part of normal sewer maintenance activities these will be communicated and progressed.
3. If significant investment is identified as being required, then this will need to be considered in terms of relative need compared to other systems being investigated for infiltration reduction. However, where viable opportunities are identified these will be included in our AMP9 (2030-35) programme of investment. Significant investment needs may need to be included in our future investment cycles.

⁵ Assessment of cost effectiveness is based on assessment of the ratio of the cost of a solution to the monetised benefit gained from implementing the solution i.e. reduction in flood/pollution risk and/or reduced operating costs.

Investigations

As mentioned above JBA Consulting have been supporting by undertaking an exercise involving assessing groundwater elevation data to determine which areas of the network are potentially below the groundwater table during high groundwater periods.

Site investigations, undertaken by Dene-Tech and our Customer Field Services (Thames Water Operations) will include 'look & lift' surveys, CCTV and where necessary dye tracing to confirm connectivity.

A table of the work undertaken is included in the appendix to this report.

Monitoring

Sewer Depth Monitors will be installed in the catchment in between 2021 and 2023. These devices are telemetered and provide real time data on the level of flow in the sewer.

The purpose of these units is to act as alerts for high groundwater impact in the sewer, calibration of the zones of infiltration risk and to demonstrate benefit gained from work undertaken to reduce infiltration. They will also provide evidence in the future of further need to manage the impact of infiltration.

Mitigation

On occasions to avoid flooding of properties or to manage the risk of damage to the environment we may undertake tankering from (manholes) points on the network, make use of pumps to manage flows or deploy settlement tanks to part treat sewage before release to the environment.

With regard to Wash Water we do not envisage needing to undertake mitigation work beyond tankering within the network.

Updates

Work on the Groundwater infiltration management plan will continue, and we will aim to provide updates annually by the end of October each year.

Appendix

Groundwater infiltration potential analysis

The sewer network classified by the groundwater infiltration risk zones. The lengths of sewers within these zones are presented in the table below.

Risk category	Description	Length (km)	Percentage
High	Predicted groundwater extreme >1m above pipe invert	9.64	23.6
Medium	Predicted groundwater extreme 0-1m above pipe invert	1.68	4.1
Low	Predicted groundwater extreme 0-1m below pipe invert	2.61	6.4
Very Low	Predicted groundwater extreme >1m below pipe invert	27.00	66.0
Total		40.93 ⁶	100

In addition, the table below presents the surface water flood risk classification for manholes within the catchment.

Manholes by Surface Water Inundation Risk Category

Risk category	Description	Number	Percentage
High	Inundation risk in 3.3% AEP fluvial or pluvial event	60	5.9
Medium	Inundation risk in 1% AEP fluvial or pluvial event	55	5.4
Low	Inundation risk in 0.1% AEP fluvial or pluvial event	129	12.7
Very Low	All other manholes	771	76.0
Total		1015	100

⁶Total of sewer length is for length of mapped sewers only and will not include unmapped S105a transferred sewers in all cases.

Investigations & remedial work undertaken since 2019/20 and future plans

Lift and Look and CCTV surveys have not yet commenced in the Wash Water system. A summary of findings will be provided in the next update of this report.

Glossary of terms

AEP – Annual Exceedance Potential

AMP – Asset Management Plan

CCTV – Closed Circuit Television

EA - Environment Agency

IRP – Infiltration Reduction Plans

MH – Manhole

STW – Sewage Treatment Works

WINEP – Water Industry National Environment Programme

Addendum – Annual Update 2022 Table of contents


Overview	19
Hydrological Review – 2021-22	20
Network Performance	24
Investigations & Interventions	25
Summary	26

Overview

This addendum to the Wash Water Groundwater Impacted System Management Plan 2021 (GISMP) provides an update on performance/work undertaken in the Hydrological Year October 2021 to September 2022. The key points covered include:

- Hydrological conditions
- How the sewerage system has performed over this period
- Mitigation / remedial measures progressed over the last year and being planned
- Summary and plan for 2022/23

Figure 1 – Wash Water Monitoring Plan

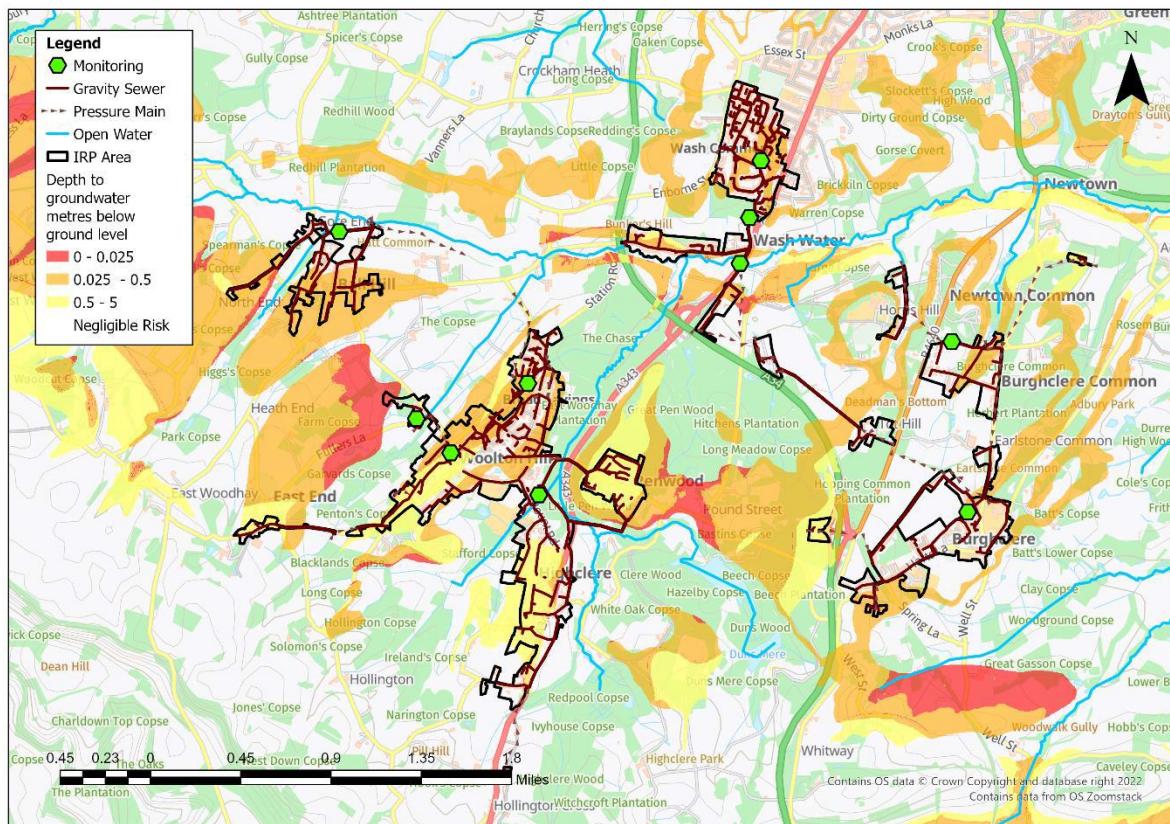


Hydrological Review – 2021-2022

This section summarises the hydrological conditions within the Wash Water catchment within the period under investigation and provides comparison against previous year's performance to put the annual performance into context. The hydrological review has been undertaken based on the Hydrological Year which runs October 1st to September 30th.

Catchment Rainfall

Representative Radar rainfall has been used to generate monthly data at catchment level for comparison with average data generated by local Met Office Weather Station Records. Figure 2 presents the comparison of this data for the last three hydrological years to support longer term trends within the local system.

Figure 2 – Monthly Rainfall Performance

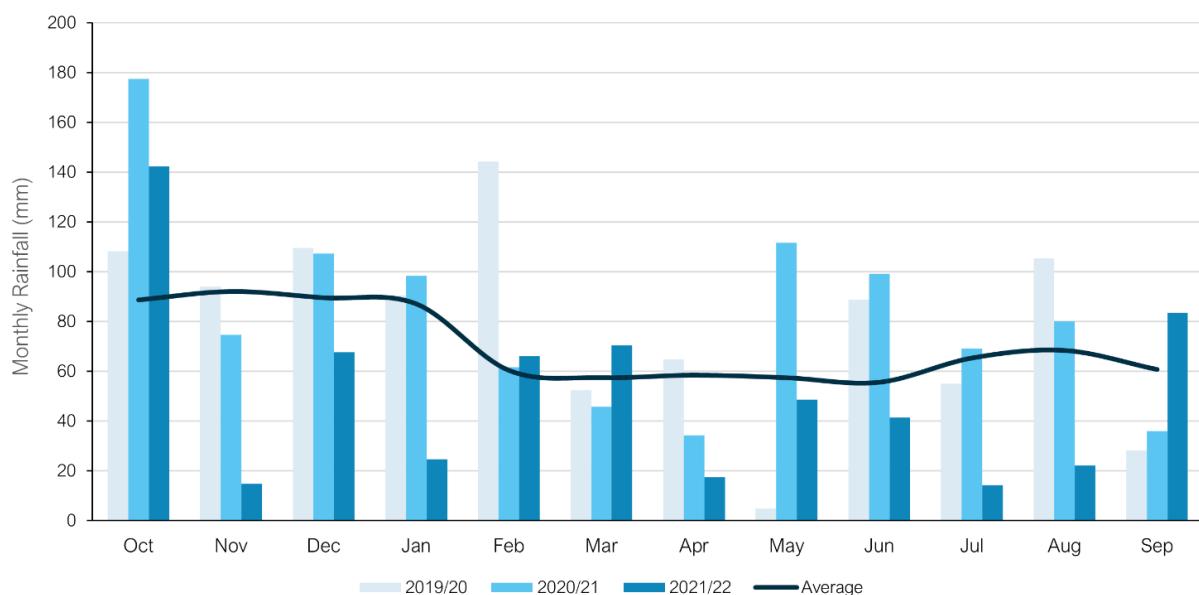

Average Values taken from Met Office Weather Station at Marlborough based on the period 1991-2020

The total rainfall for the 2021/22 hydrological year is 26% below the annual average total. Total rainfall values are presented in Table 3 below.

Table 3 –Total Rainfall Based on Hydrological Year

Average (mm)	2019/20 (mm)	2020/21 (mm)	2021/22 (mm)
841	946	995	619

Groundwater / Local River Level

The Wash Water catchment is situated in the Enborne water resources area. It sits in the sedimentary bedrock of the London Clay formation of sand and the London Clay formation of clay, silt and sand. The Wash Water catchment is not part of a designated principal aquifer within the UK.


The Environment Agency has gauging stations on local watercourses measuring stage and observation boreholes measuring groundwater levels locally to the catchment which can be used to provide indicative local groundwater performance.

From previous investigations we have identified the following site is a good indicator of groundwater levels within the catchment.

- River Enborne, Brimpton.
- Kingsclere Brook, Kingsclere.

These sites are illustrated in the figure below, alongside the closest groundwater reference station and closest gauging station from the Water Situation Report.

Figure 4 – Local Monitoring Stations

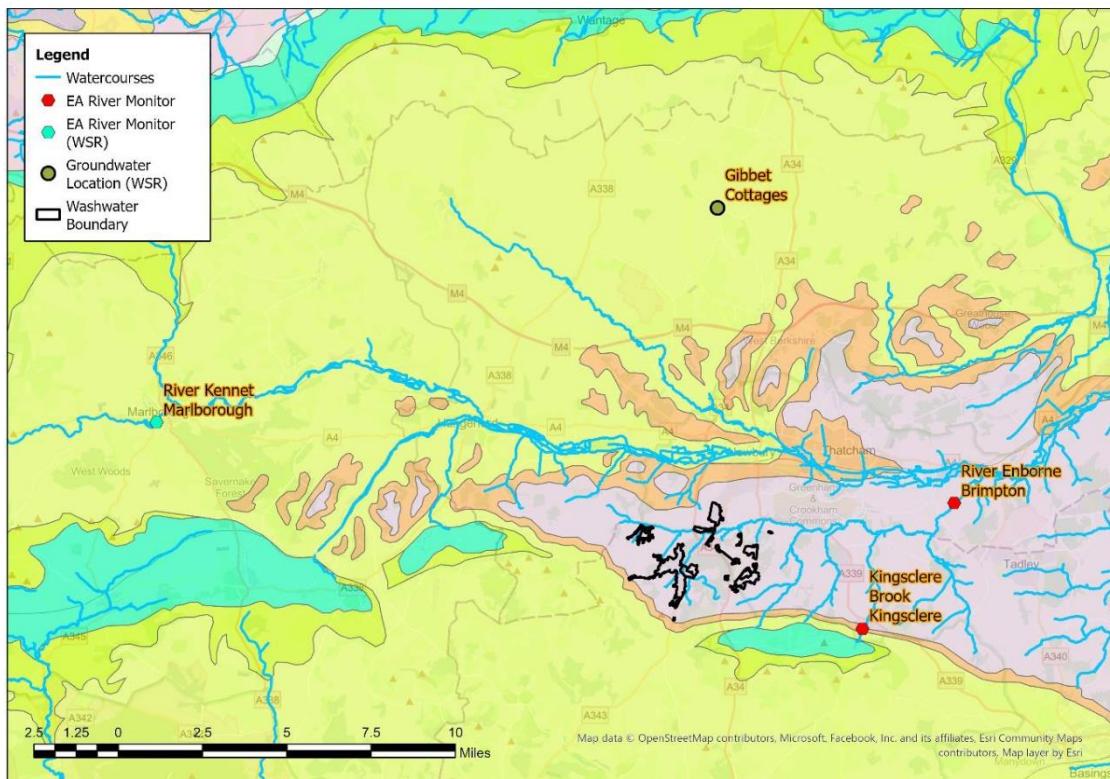

The following figures represent the last three hydrological years of level information at the indicator sites to build a picture of the relative conditions prevalent in the current year. It is presented against both the daily total rainfall values for the catchment and a rolling 15-day total rainfall.

Figure 5A – River Enborne, Brimpton



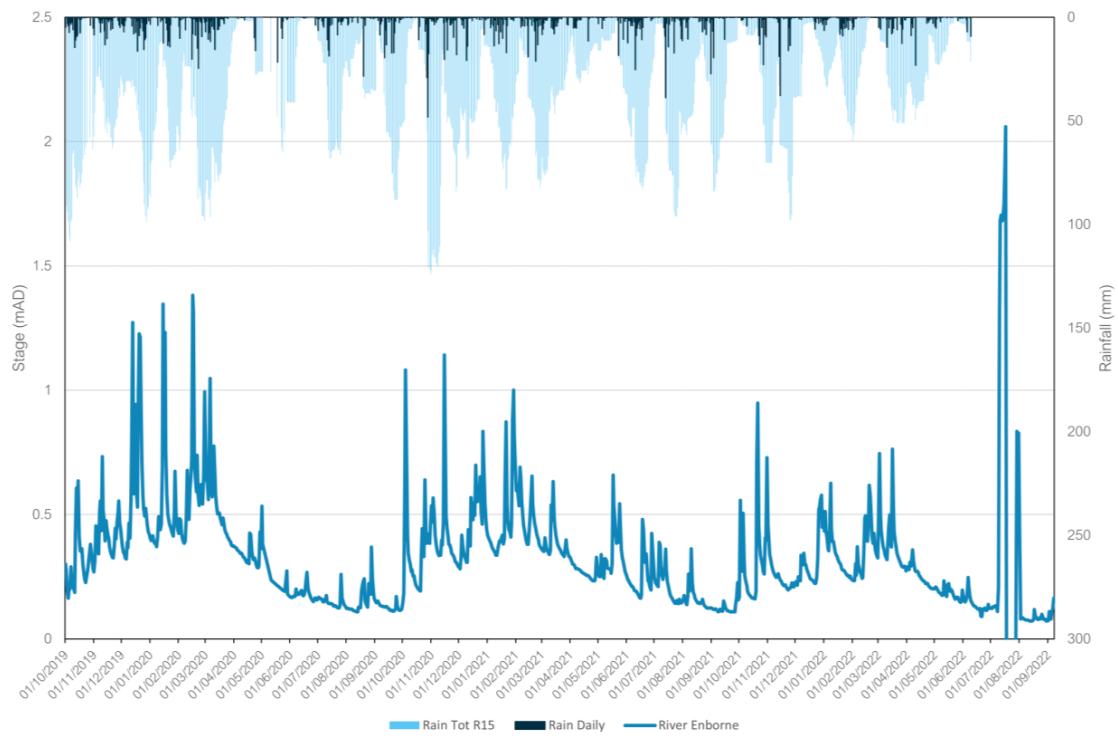


Figure 5B – Kingsclere Brook, Kingsclere

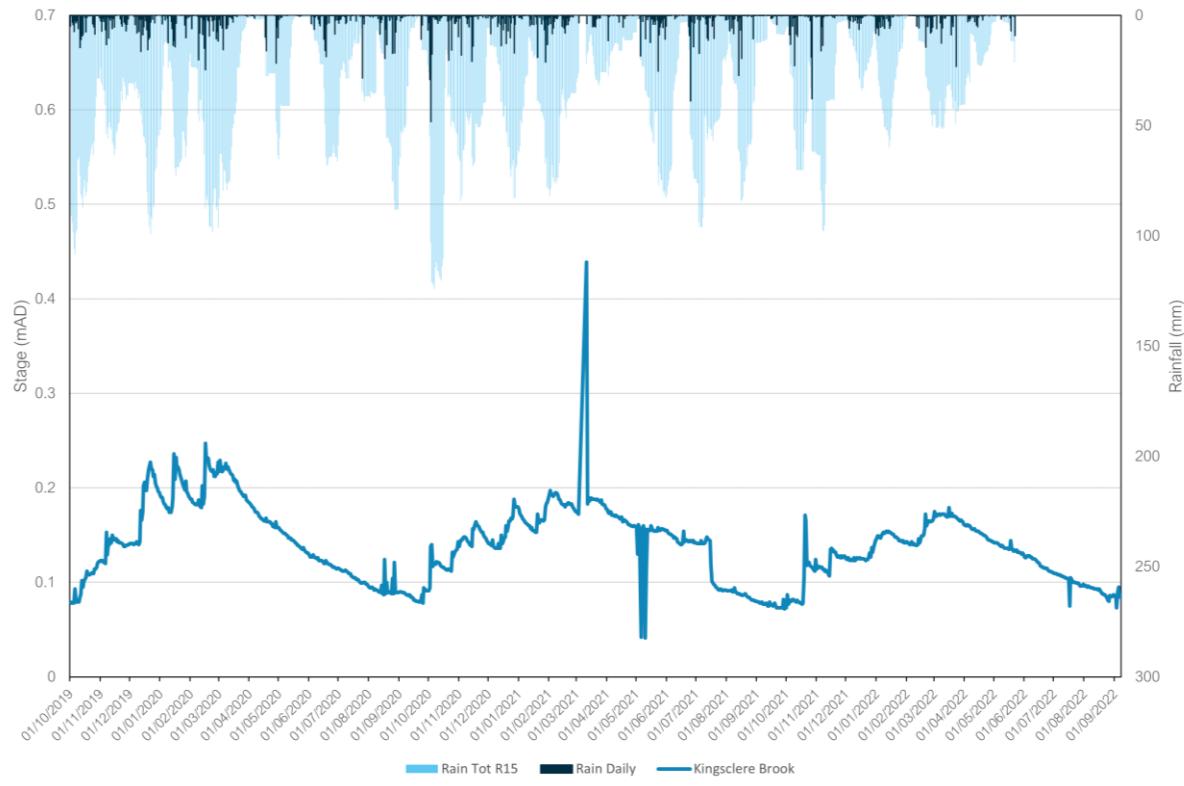

In addition to these specific stations, the wider groundwater context is illustrated in the Water Situation Report for Enborne. The nearest groundwater reference station is Gibbet Cottages. This site shows significantly lower overall groundwater than the previous year. This can be seen in the figure below alongside the river indicator Marlborough on the River Kennet.

Figure 6 – Water Situation Report

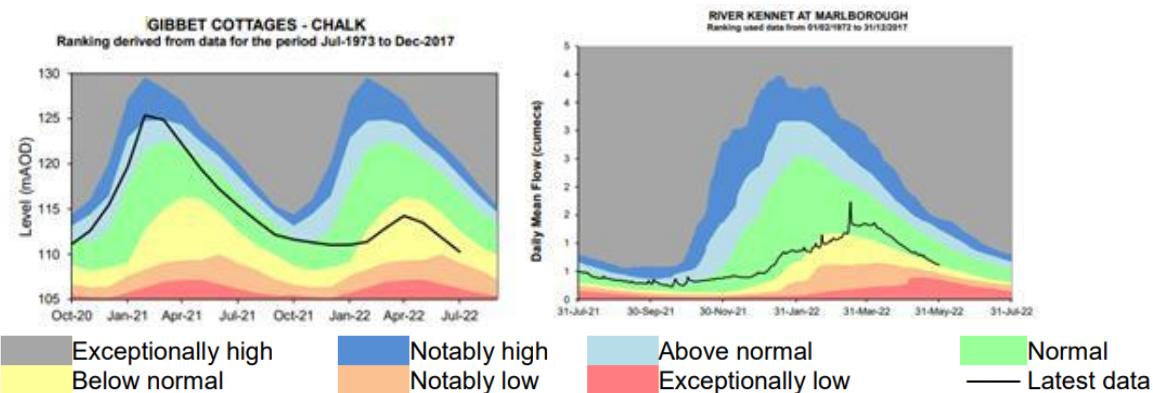

Extract from - [Water Situation Report \(publishing.service.gov.uk\)](https://publishing.service.gov.uk)

Network Performance

Within the Wash Water catchment there is one site detailed within the Environment Agency Consents Database which has an Event Duration Monitor (EDM) fitted.


Table 7 below details the last 2 years performance of overflows within the catchment.

Table 7 – Event Duration Monitoring

Overflow	2020		2021	
	Spills	Duration (hours)	Spills	Duration (hours)
Wash Water STW	88	1302.59	61	697.48

A critical part of the assessment of EDM performance and its relation to groundwater inundation is to review the month-on-month spill performance, against previous years and the monthly total rainfall values to give context to the performance. Note a spill frequency of 88 is stated for 2020 which is lower than the published spill count of 90. The data has been revalidated/ corrected and the revised spill count of 88 will be included in the re-submission to the EA. Figure 8 below presents the EDM performance trend and rainfall for recent years.

Figure 8 – EDM Monthly Performance

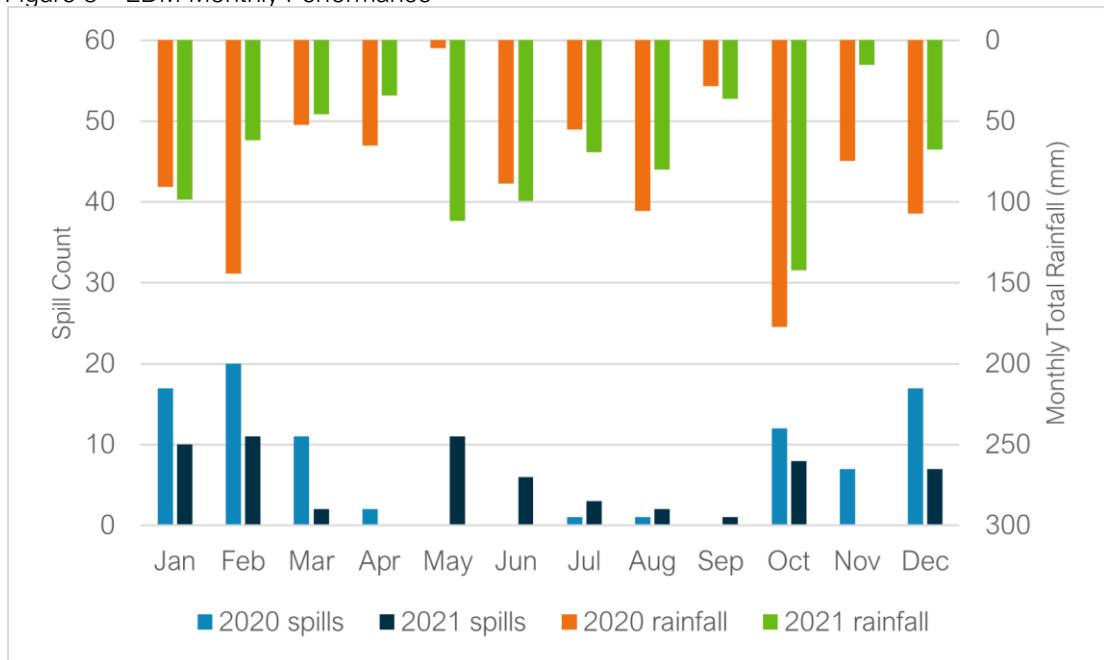

The trend in spill performance across the two recorded years does show variation in spills, with an overall focus on spills during the autumn and winter months. The data suggests a wider relationship between rainfall, elevated groundwater levels and spill frequency. This is particularly evident for January figures where similar rainfall has generated different spill frequency.

Note that a significant number of spills were recorded at Wash Water STW during the summer of 2021. The cause of the spills at Wash Water STW has been identified as both groundwater and operational issues.

Investigations & Interventions

This section details the activities that have been undertaken within the catchment within the Hydrological Year 2021-22.

Monitor Installations

The sewer depth monitor (SDM) programme supports long term groundwater understanding within GISMP catchments. Currently, there are a total of 8 monitors installed within the Wash Water catchment. There are currently 2 further monitor installs planned.

The data from these will be cross-referenced with other long-term records (where available) within the catchment.

Remediation Works Undertaken this Hydrological Year

Table 9 below provides a summary of the investigations and remediation works undertaken or planned within the Wash Water catchment in the 2021-22 Hydrological Year.

Table 9 – Works Undertaken in the 2021/22 Hydrological Year

Investigation/ remediation type	Number/ length undertaken
CCTV survey	N/A
Look and lift survey	N/A
Sewer lining	N/A
Patch lining	N/A
Manhole sealing	N/A
Manhole sealing plates	N/A
Manhole covers and frames replaced	N/A

With the seasonal trends in groundwater being low in comparison with previous years and the SDM installations ongoing, the larger scale survey, identification and remediation of the sewerage network has not been possible within the 2021/2022 hydrological year.

Summary

Rainfall in the Wash Water catchment over the 2021/22 hydrological year has been below average, with groundwater levels in the aquifer beneath Wash Water not reaching the levels seen in previous years which triggered groundwater ingress into the sewerage network and elevated flow/depth readings at monitoring sites. This is indicated by the fact fewer EDM spills were recorded at Wash Water STW in autumn and winter 2021, compared to the same time period in 2020, when the indicator sites suggest groundwater levels in the catchment were higher.

Lift and look and CCTV surveys will continue throughout the remaining wet winter periods with the aim of finding further priority locations for remediation and investigating/justifying the need for future larger scale lining as part of our Price Review (PR) process if required.

Addendum - Annual Update 2023

Table of contents


Overview	28
Hydrological Review – 2022-23	29
Network Performance	33
Investigations & Interventions	36
Summary	37

Overview

This addendum to the Wash Water Groundwater Impacted System Management Plan 2021 (GISMP) provides an update on performance/work undertaken in the Hydrological Year October 2022 to September 2023. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year and being planned
- Summary and plan for 2023/24

Figure 1 – Wash Water Monitoring Plan

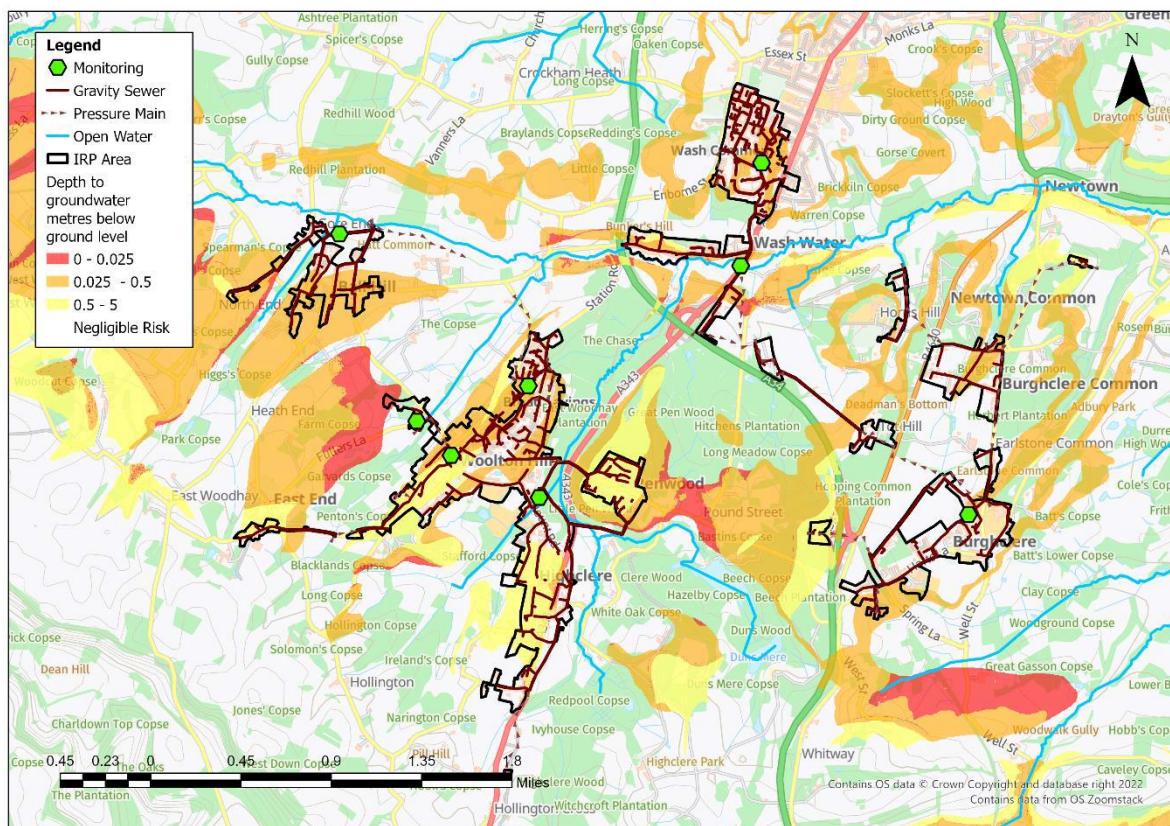


Hydrological Review – 2022-2023

This section summarises the hydrological conditions within the Wash Water catchment within the period under investigation and provides comparison against previous year's performance to put the annual performance into context. The hydrological review has been undertaken based on the Hydrological Year which runs October 1st to September 30th.

Catchment Rainfall

Representative Radar rainfall has been used to generate monthly data at catchment level for comparison with average data generated by local Met Office Weather Station Records. Figure 2 presents the comparison of this data for the last four hydrological years to support longer term trends within the local system.

Figure 2 – Monthly Rainfall Performance

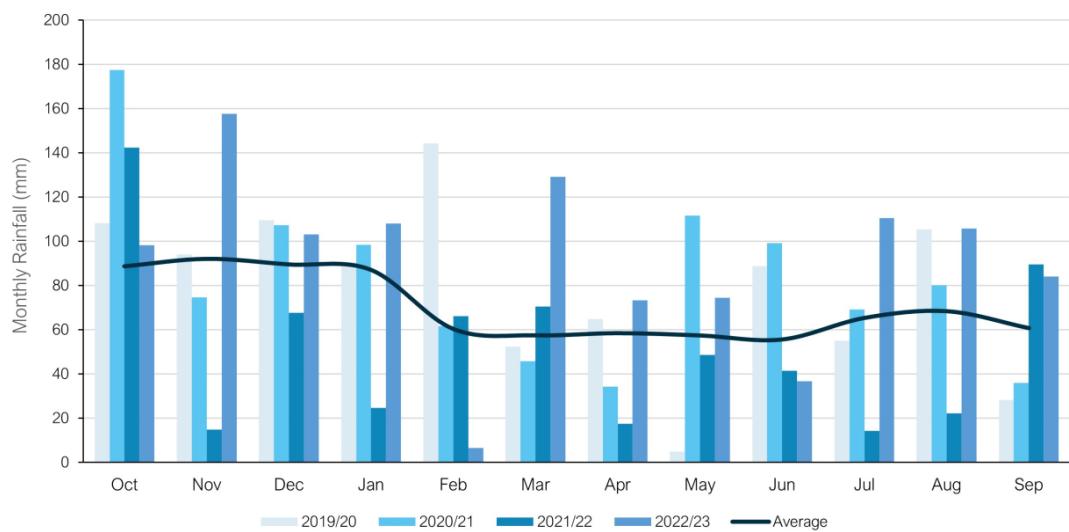

Average Values taken from Met Office Weather Station at Marlborough based on the period 1991-2020

The total rainfall for the 2022/23 hydrological year is 29% above the annual average total. Total rainfall values are presented in Table 3 below.

Table 3 –Total Rainfall Based on Hydrological Year

Average (mm)	2019/20 (mm)	2020/21 (mm)	2021/22 (mm)	2022/23 (mm)
841	946	995	619	1087

Groundwater / Local River Level

The Wash Water catchment is situated in the Enborne water resources area. It sits in the sedimentary bedrock of the London Clay formation of sand and the London Clay formation of clay, silt and sand. The Wash Water catchment is not part of a designated principal aquifer within the UK.


The Environment Agency has gauging stations on local watercourses measuring stage and observation boreholes (OBH) measuring groundwater levels locally to the catchment which can be used to provide indicative local groundwater performance.

From previous investigations we have identified the following sites are good indicators of groundwater levels within the catchment.

- River Enborne, Brimpton.
- Kingsclere Brook, Kingsclere.

These sites are illustrated in the figure below, alongside the closest groundwater reference station and closest gauging station from the Water Situation Report.

Figure 4 – Local Monitoring Stations

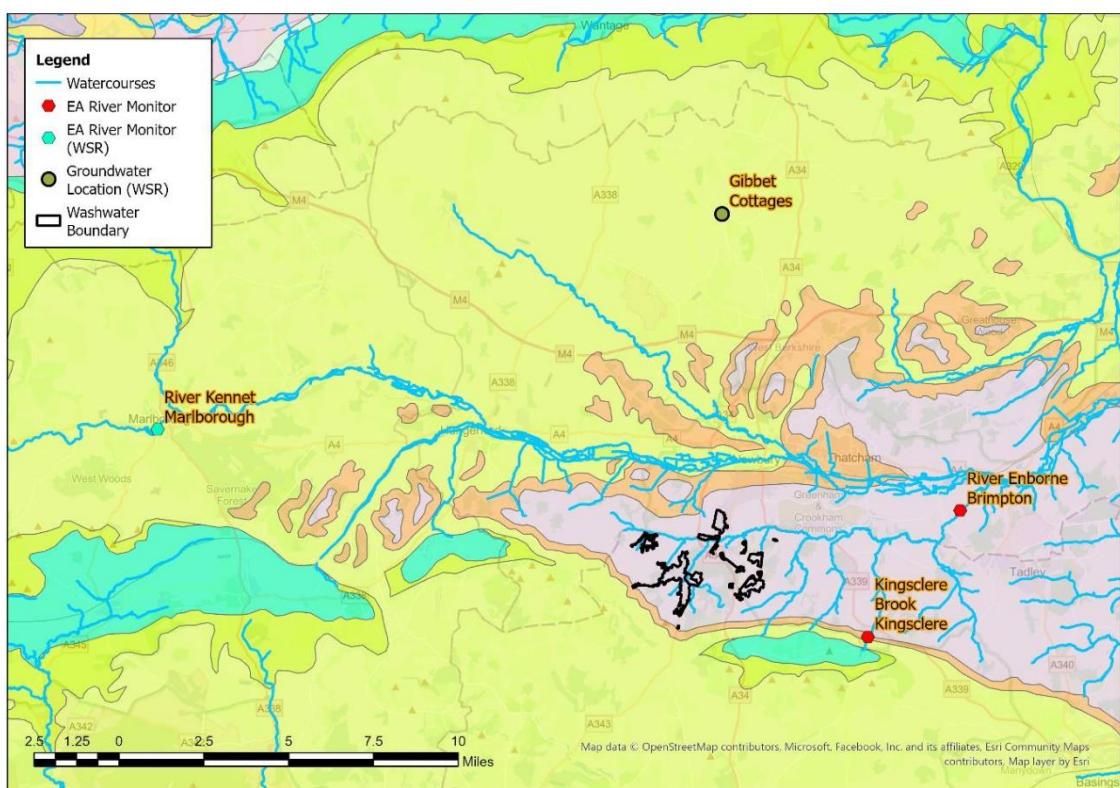

The following figures represent the last three hydrological years of level information at the indicator sites to build a picture of the relative conditions prevalent in the current year. It is presented against both the daily total rainfall values for the catchment and a rolling 15 day total rainfall.

Figure 5A – River Enborne, Brimpton



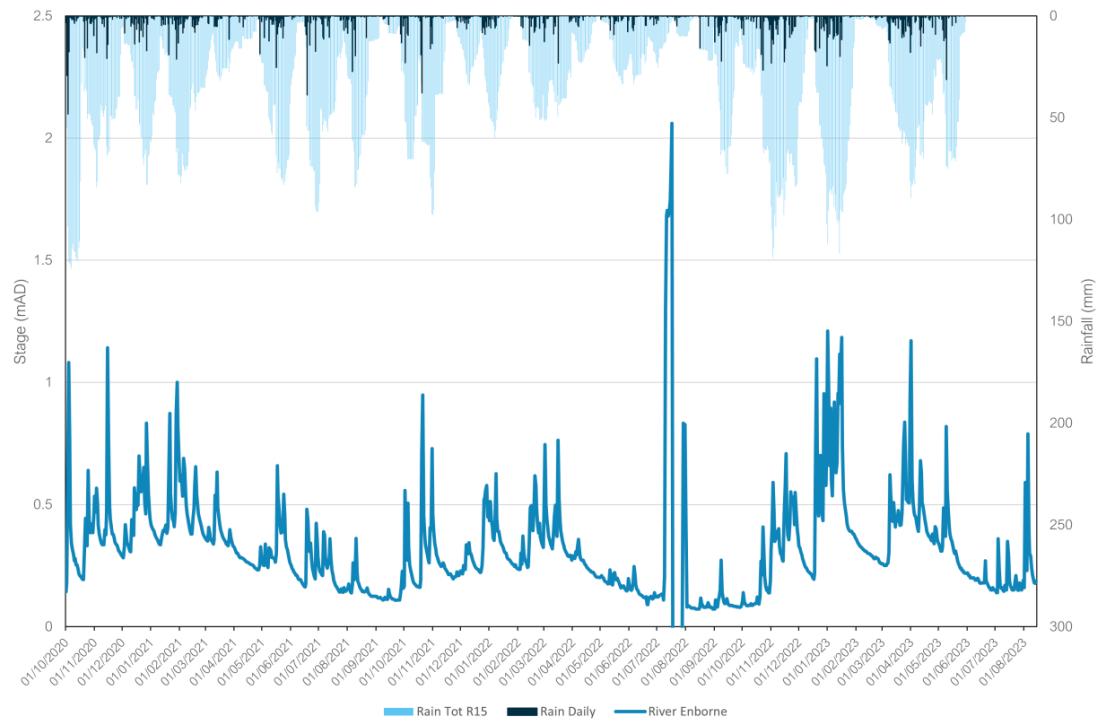


Figure 5B – Kingsclere Brook, Kingsclere

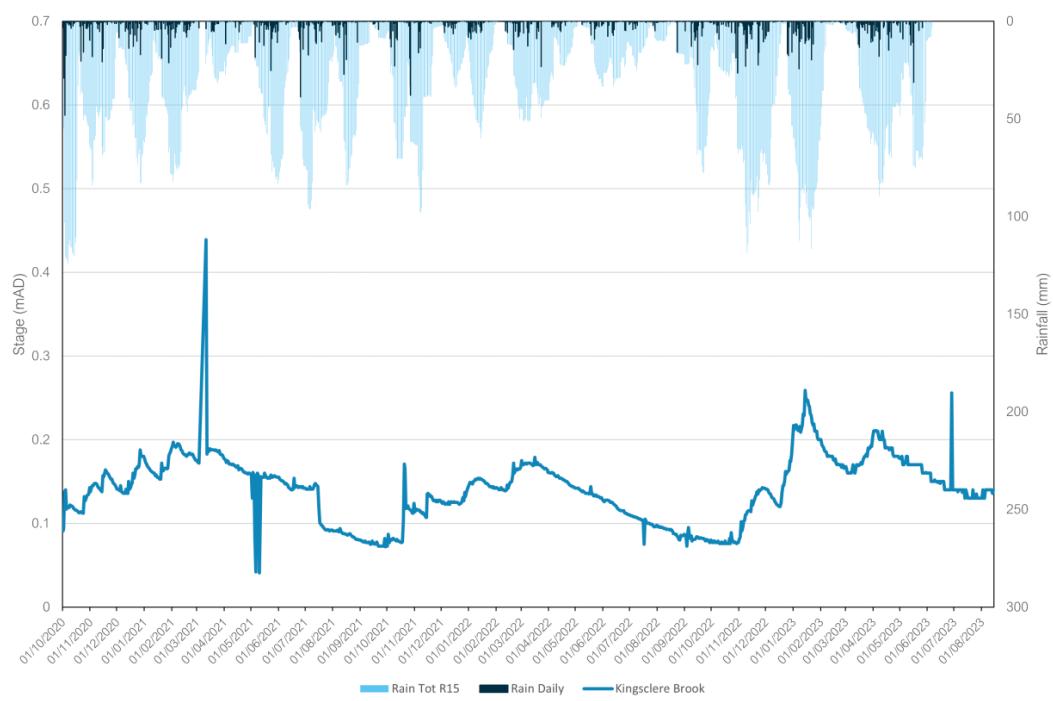

In addition to these specific stations, the wider groundwater context is illustrated in the Water Situation Report for Enborne. The nearest groundwater reference station is Gibbet Cottages. This site shows groundwater levels at below normal in 2022, before rising towards the end of the year. Groundwater levels have been observed at normal in 2023. This can be seen in the figure below alongside the river indicator Marlborough on the River Kennet.

Figure 6 – Water Situation Report

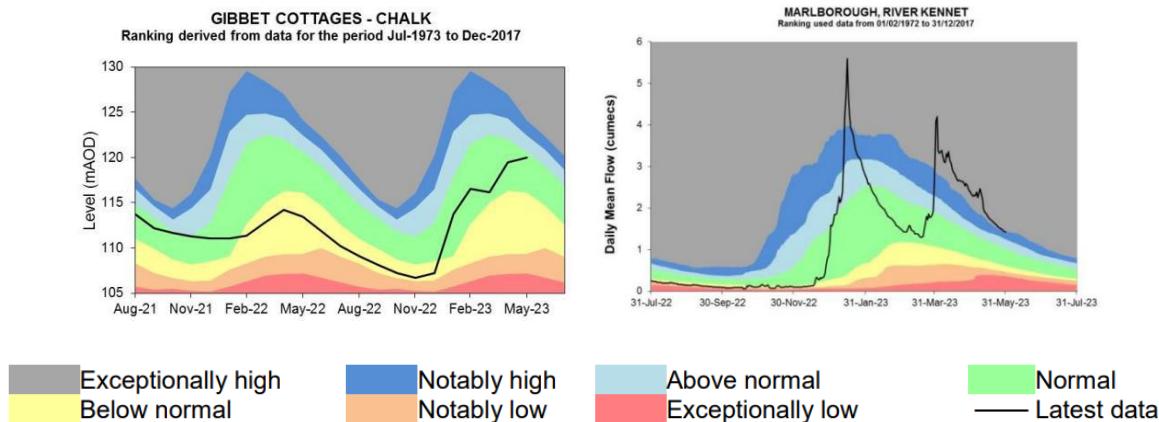

Extract from - [Water Situation Report \(publishing.service.gov.uk\)](https://publishing.service.gov.uk)

Network Performance

Within the Wash Water catchment there are three sites detailed within the Environment Agency Consents Database which has an Event Duration Monitor (EDM) fitted.


Table 7 below details the last 2 years performance of overflow 'Wash Water STW'.

Table 7 – Event Duration Monitoring – Wash Water STW

Overflow	2021		2022	
	Spills	Duration (hours)	Spills	Duration (hours)
Wash Water STW	61	697.48	44	593.68

A critical part of the assessment of EDM performance and its relation to groundwater infiltration is to review the month-on-month spill performance, against previous years and the monthly total rainfall values to give context to the performance. Figure 8 below presents the EDM performance trend and rainfall for recent years.

Figure 8 – EDM Monthly Performance – Wash Water STW

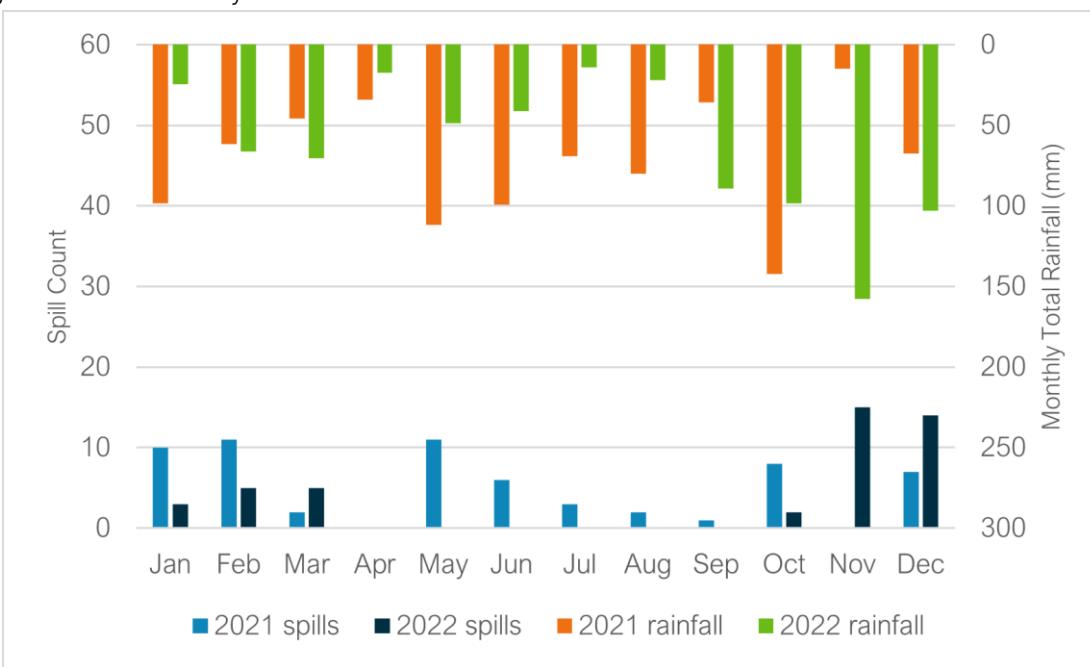

The trend in spill performance across the two recorded years does show variation in spills, with an overall focus on spills during the autumn and winter months. The data suggests a wider relationship between rainfall, elevated groundwater levels and spill frequency. For example, despite broadly similar rainfall totals, significantly more spills were recorded at Wash Water STW in February 2021 compared to February 2022. The indicator site data shown in Figure 5, suggests groundwater levels in the catchment were higher in February 2021 than in February 2022. Similarly, a relatively high number of spills were recorded in December 2022, when considering the rainfall total for the month, with the indicator site data shown in Figure 5 suggesting groundwater levels became elevated towards the end of the month.

Note that a significant number of spills were recorded at Wash Water STW during the summer of 2021, indicative of spills also occurring in the catchment during prolonged or intense rainfall events, outside of periods of elevated groundwater levels.

As part of the process of matching GISMP catchments to EDM sites, two additional sites have been identified for inclusion in this year's Addendum Report, that weren't included in last year's report.


Table 9 below details the last 2 years performance of overflow 'Blind Mans Gate Highclere SPS'.

Table 9 – Event Duration Monitoring – Blind Mans Gate Highclere SPS

Overflow	2021		2022	
	Spills	Duration (hours)	Spills	Duration (hours)
Blind Mans Gate Highclere SPS	16	140.12	18	122.81

Figure 10 below presents the EDM performance trend and rainfall for recent years.

Figure 10 – EDM Monthly Performance – Blind Mans Gate Highclere SPS

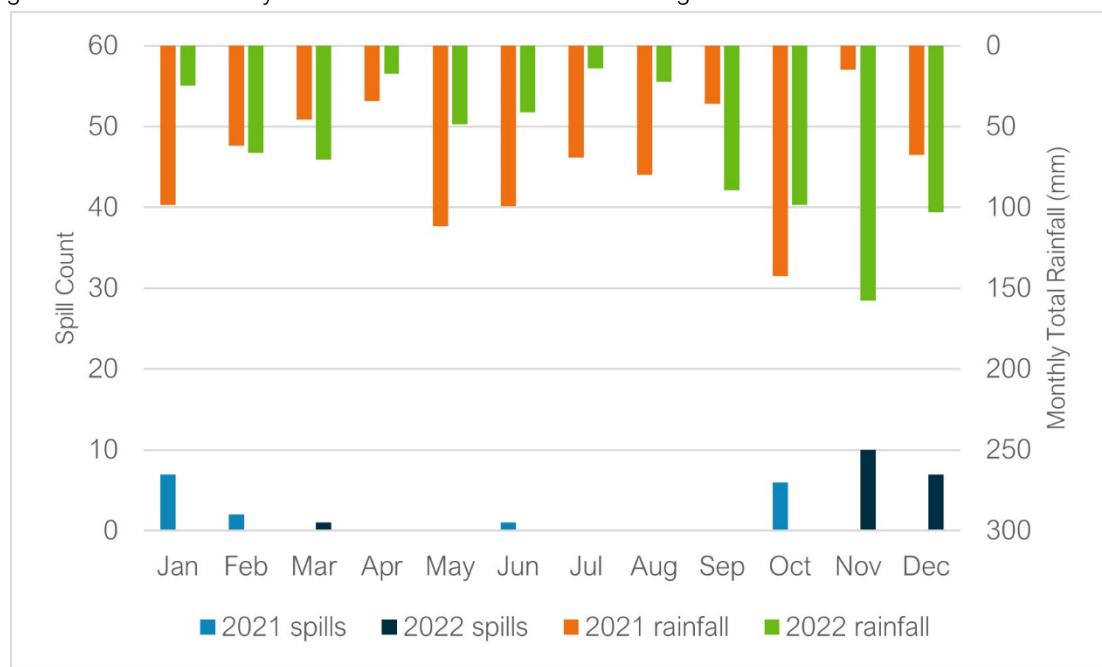

The data suggests a wider relationship between rainfall, elevated groundwater levels and spill frequency. A relatively high number of spills were recorded in December 2022, when considering the rainfall total for the month, with the indicator site data shown in Figure 5 suggesting groundwater levels became elevated towards the end of the month.


Table 11 below details the last two years performance of overflow 'Knights Lane SPS'.

Table 11 – Event Duration Monitoring – Knights Lane SP

Overflow	2021		2022	
	Spills	Duration (hours)	Spills	Duration (hours)
Knights Lane SPS	25	359.10	26	298.16

Figure 12 below presents the EDM performance trend and rainfall for recent years.

Figure 12 – EDM Monthly Performance – Knights Lane SPS

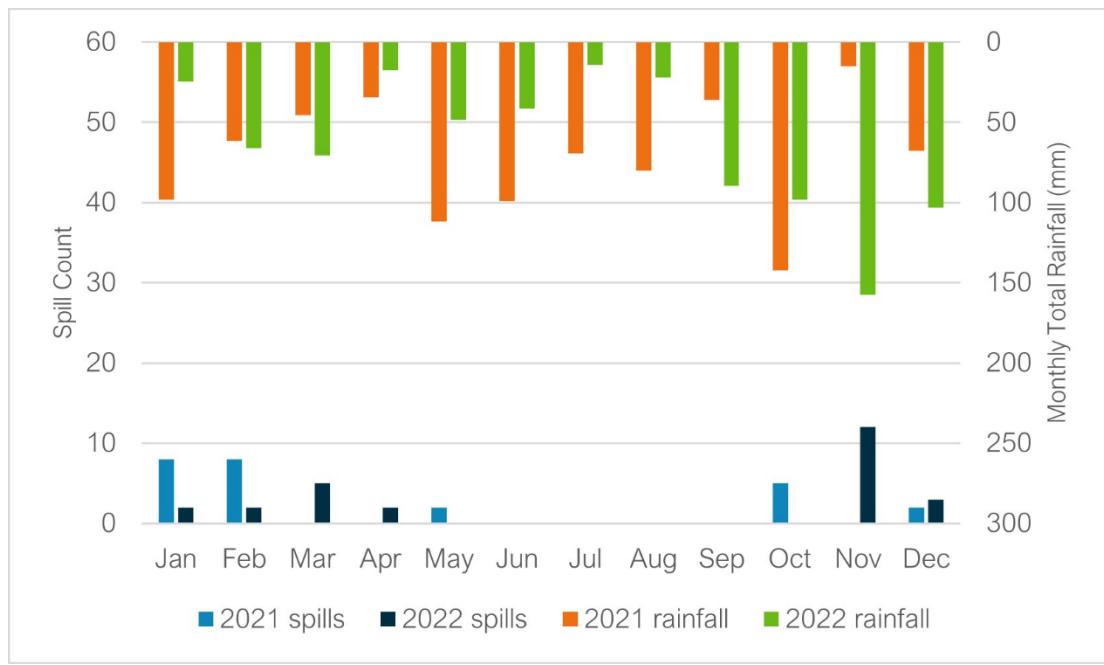

The data suggests a wider relationship between rainfall, elevated groundwater levels and spill frequency. There is an overall focus on spills in the autumn, winter, and early spring months, despite similar rainfall totals having been observed during other months of the year. The indicator site data shown in Figure 5, suggests groundwater levels in the catchment were elevated during the autumn, winter, and early spring months, in comparison to other months of the year. Similarly, despite broadly similar rainfall totals, significantly more spills were recorded at Knights Lane SPS in February 2021 compared to February 2022. The indicator site data shown in Figure 5, suggests groundwater levels in the catchment were higher in February 2021.

Investigations & Interventions

This section details the activities that have been undertaken within the catchment within the Hydrological Year 2022-23.

Monitor Installations

The sewer depth monitor (SDM) programme supports long term groundwater understanding within GISMP catchments. Currently, there are a total of 8 monitors installed within the Wash Water catchment. There are currently no further monitor installs pending.

The data from these will be cross-referenced with other long-term records (where available) within the catchment.

Remediation Works Undertaken this Hydrological Year

Table 13 below provides a summary of the investigations and remediation works undertaken or planned within the Wash Water catchment in the 2022-23 Hydrological Year, as well as works undertaken in the 2021-22 Hydrological Year.

Table 13 – Works Undertaken in the 2022/23 Hydrological Year & in the 2021/22 Hydrological Year

Investigation/ remediation type	Number/ length undertaken 21/22	Number/ length undertaken 22/23
CCTV survey	N/A	N/A
Look and lift survey	N/A	N/A
Sewer lining	N/A	N/A
Patch lining	N/A	N/A
Manhole sealing	N/A	N/A
Manhole sealing plates	N/A	N/A
Manhole covers and frames replaced	N/A	N/A

No investigations/ interventions were undertaken in the Wash Water catchment in the 2022/23 Hydrological Year. However, the system will continue to be monitored and investigations/ interventions undertaken as appropriate and when conditions allow.

An upgrade is also planned for Wash Water STW. This will improve its ability to treat the volumes of incoming sewage, reducing the need for untreated discharges to the environment. The scheme is due to be completed in 2024.

Summary

EDM data is indicative of the role of groundwater infiltration on spills in the Wash Water catchment. This hydrological year (October 2022 – September 2023), indicator site data suggests groundwater levels have generally been higher than the previous hydrological year, and EDM data for 2023 will be analysed once available to continue to examine the relationship between groundwater levels and overflow spills in the Wash Water catchment.

Lift and look and CCTV surveys will be undertaken in remaining wet winter periods if conditions allow. The aim of this is to find further priority locations for remediation and investigating/ justifying the need for future larger scale lining as part of our 2024 Price Review (PR) process if required.

Addendum - Annual Update 2024 Table of contents


Overview	39
Hydrological Review – 2023-24	40
Network Performance	44
Investigations & Interventions	47
Summary	49

Overview

This addendum to the Wash Water Groundwater Impacted System Management Plan 2021 (GISMP) provides an update on performance/work undertaken in the Hydrological Year October 2023 to September 2024. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year and being planned
- Summary and plan for 2024/25

Figure 1 – Wash Water Monitoring Plan

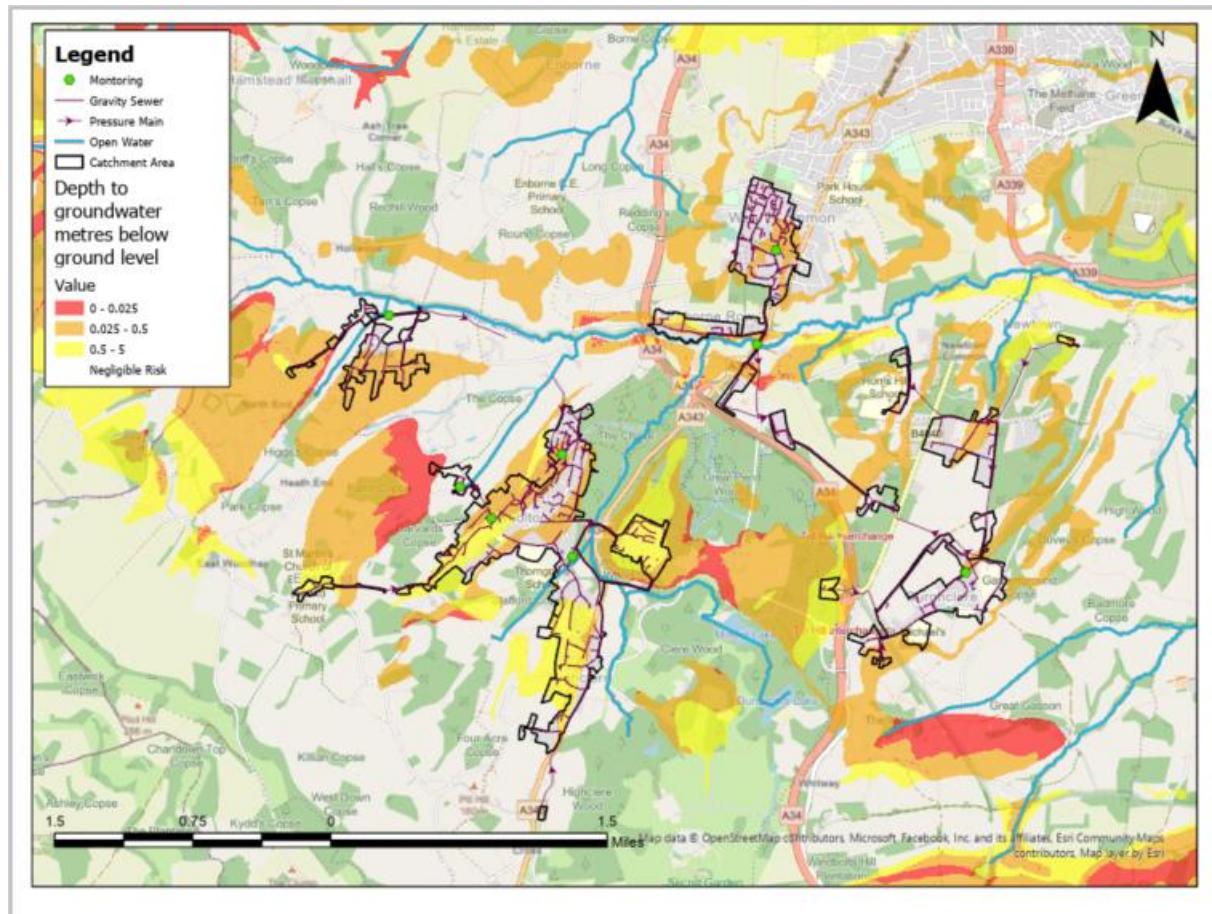


Hydrological Review – 2023-24

This section summarises the hydrological conditions within the Wash Water catchment within the period under investigation and provides comparison against previous year's performance to put the annual performance into context. The hydrological review has been undertaken based on the Hydrological Year which runs October 1st to September 30th.

Catchment Rainfall

Representative Radar rainfall has been used to generate monthly data at catchment level for comparison with average data generated by local Met Office Weather Station Records. Figure 2 presents the comparison of this data for the last five hydrological years to support longer term trends within the local system.

Figure 2 – Monthly Rainfall Data

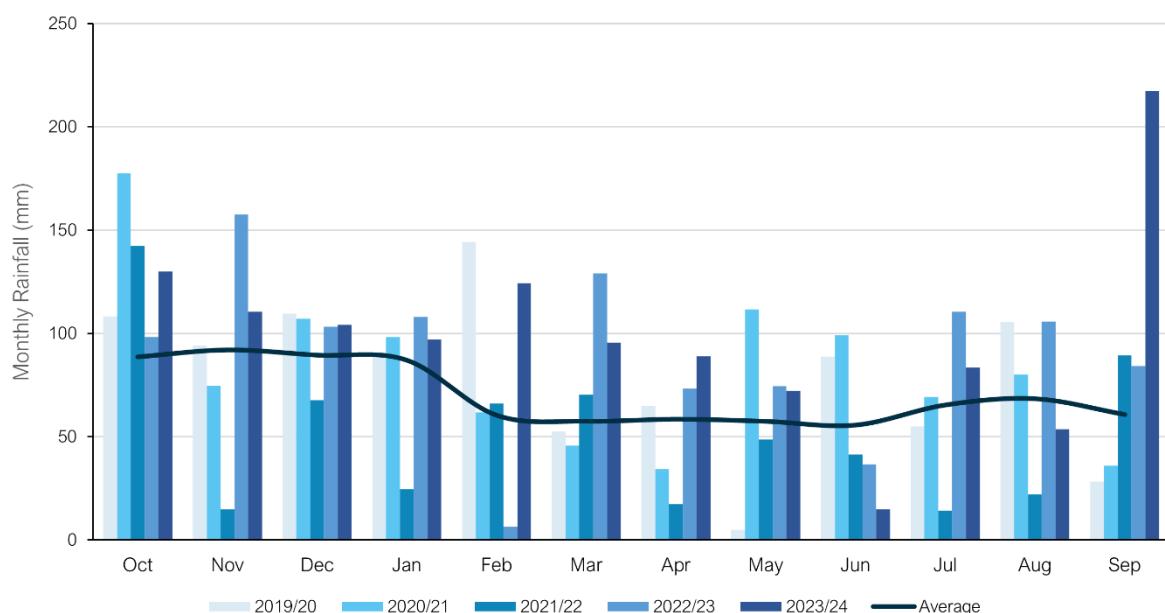

Average Values taken from Met Office Weather Station at Marlborough based on the period 1991-2020

The total rainfall for the 2023/24 hydrological year is 42% above the annual average total. Total rainfall values are presented in Table 3 below.

Table 3 –Total Rainfall Based on Hydrological Year

Average (mm)	2019/20 (mm)	2020/21 (mm)	2021/22 (mm)	2022/23 (mm)	2023/24 (mm)
841	946	995	619	1087	1192

Groundwater / Local River Level

The Wash Water catchment is situated in the Enborne water resources area. It sits in the sedimentary bedrock of the London Clay formation of sand and the London Clay formation of clay, silt and sand. The Wash Water catchment is not part of a designated principal aquifer within the UK.


The Environment Agency has gauging stations on local watercourses measuring stage and observation boreholes (OBH) measuring groundwater levels locally to the catchment which can be used to provide indicative local groundwater performance.

From previous investigations we have identified the following sites are good indicators of groundwater levels within the catchment.

- River Enborne, Brimpton.
- Kingsclere Brook, Kingsclere.

These sites are illustrated in Figure 4, alongside the closest groundwater reference station and closest gauging station from the Water Situation Report.

Figure 4 – Local Monitoring Stations

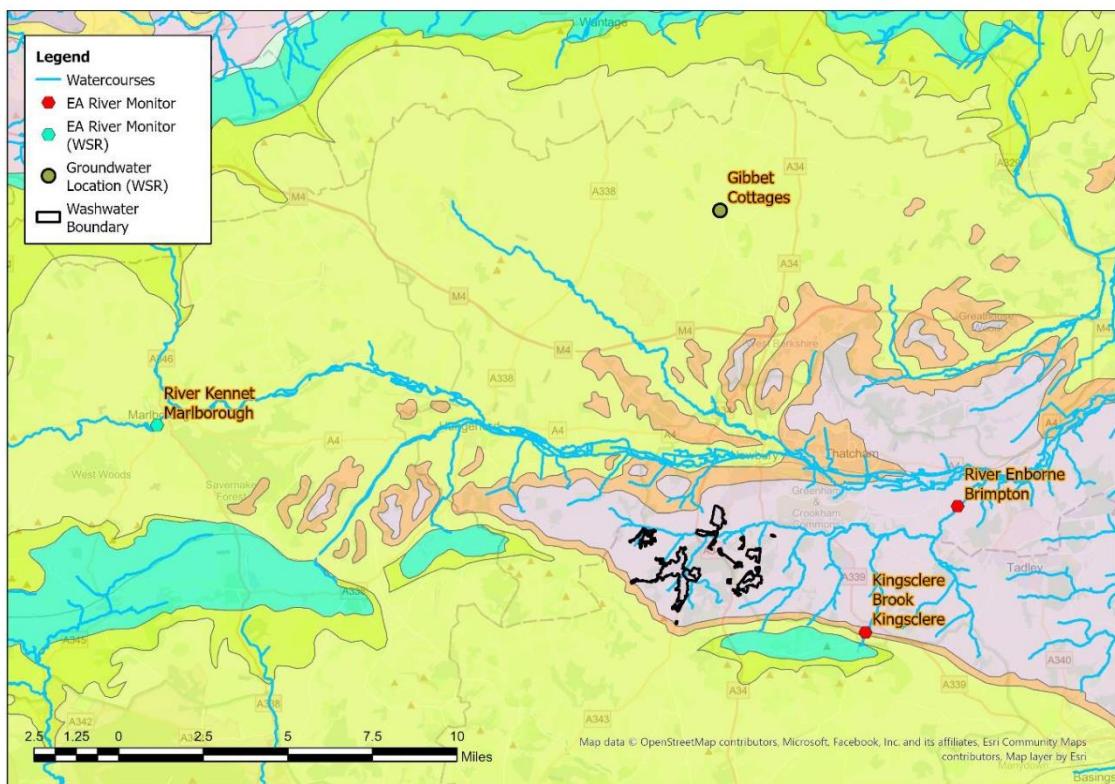

Figures 5A-5B represent the last three hydrological years of level information at the indicator sites to build a picture of the relative conditions prevalent in the current year. It is presented against both the daily total rainfall values for the catchment and a rolling 15 day total rainfall.

Figure 5A – River Enborne, Brimpton



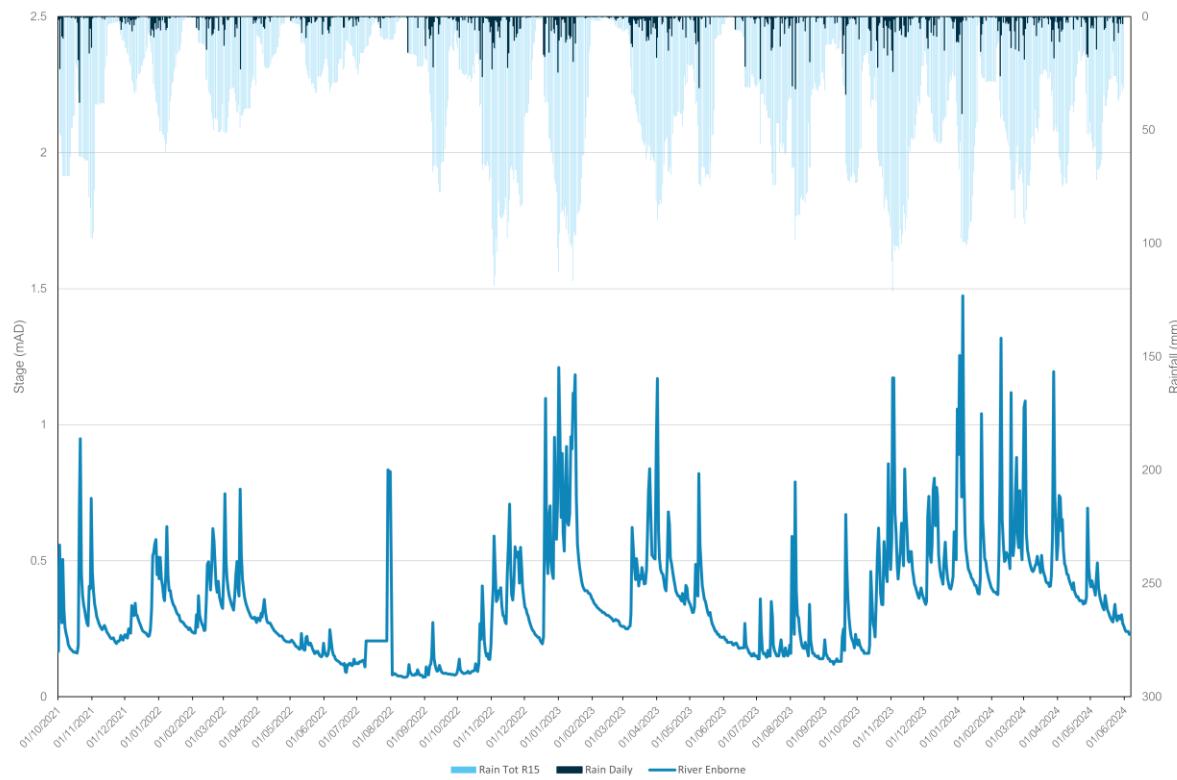


Figure 5B – Kingsclere Brook, Kingsclere

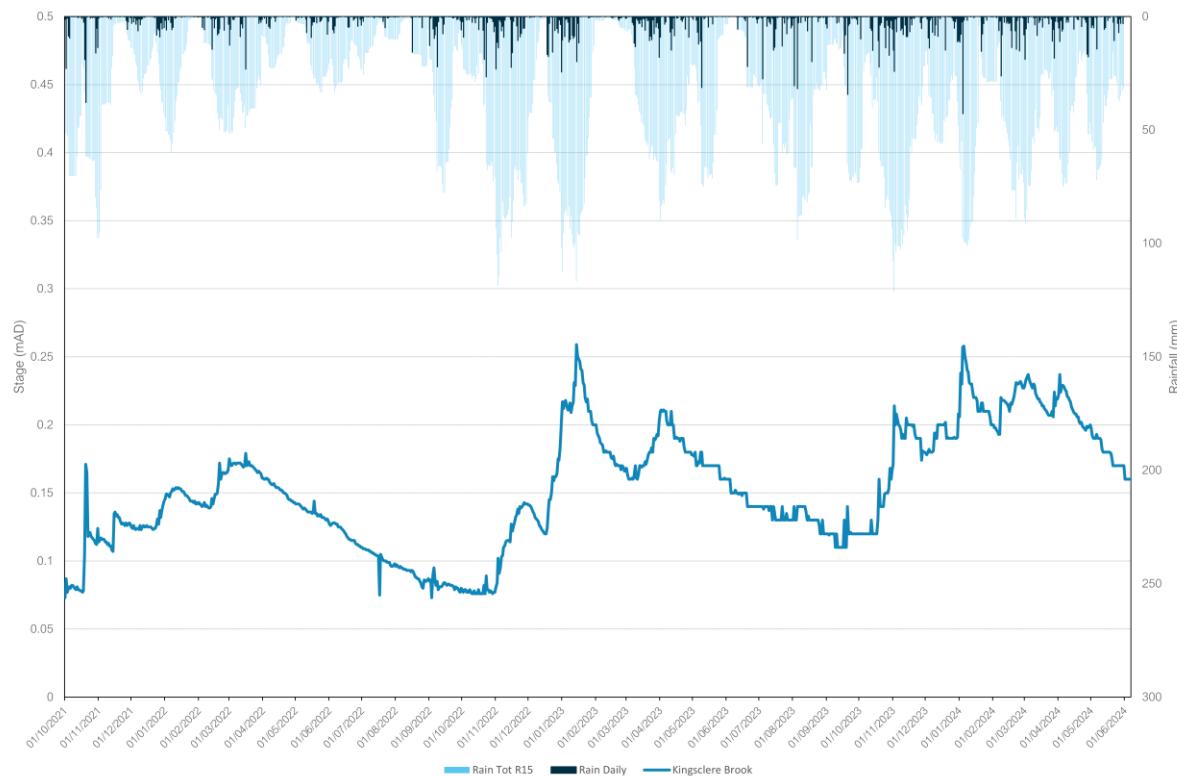

In addition to these specific stations, the wider groundwater context is illustrated in the Water Situation Report for Enborne. The nearest groundwater reference station is Gibbet Cottages. This site shows groundwater levels generally at normal levels in 2023, before increasing towards the end of the year to reach exceptionally high levels. Groundwater levels have remained exceptionally high during 2024. This can be seen in Figure 6 alongside the river indicator Marlborough on the River Kennet.

Figure 6 – Water Situation Report

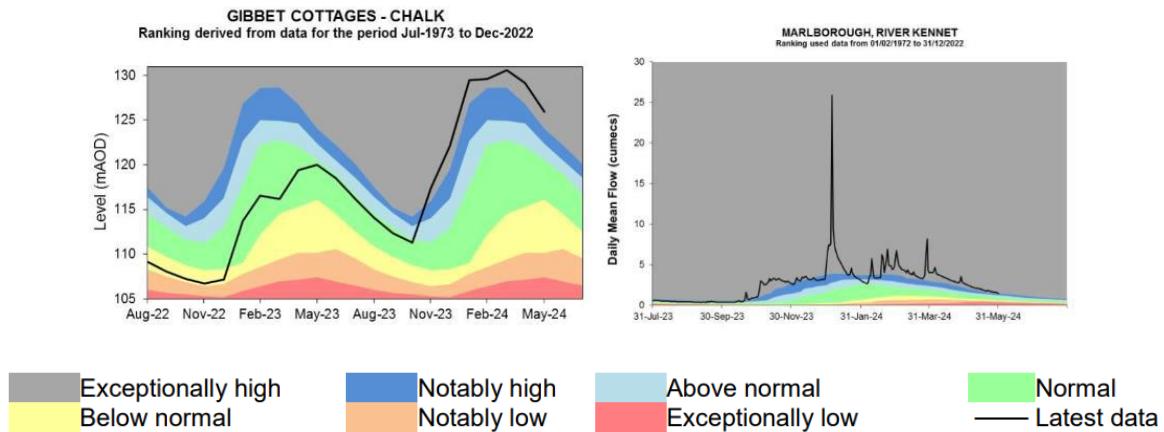

Extract from - [Water Situation Report \(publishing.service.gov.uk\)](https://publishing.service.gov.uk)

Network Performance

Within the Wash Water catchment there are three sites detailed within the Environment Agency Consents Database which has an Event Duration Monitor (EDM) fitted.


Table 7 below details the last 2 years performance of overflow 'Wash Water STW'.

Table 7 – Event Duration Monitoring – Wash Water STW

Overflow	2022		2023	
	Spills	Duration (hours)	Spills	Duration (hours)
Wash Water STW	44	593.68	111	1731.25

A critical part of the assessment of EDM performance and its relation to groundwater infiltration is to review the month-on-month spill performance, against previous years and the monthly total rainfall values to give context to the performance. Figure 8 below presents the EDM performance trend and rainfall for recent years.

Figure 8 – EDM Monthly Performance – Wash Water STW

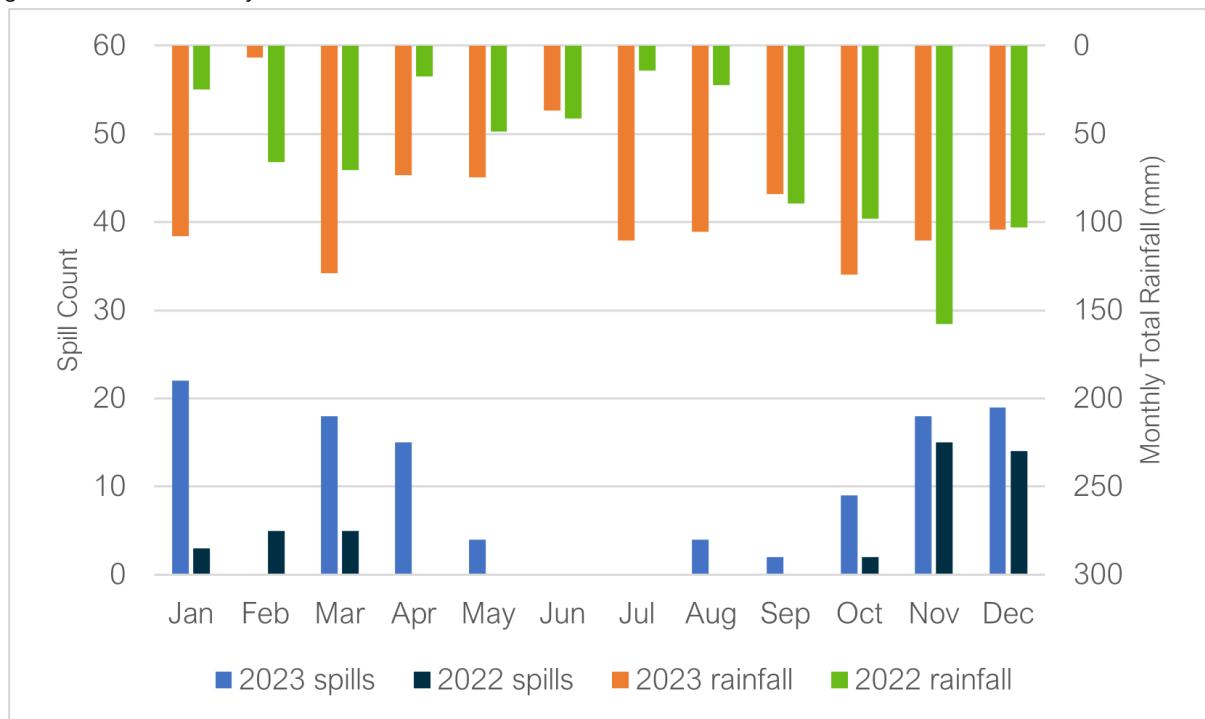

The trend in spill performance across the two recorded years does show variation in spills, with an overall focus on spills during the autumn and winter months. The data suggests a wider relationship between rainfall, elevated groundwater levels and spill frequency. For example, despite broadly similar rainfall totals, significantly more spills were recorded in December 2023 compared to December 2022. The indicator data shown in Figures 5 and 6, suggests that groundwater levels were more elevated in December 2023. Similarly, significantly more spills were recorded January – April 2023, compared to the same period in 2022. The indicator site data shown in Figure 5, suggests that groundwater levels in the catchment were more elevated during this period in 2023. Note that several spills were recorded at Wash Water STW during the summer of 2023, indicative of spills also occurring in the catchment during prolonged or intense rainfall events, outside of periods of elevated groundwater levels.


Table 9 below details the last 2 years performance of overflow 'Blind Mans Gate Highclere SPS'.

Table 9 – Event Duration Monitoring – Blind Mans Gate Highclere SPS

Overflow	2022		2023	
	Spills	Duration (hours)	Spills	Duration (hours)
Blind Mans Gate Highclere SPS	18	122.81	46	521.00

Figure 10 below presents the EDM performance trend and rainfall for recent years.

Figure 10 – EDM Monthly Performance – Blind Mans Gate Highclere SPS

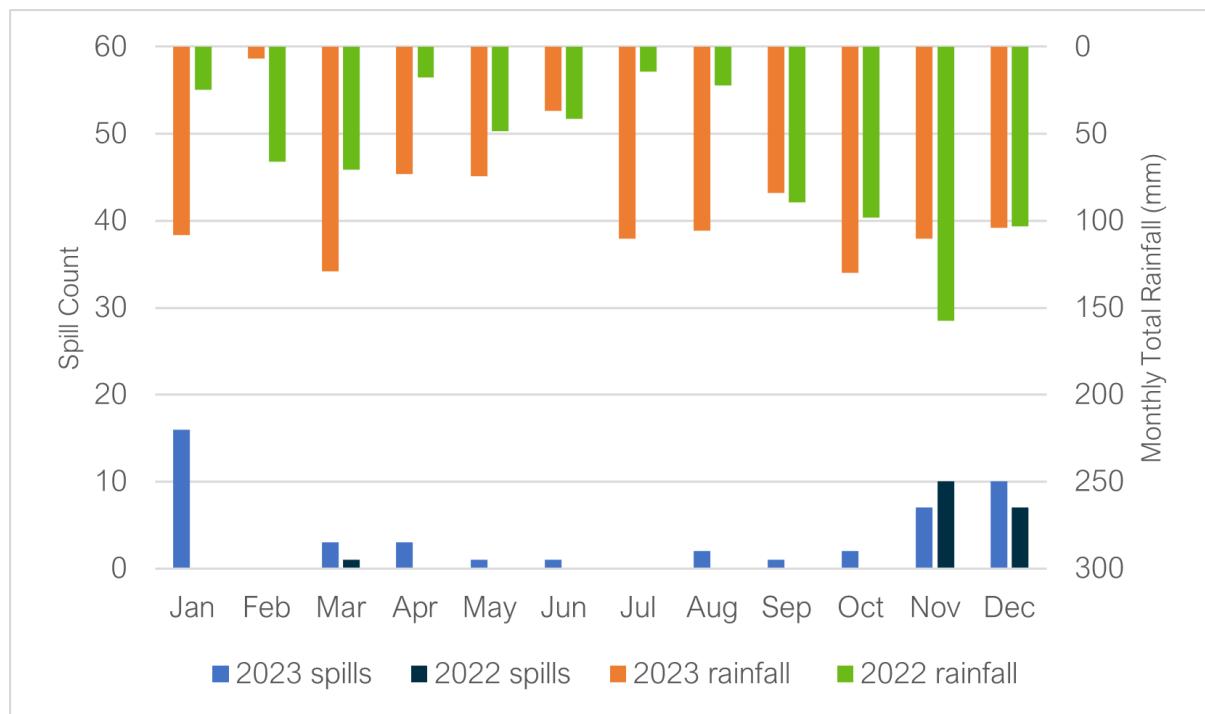

The data suggests a wider relationship between rainfall, elevated groundwater levels and spill frequency. For example, despite broadly similar rainfall totals, significantly more spills were recorded at Blind Mans Gate SPS in December 2023 compared to December 2022. The indicator data shown in Figure 5, suggests groundwater levels in 2023 were at higher levels than those seen in 2022 for this period. Note that a number of spills were recorded at Blind Mans Gate Highclere SPS during the summer of 2023, indicative of spills also occurring in the catchment during prolonged or intense rainfall events, outside of periods of elevated groundwater levels.


Table 11 below details the last two years performance of overflow 'Knights Lane SPS'.

Table 11 – Event Duration Monitoring – Knights Lane SPS

Overflow	2022		2023	
	Spills	Duration (hours)	Spills	Duration (hours)
Knights Lane SPS	26	298.16	50	743.75

Note that in 2023, the EDM was only operational for 70% of the year. This likely impacted the number of spills recorded earlier in the year, the monitor issues were resolved in March. Figure 12 below presents the EDM performance trend and rainfall for recent years.

Figure 12 – EDM Monthly Performance – Knights Lane SPS

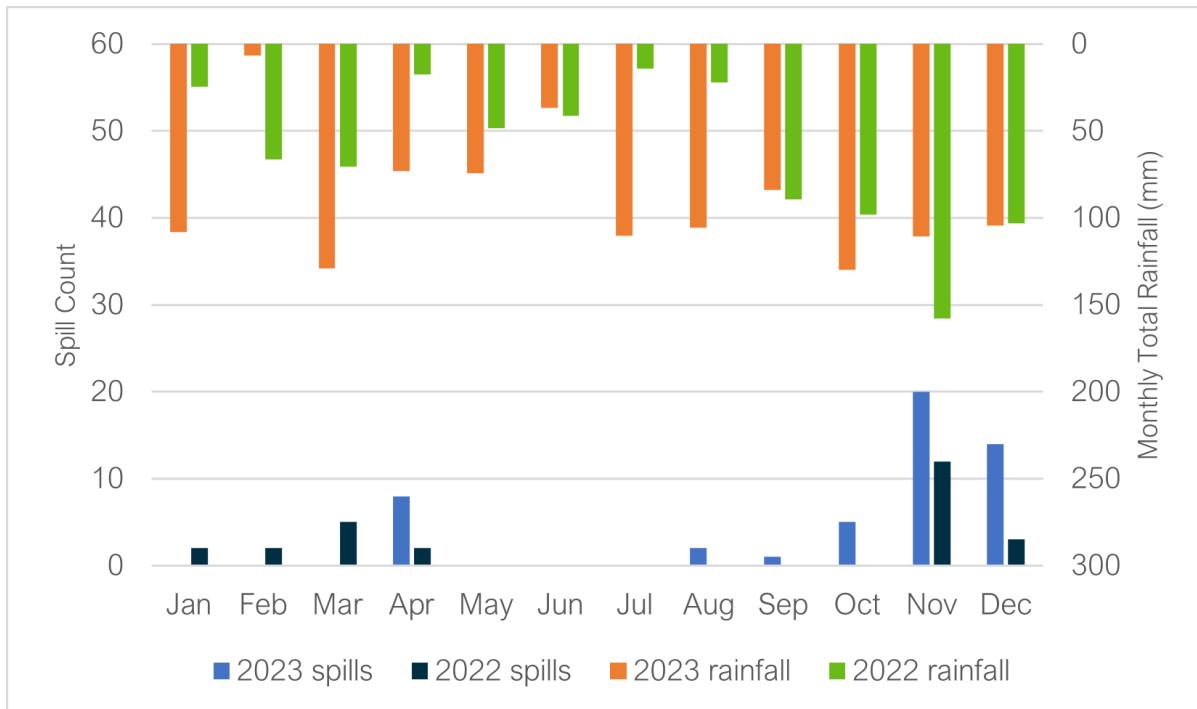

The data suggests a wider relationship between rainfall, elevated groundwater levels and spill frequency. For example, despite broadly similar rainfall totals, significantly more spills were recorded at Knights Lane SPS in December 2023. The indicator data in Figure 5, suggests groundwater levels in December 2023 were higher compared to in December 2022. Note that spills were also recorded at Knights Lane SPS during the summer of 2023, indicative of spills also occurring in the catchment during prolonged or intense rainfall events, outside of periods of elevated groundwater levels.

Investigations & Interventions

This section details the activities that have been undertaken within the catchment within the Hydrological Year 2023-24.

Monitor Installations

The sewer depth monitor (SDM) programme supports long term groundwater understanding within GISMP catchments. Currently, there are a total of 8 monitors installed within the Wash Water catchment. There are currently no further monitor installs pending.

The data from these will be cross-referenced with other long-term records (where available) within the catchment.

Remediation Works Undertaken this Hydrological Year

Table 13 below provides a summary of the investigations and remediation works undertaken or planned within the Wash Water catchment in the 2023-24 Hydrological Year, as well as works undertaken in the previous two hydrological years.

Table 13 – Works Undertaken in the 2023/2024 Hydrological Year, 2022/23 Hydrological Year & in the 2021/22 Hydrological Year.

Investigation/ remediation type	Number/ length undertaken 21/22	Number/ length undertaken 22/23	Number/ length undertaken 23/24
CCTV survey	N/A	N/A	4.2 Kilometres*
Look and lift survey	N/A	N/A	N/A
Sewer lining	N/A	N/A	N/A
Patch lining	N/A	N/A	N/A
Manhole sealing	N/A	N/A	N/A
Manhole sealing plates	N/A	N/A	N/A
Manhole covers and frames replaced	N/A	N/A	N/A

*Total length of network scoped for survey across sewers predicted to be at high/ medium and low risk of groundwater infiltration. The purpose of the surveys to identify priority locations for remediation and to help verify the sewer risk zones.

Summary of CCTV surveys

Tables 10 and 11 below summarise the CCTV work undertaken for Wash Water in the 2023-24 Hydrological Year and gives details on the infiltration identified.

Table 10 – Total length of sewerage network surveyed by CCTV in the 2023-24 Hydrological Year.

Investigation/ remediation type	Length (m)
Planned CCTV Survey	3050
Survey Completed	1256
Total surveyed with clear flow	682

Table 11 - Number of points of infiltration found and assessed severity from CCTV surveys.

Infiltration severity	No. of sections of pipework
Gushing	0
Running	3
Dripping	1
Seeping	1
Total	5

An upgrade is also planned for Wash Water STW. This will improve its ability to treat the volumes of incoming sewage, reducing the need for untreated discharges to the environment. The scheme is due to be completed in 2024, however, delivery dates are being managed at a programme level, delivery dates stated are based upon current views and are subject to change

It is expected that Wash Water STW, Blind Mans Gate Highclere SPS and Knights Lane SPS will meet all government targets for storm overflows by 2040 – 2045.

Summary

EDM data is indicative of the role of groundwater infiltration on spills in the Wash Water catchment. This hydrological year (October 2023 – September 2024), indicator site data suggests groundwater levels have generally been higher than those observed in the previous hydrological year, and EDM data for 2024 will be analysed once available to continue to examine the relationship between groundwater levels and overflow spills in the Wash Water catchment.

Lift and look and CCTV surveys will be undertaken in remaining wet winter periods if conditions allow and subject to funding and available capacity. The aim of this is to find further priority locations for remediation and investigating/justifying the need for future larger scale lining as part of our Price Review (PR) process if required.

Addendum - Annual Update 2025

Table of contents

Kennet and Trib River Basin Summary	50
Burghfield	52
East Shefford	55
Froxfield	58
Fyfield	60
Kingsclere	64
Marlborough	67
Ramsbury	71
Reading	75
Silchester	78
Wash Water	81
Winterbourne	85
Woolhampton	88

Kennet and Trib River basin summary

The Thames Water region covers the length of the River Thames from its source down to Tilbury including all its tributaries. The sewer network has overflows that discharge along the River Thames and its associated tributaries. The role of storm overflows in the network is to protect against property flooding from the sewerage system. Storm overflows, which may be augmented with settlement tanks, are employed to optimise the split between wastewater treatment and the management of rainfall. Storm separation is typically designed in accordance with regulatory guidance.

Aligned with our Drainage and Wastewater Management Plan (DWMP) approach, the Thames Water region has been split into River Basins, each contains a varying number of localised sewer networks. Taking this approach allows alignment to the different drivers in each river basin and provides an efficient way to investigate, tackle performance and protect the environment. This report covers the performance of the sewer networks within the Kennet and Trib River Basin which are heavily influenced by groundwater infiltration into the network.

The Kennet and Trib River covers the upper reaches of the River Thames including its associated tributaries and streams. The river basin contains 12 heavily groundwater impacted Thames Water localised sewer systems that interact with various rivers and streams forming the tributaries to the River Thames. Each localised sewer system may contain storm overflows located at sewage treatment works (STW) and/or in the network; or are “treat all” sites for which there is no overflow. Figure 1 shows the relationship between the sewer systems and the associated rivers and streams. Figure 2 shows the location of each localised sewer system within the Kennet and Trib River Basin with an insert showing the location of the Kennet and Trib River Basin in relation to the Thames Water Region.

Sewer System	Associated River / Stream	Relationship to the River Thames
Burghfield STW	River Kennet	Direct tributary of the River Thames
East Shefford STW	River Lambourn	Indirect tributary of the River Thames via River Kennet
Froxfield STW	River Dun	Indirect tributary of the River Thames via River Kennet
Fyfield STW	River Roding	Indirect tributary of the River Thames via Barking Creek
Kingsclere STW	Kingsclere Brook, River Enborne	Kingsclere indirect tributary of the River Thames via River Enborne then River Kennet. River Enborne indirect tributary of the River Thames via River Kennet.
Marlborough STW	River Kennet	Direct tributary of the River Thames
Ramsbury STW	River Kennet	Direct tributary of the River Thames
Reading STW	River Kennet, Holy Brook, River Thames	River Kennet direct tributary of the River Thames. Holy Brook indirect tributary of the River Thames via River Kennet. River Thames.
Silchester STW	Silchester Brook	Indirect tributary of the River Thames via River Loddon
Wash Water STW	River Enborne	Indirect tributary of the River Thames via River Kennet
Winterbourne STW	Winterbourne Stream	Indirect tributary of the River Thames via River Lambourn then River Kennet
Woolhampton STW	River Kennet	Direct tributary of the River Thames.

Figure 1: Relationship of the Sewer Systems to Associated Rivers

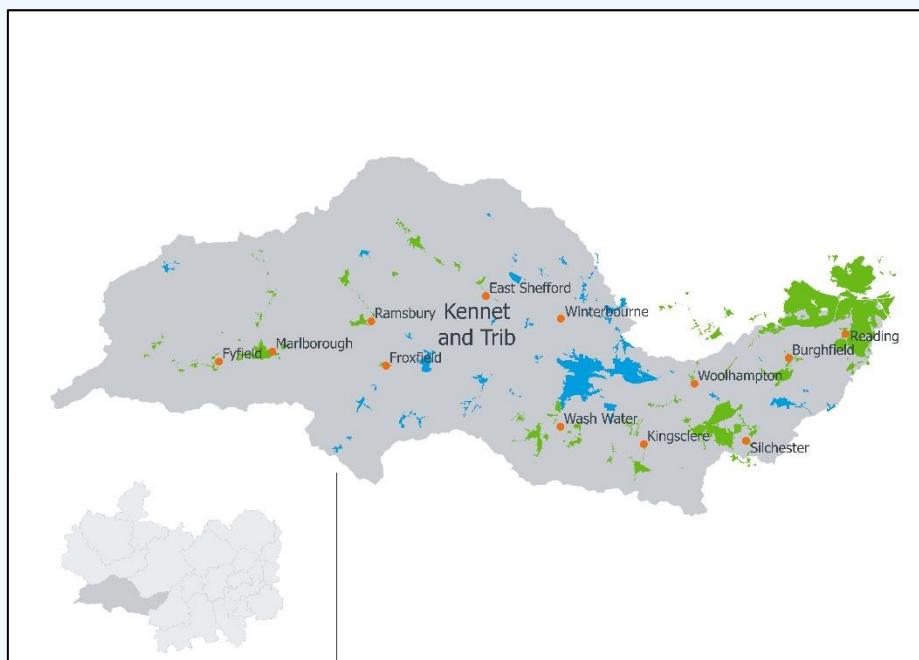


Figure 2: Location of Sewer Systems Within the Kennet and Trib River Basin

Burghfield

Burghfield is located in West Berkshire, approximately 4 miles south-west of Reading.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Burghfield sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 5 illustrate the relationship between rainfall and spills at CSOs. As can be seen the decrease in rainfall from 2023/24 into 2024/25, shown in Figure 1; shows a correlation with decreased number and duration of spills at the CSOs shown in Figure 5. However, the river levels remain consistent as shown in Figure 2, and 3.

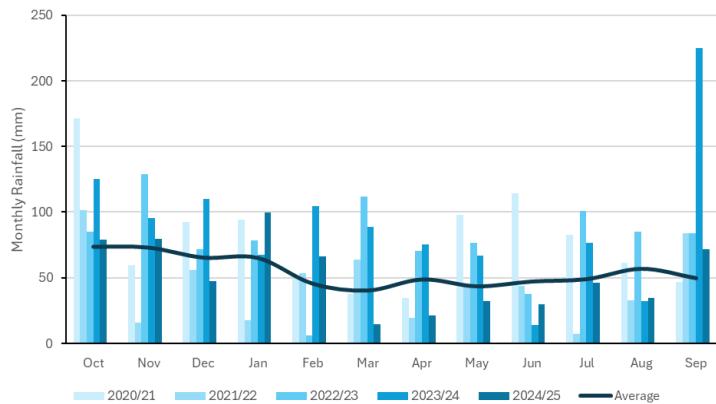


Figure 1: Monthly Rainfall Data

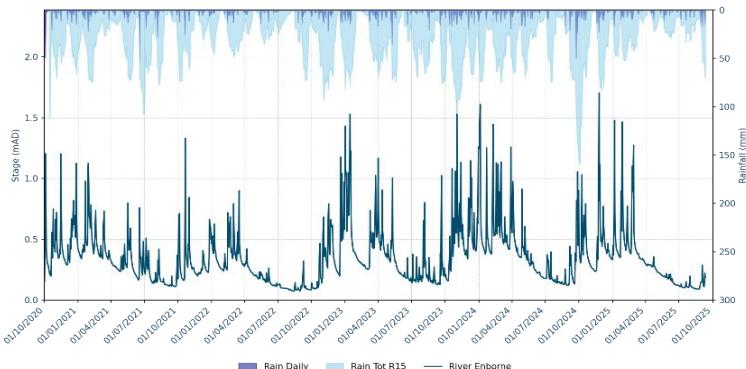


Figure 2: River Level data for River Enborne, Brimpton

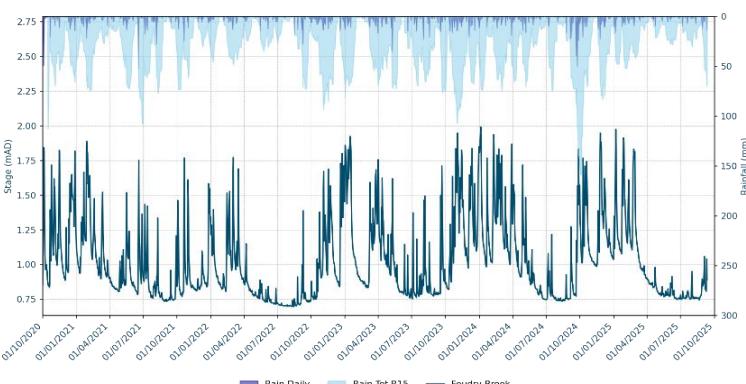


Figure 3: River Level data for Foudry Brook, Beech Hill

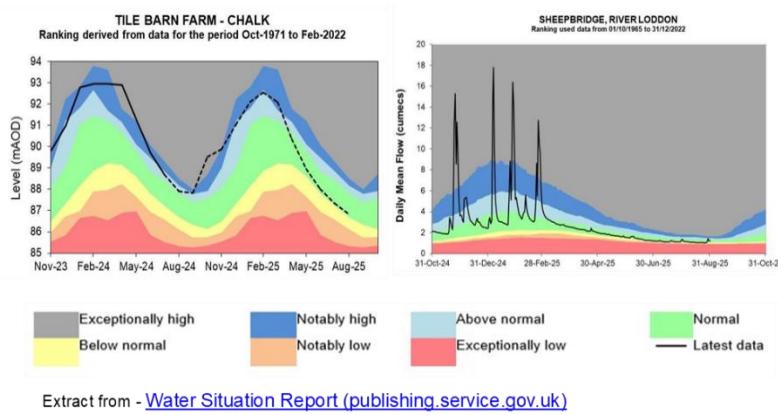


Figure 4: Ground Water situation Report

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figure 5.

Event Duration Monitoring	2023		2024		
	Overflow	Annual Spills	Duration (hours)	Annual Spills	Duration (hours)
Burghfield STW		132	2861	96	1639

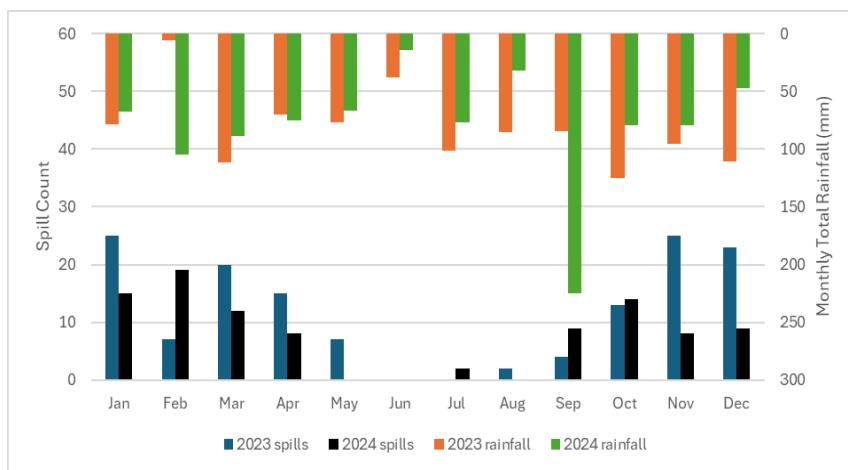


Figure 5: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Burghfield STW

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	170m	-	-
Look and lift surveys	-	-	-	-	-
Sewer lining	-	-	-	-	-
Patch lining	-	-	-	-	-
Manhole sealing / plates / covers and frames replaced	-	-	-	-	-
ATAC unit deployment	-	-	-	-	-

Summary

A review of river level data over 2023/2024 shows a similar pattern being followed compared to previous years, including the average rainfall in 2023 staying fairly consistent compared to 2024 (see Figure 5). The lower number of annual spills could be a result of the rainfall and river levels staying consistent. Moreover, there is a slight drop in groundwater levels for 2024/2025 compared to the groundwater levels of the previous year, but the effect of this decrease will be analysed when 2025 spill data is published.

East Shefford

East Shefford is located in Berkshire, approximately 9 miles south of Newbury and 16 miles north of Reading. This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the East Shefford sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 6 illustrate the relationship between rainfall and spills at CSOs. As can be seen the decrease in rainfall from 2023/24 into 2024/25, shown in Figure 1; shows a correlation to decreased groundwater and river levels shown in Figure 2 and Figure 3. However, an increased number and duration of spills at the CSOs are observed in 2025 compared to 2024 as shown in Figure 5.

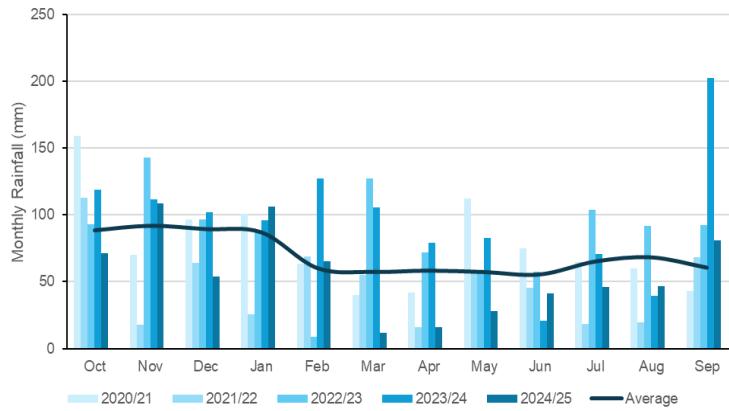


Figure 1: Monthly rainfall data 2020/21 to 2024/25

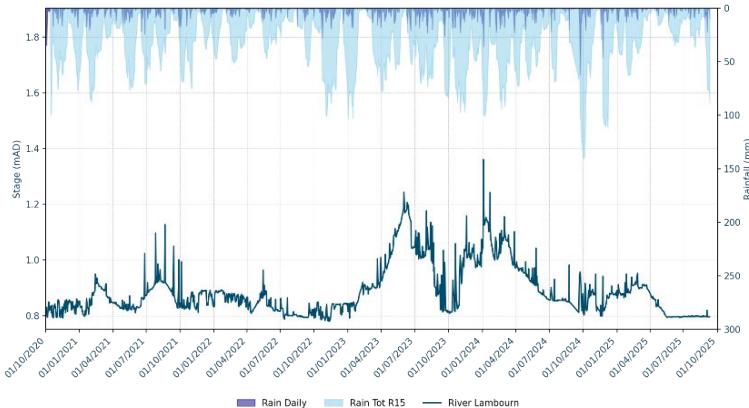


Figure 2: River Level data for River Lambourn at Lambourn

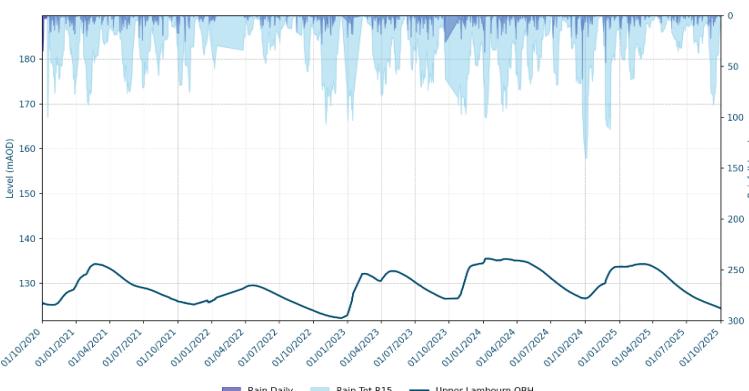


Figure 3: River Level data for Upper Lambourn OBH

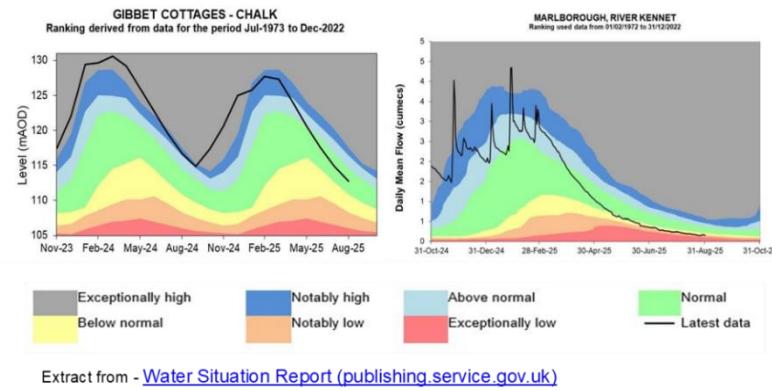


Figure 4: Ground Water situation Report

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figure 5 and 6.

Event Duration Monitoring	2023		2024	
	Annual Spills	Duration (hours)	Annual Spills	Duration (hours)
Overflow				
East Shefford STW	1	2.5	35	541
East Garston SPS	4	51.8	0	0

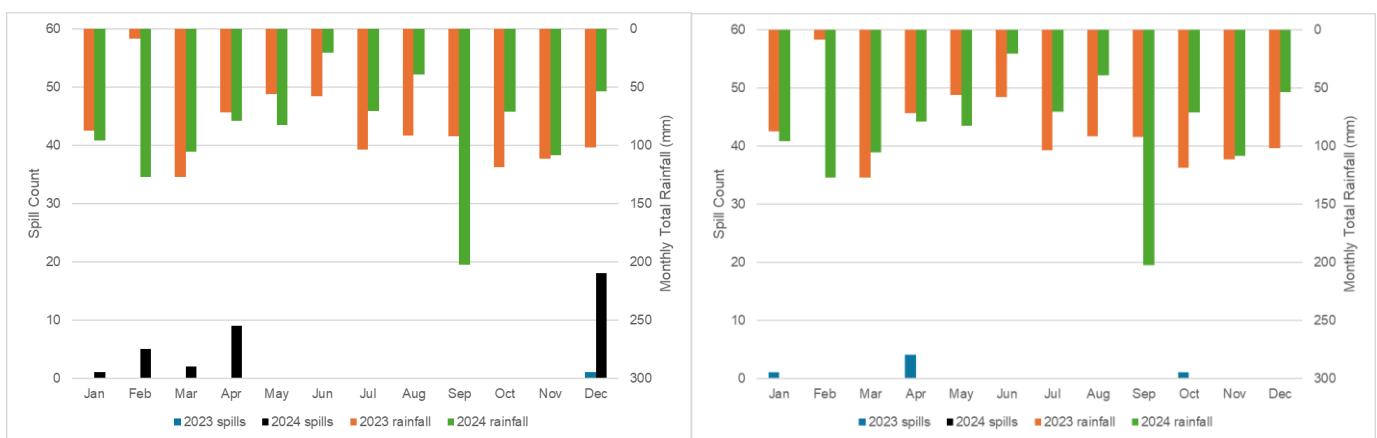


Figure 5: Monthly rainfall data versus monthly spill count for 2023 and 2024 – East Shefford STW / Figure 6: Monthly rainfall data versus monthly spill count for 2023 and 2024 – East Garston SPS

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	595m	277m	800m	1,800m
Look and lift surveys	-	-	7	30	-
Sewer lining	144m	340m	916m	-	1,600m
Patch lining	-	-	1	-	-
Manhole sealing / plates / covers and frames replaced	1	30	2	-	39
ATAC unit deployment	1	-	-	2	2

Summary

A review of river level data over 2023/24 has increased compared to previous years. For East Shefford STW the number and duration of spills have increased in 2024 compared to 2023. The higher number of annual spills and river levels could be a result of the increased rainfall in 2024 (seen in Figure 8). During months January to April 2024, river levels were at the highest for the year (see Figure 5B) which could have led to groundwater ingress leading to the high number of spills during this period. Moreover, there is a slight drop in groundwater levels for 2024/2025 compared to the groundwater levels of the previous year, but the effect of this decrease will be analysed when 2025 spill data is published.

In the reporting year, we have undertaken CCTV survey of our sewers network, covering some 1,800 metres. These CCTV surveys help us monitor the condition of sewer network as well as identifying potential defects that could allow groundwater infiltration. In conjunction with the CCTV, we have completed 1,600 metres of sewer lining, 21 manholes sealing, 9 manhole sealing plates, and 9 manhole covers and frames replaces, to prevent potential infiltration. ATAC units were deployed in the catchment during periods of high flows to partially treat flows being discharged to the watercourse. The ATAC at East Garston was deployed on site but not turned on.

Furthermore, our operational teams have also worked with local stakeholders to improve overland drainage in the area which may be contributing to infiltration into the foul system through manholes.

Froxfield

Froxfield is located in Wiltshire, approximately 7.5 miles east of Marlborough.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Froxfield sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 3 illustrate the relationship between rainfall and river levels. The decrease in rainfall from 2023/24 into 2024/25, shown in Figure 1; represents a correlation to decreased average river levels shown in Figure 2 and Figure 3.

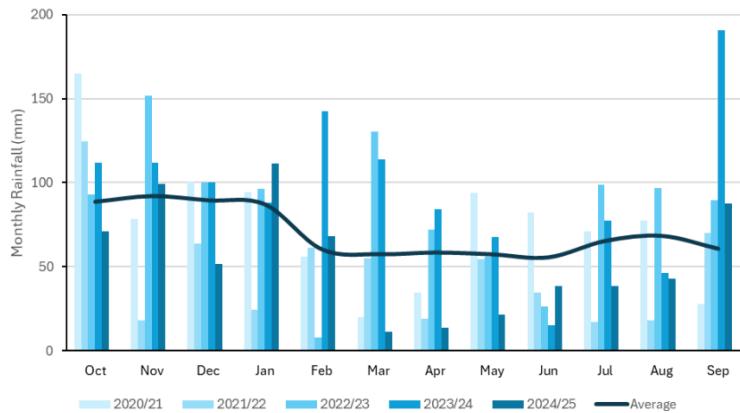


Figure 1: Monthly rainfall data 2020/21 to 2024/25

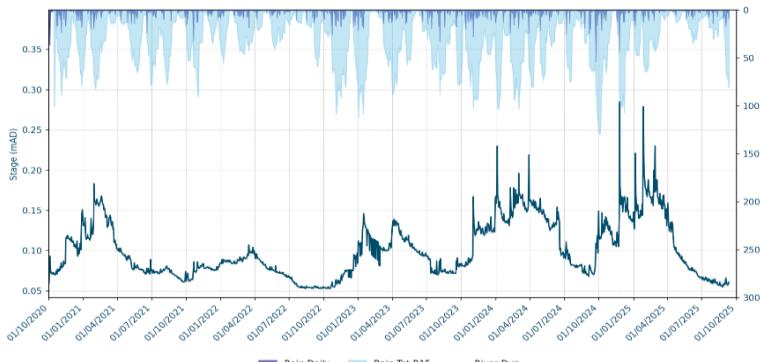


Figure 2: River Level data for River Dun, Hungerford


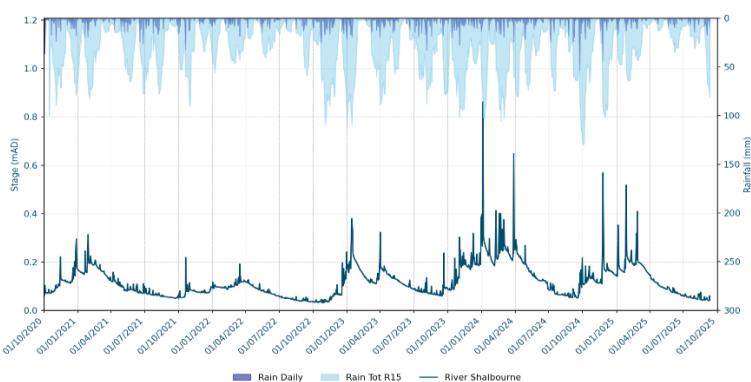


Figure 3: River Level data for River Shalbourne, Hungerford Shalbourne

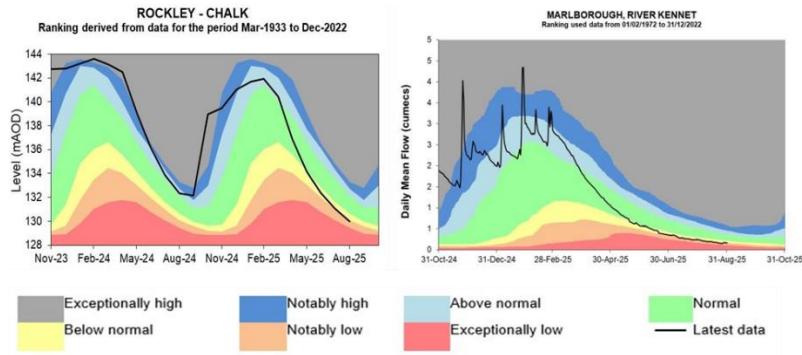

Extract from - [Water Situation Report \(publishing.service.gov.uk\)](https://publishing.service.gov.uk)

Figure 4: Ground Water situation Report

Froxfield STW is a ‘treat all’ site and does not have a storm permit. Therefore, there are no overflow sites with Event Duration Monitor (EDM’s) fitted.

Table 1 below represents the intervention works utilised to address infiltration in the sewer and upgrade capacity at treatment works or pumping stations. Please note that this table does not capture works carried out in previous years or long term planned works as these do not have a bearing on the current performance.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	-	-	1,650m
Look and lift surveys	-	-	-	3	-
Sewer lining	-	-	-	-	-
Patch lining	-	-	-	-	-
Manhole sealing / plates / covers and frames replaced	-	-	-	-	-
ATAC unit deployment	-	-	-	-	-

Summary

A review of river level data over 2023/24 has increased compared to previous years. Froxfield STW is a ‘treat all’ site and does not have a storm permit. Therefore, there are no overflow sites with Event Duration Monitor (EDM’s) fitted. Moreover, there is a slight drop in groundwater levels for 2024/2025 compared to the groundwater levels of the previous year, but the effect of this decrease will be analysed when 2025 spill data is published.

In the reporting year, we have undertaken CCTV survey of our sewers network, covering some 1,650 metres. These CCTV surveys help us monitor the condition of sewer network as well as identifying potential defects that could allow groundwater infiltration.

Fyfield

Fyfield is located on the River Kennet in Wiltshire, approximately 2km east of Marlborough.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Fyfield sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 5 illustrate the relationship between rainfall and spills at CSOs. Viewing Figure 1, there has been a reduction in rainfall from 2023/24 into 2024/25, representing a correlation to decreased river levels displayed in Figures 2 and 3. Figure 5 also demonstrates how there were no spills in 2025.

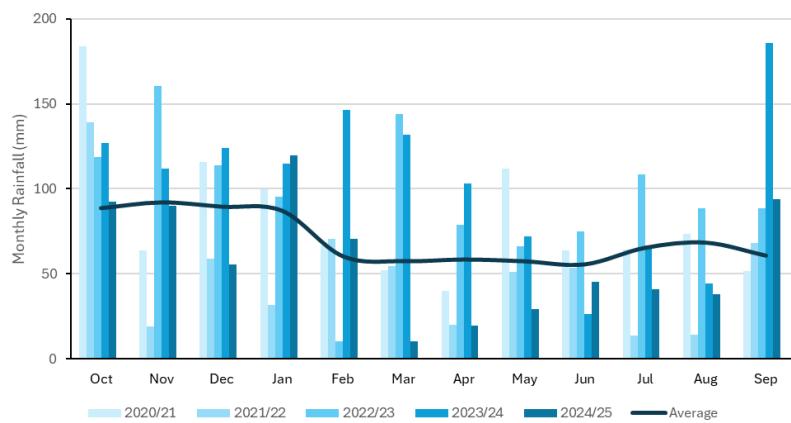


Figure 1: Monthly rainfall data 2020/21 to 2024/25

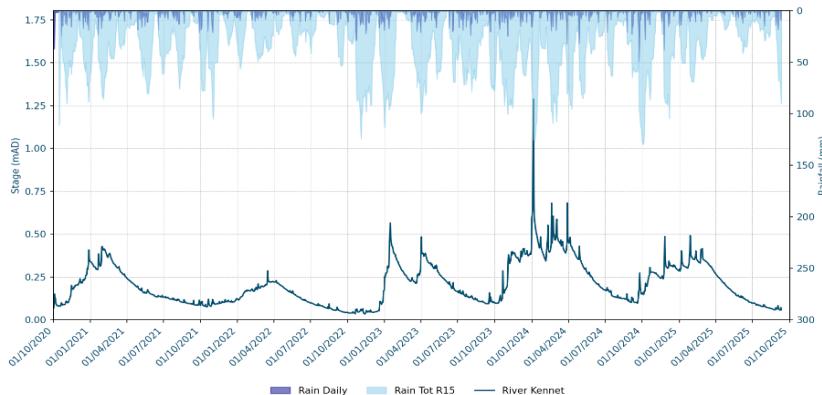


Figure 2: River Level data for River Kennet, Marlborough

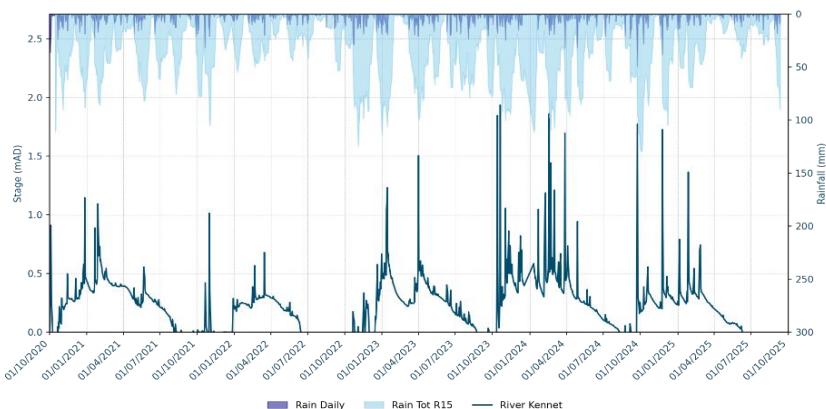


Figure 3: River Level data for River kennet, Winterborne Monkton

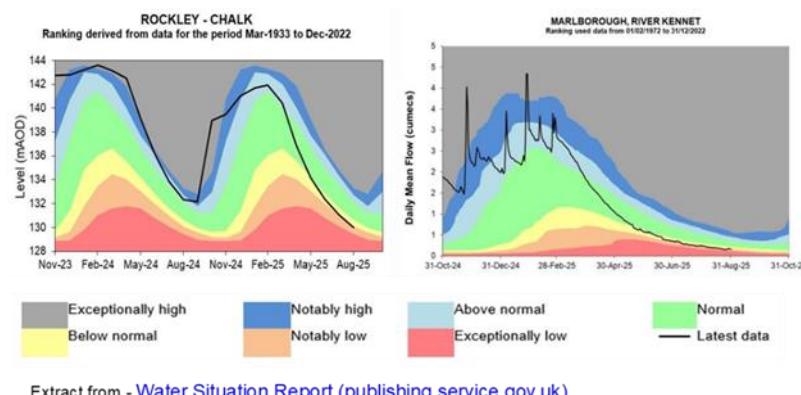


Figure 4: Ground Water situation Report

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figure 5.

Event Duration Monitoring	2023		2024		
	Overflow	Annual Spills	Duration (hours)	Annual Spills	Duration (hours)
Fyfield STW		15	238.5	44	993.45

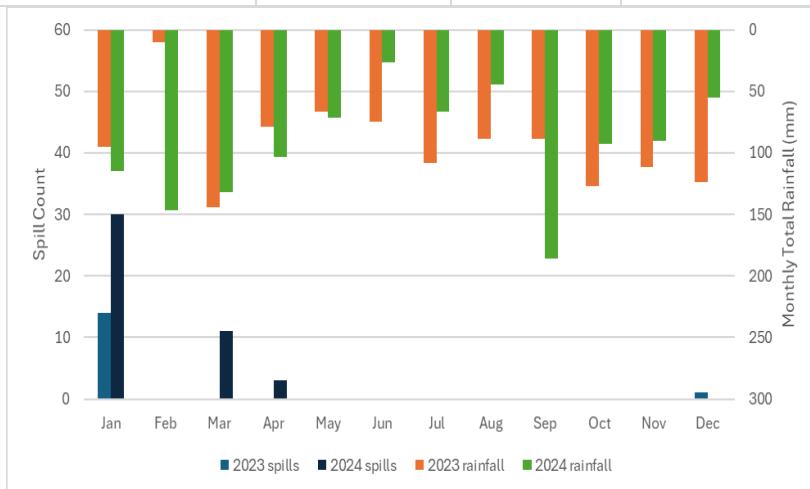


Figure 5: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Fyfield STW

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	370m	-	-
Look and lift surveys	-	-	4	-	-
Sewer lining	-	-	-	-	-
Patch lining	-	-	-	-	-
Manhole sealing / plates / covers and frames replaced	-	-	-	-	-
ATAC unit deployment	-	-	-	-	-

Summary

A review of river level data over 2023/24 has increased compared to previous years. The number and duration of spills have increased in 2024 compared to 2023. The higher number of annual spills and river levels could be a result of the increased rainfall in 2024 (seen in Figure 5). Moreover, there is a slight drop in groundwater levels for 2024/2025 compared to the groundwater levels of the previous year, but the effect of this decrease will be analysed when 2025 spill data is published. Thames Water delivered wastewater treatment enhancement scheme in 2023 which has increased treatment capacity, providing a higher quality of treated effluent discharging into the river.

Thames Water is currently undertaking a scheme, due to complete in 2026, to reduce ground water infiltration into the sewer network. These works include GISMP strategic sealing of 123 manholes and replacing 32 standard manhole covers and frames with "Low Leak" covers and frames in locations where surface water has a potential to accumulate. The scheme also includes sealing an estimated 7,025m of sewers, in locations considered to be at high risk of ground water infiltration, using "Leak Tight" Cured in Place Pipe Lining.

Kingsclere

Kingsclere is located in West Berkshire, approximately 6 miles south-east of Newbury.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Kingsclere sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 5 illustrate the relationship between rainfall and spills at CSOs. Figure 1 displays the reduction in rainfall from 2023/24 to 2024/25. shows a correlation with decreased number and duration of spills at the CSOs shown in Figure 5. However, the river levels remain consistent as shown in Figures 2 and 3.

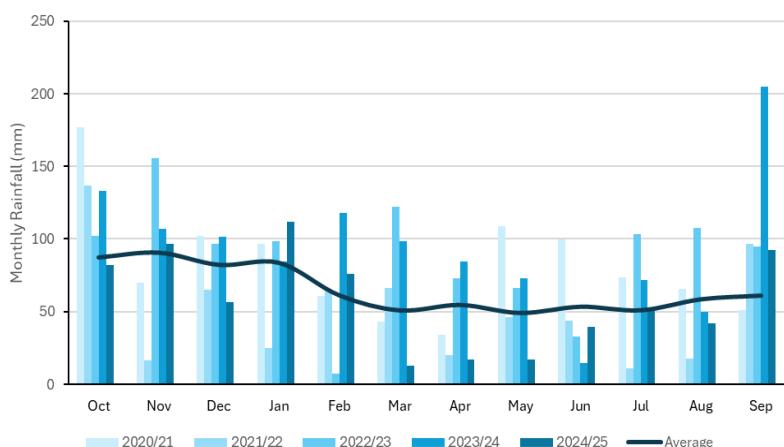


Figure 1: Monthly rainfall data 2020/21 to 2024/25

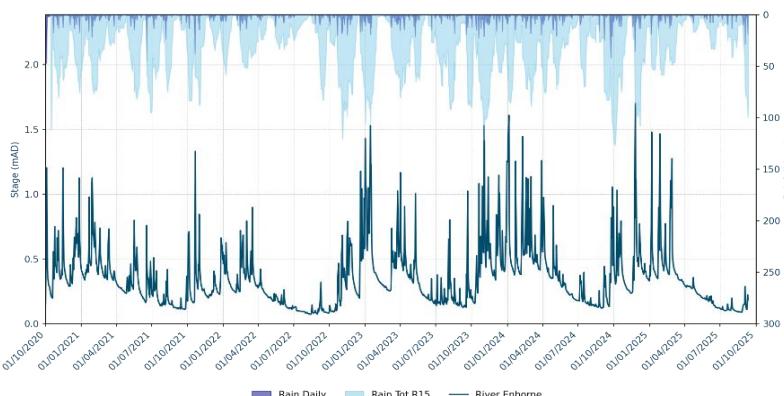


Figure 2: River Level data for River Enborne, Brimpton

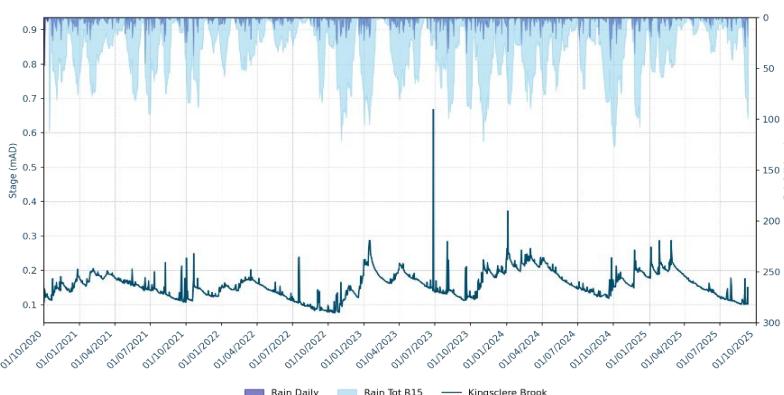


Figure 3: River Level data for Kingsclere Brook, Kingsclere

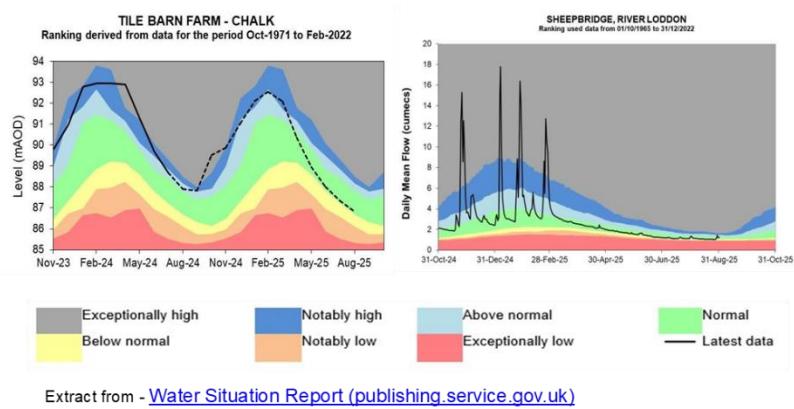


Figure 4: Ground Water situation Report

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figure 5.

Event Duration Monitoring	2023		2024		
	Overflow	Annual Spills	Duration (hours)	Annual Spills	Duration (hours)
Kingsclere STW		134	2562.25	119	2271

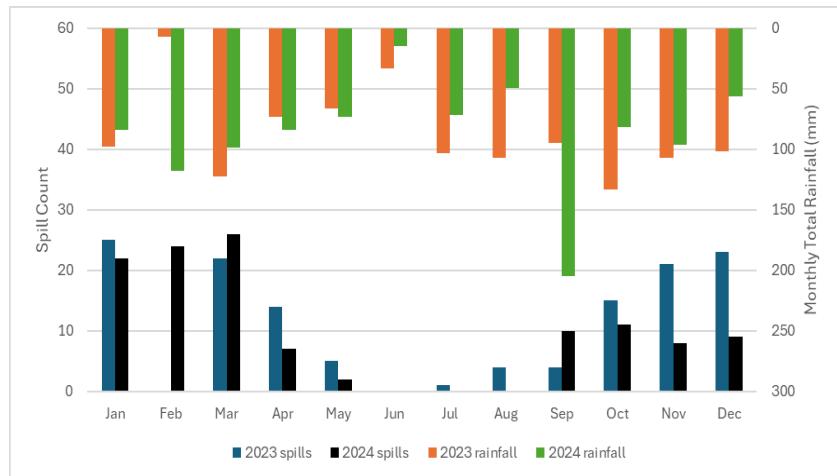


Figure 5: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Kingsclere STW

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	-	1,727m	-
Look and lift surveys	-	-	-	-	-
Sewer lining	-	-	-	-	-
Patch lining	-	-	-	-	-
Manhole sealing / plates / covers and frames replaced	-	-	-	-	-
ATAC unit deployment	-	-	-	-	-

Summary

A review of river level data over 2023/2024 shows a similar pattern being followed compared to previous years, including the average rainfall in 2023 staying fairly consistent compared to 2024 (see Figure 5). The lower number of annual spills could be a result of the rainfall and river levels staying consistent. Moreover, there is a slight drop in groundwater levels for 2024/2025 compared to the groundwater levels of the previous year, but the effect of this decrease will be analysed when 2025 spill data is published.

Marlborough

Marlborough is located on the River Kennet in Wiltshire, approximately 10 miles South of Swindon.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Marlborough sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 8 illustrate the relationship between rainfall and spills at CSOs. Figure 1 displays the decrease in rainfall from 2023/24 into 2024/25, this correlating to decreased groundwater and river levels shown in Figures 2-5, and the decreased number and duration of spills at the CSOs is shown in Figure 7 and Figure 8.

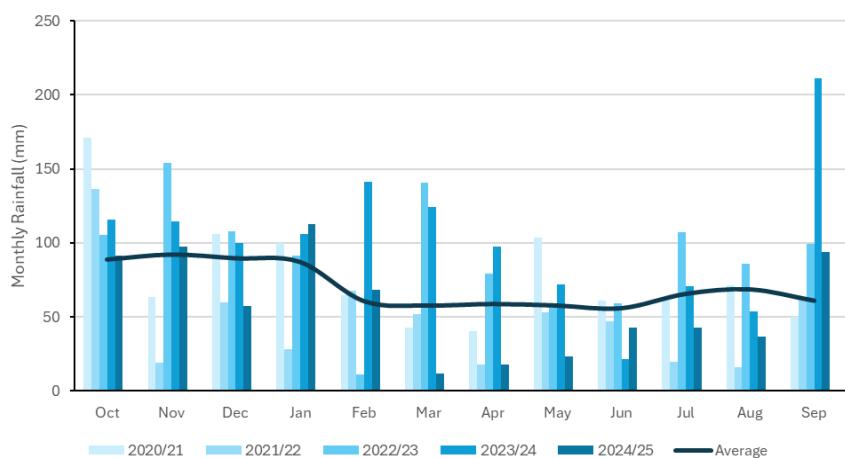


Figure 1: Monthly rainfall data 2020/21 to 2024/25

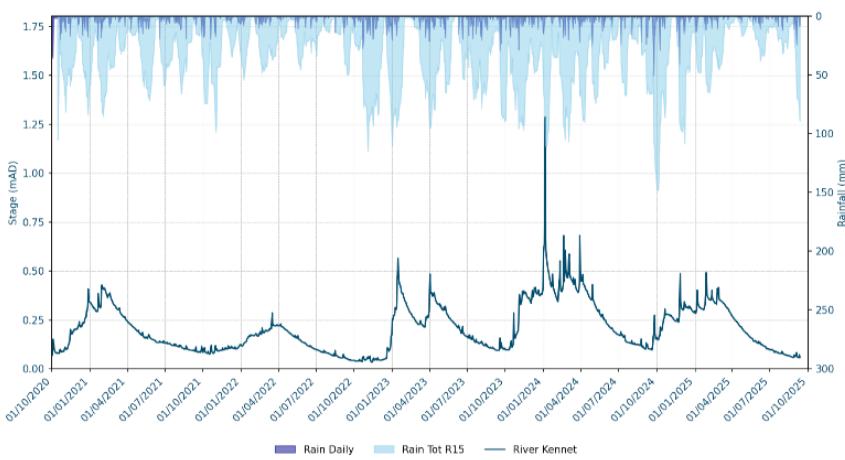


Figure 2: River Level data for River Kennet at Marlborough

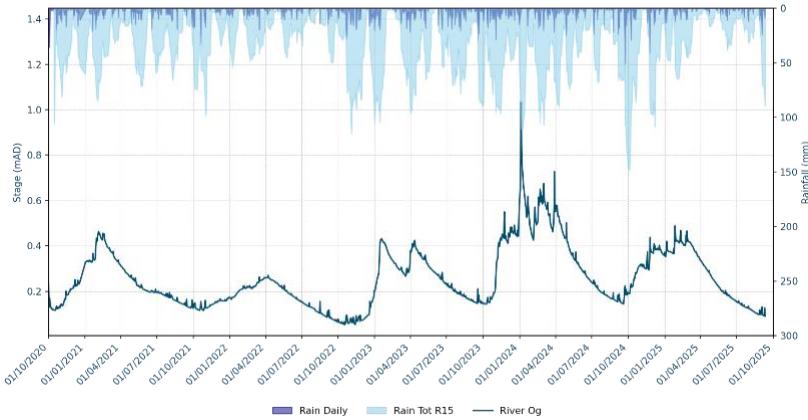


Figure 3: River Level data for River Og at Poulton Farm


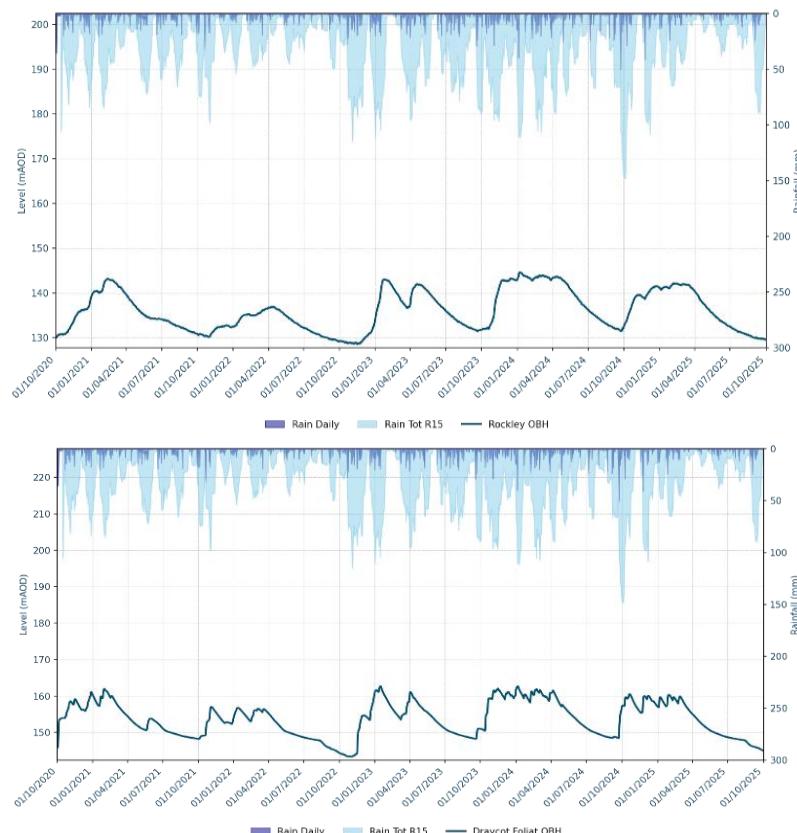


Figure 4: River Level data for Rockley OBH / Figure 5: River Level data for Draycot Foliat OBH

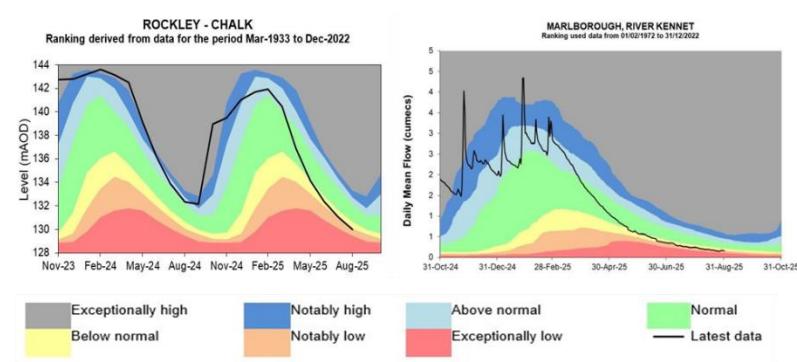

Extract from - [Water Situation Report \(publishing.service.gov.uk\)](https://publishing.service.gov.uk)

Figure 6: Ground Water situation Report

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figures 7 and 8.

Event Duration Monitoring	2023		2024	
	Annual Spills	Duration (hours)	Annual Spills	Duration (hours)
Marlborough STW	172	2383.25	172	2786
London Road SPS	2	1.5	11	59.45

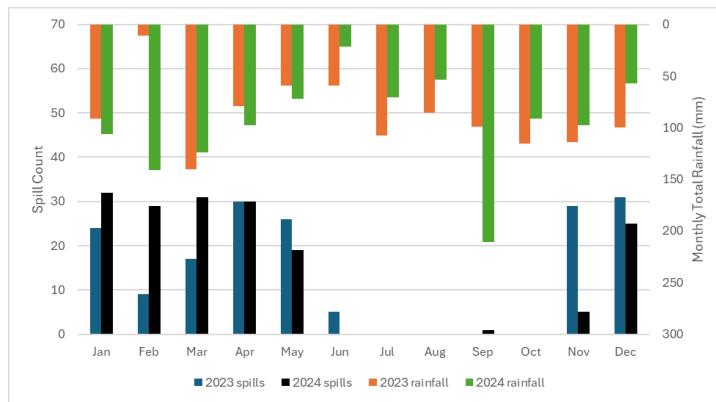


Figure 7: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Marlborough STW

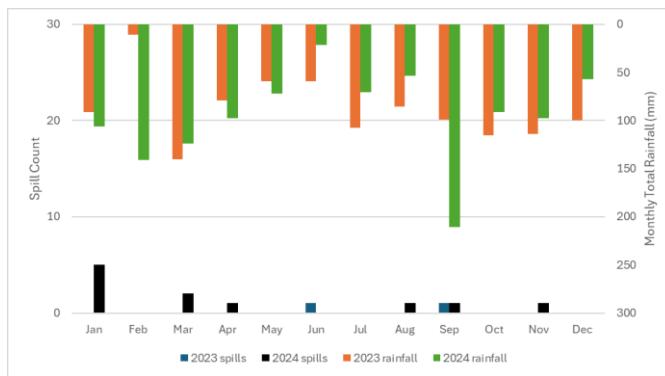


Figure 8: Monthly rainfall data versus monthly spill count for 2023 and 2024 – London Road SPS

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	380m	-	3,700m
Look and lift surveys	-	-	2	6	-
Sewer lining	30m	50m	-	-	-
Patch lining	-	-	2	-	-
Manhole sealing / plates / covers and frames replaced	1	2	6	-	-
ATAC unit deployment	-	-	-	1	1

Summary

A review of river level data over 2023/24 has increased compared to previous years. The number and duration of spills have increased in 2024 compared to 2023 for “London Road SPS”, whereas number of spills have remained

the same for “Marlborough STW”, but spill duration has increased. The higher number of annual spills and river levels could be a result of the increased rainfall in 2024 (seen in Figure 7 & 8). Moreover, there is a slight drop in groundwater levels for 2024/2025 compared to the groundwater levels of the previous year, but the effect of this decrease will be analysed when 2025 spill data is published. Thames Water delivered wastewater treatment enhancement scheme to be completed in 2026 that will increase the ability to treat the volumes of incoming sewage, reducing the need for untreated discharges to the environment.

In the reporting year, we have undertaken CCTV survey of our sewers network, covering some 3,700 metres in the area upstream of the ATAC, the Ogbourne down to Bay Bridges. The CCTV has been reviewed, and there were no major gushers found. The footage has highlighted an area of interest where a number of private connections cross the river Kennet before discharging in the sewer. Operations are currently liaising with the customers about gaining access to review these private lines this winter.

Furthermore, ATAC units were utilized in this catchment during periods of high flows to partially treat flows being discharged to the watercourse. The ATAC unit at Bay Bridges was switched on between 25/11/2024 – 01/05/2025. Further details for the ATAC units are available in the standalone groundwater plan for this system.

Ramsbury

Ramsbury is located in the Kennet Valley, Wiltshire.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Ramsbury sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 6 illustrate the relationship between rainfall and spills at CSOs. As can be seen the decrease in rainfall from 2023/24 into 2024/25, shown in Figure 1; shows a correlation with decreased number and duration of spills at the CSOs in Figure 5. However, the Groundwater and river levels remain consistent as shown in Figure 2 to Figure 4.

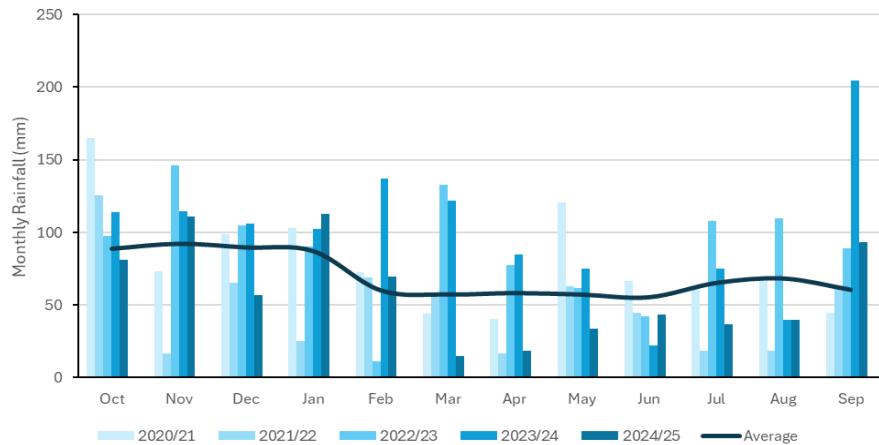


Figure 1: Monthly rainfall data 2020/21 to 2024/25

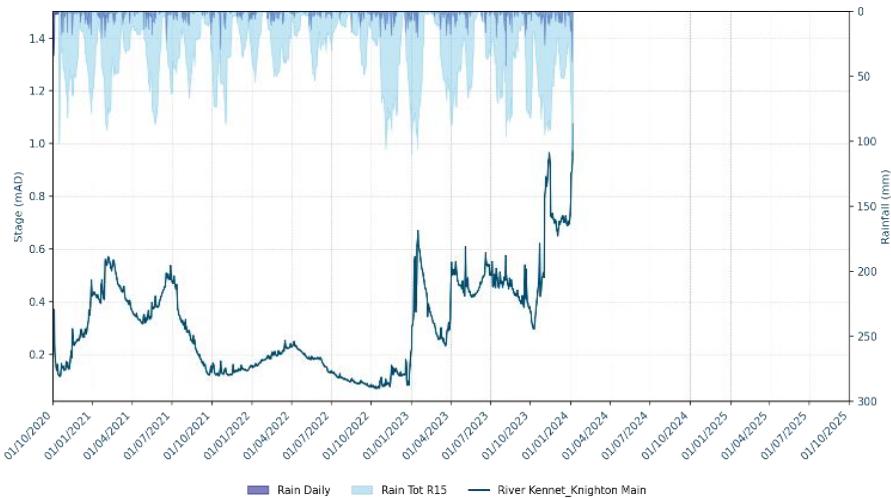


Figure 2: River Level data for Kennet, Knighton Main


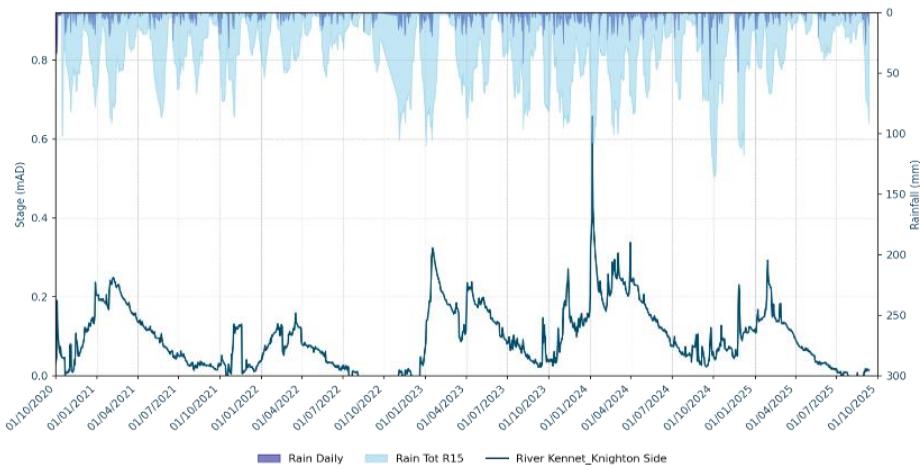


Figure 3: River Level data for Kennet, Knighton Side



Figure 4: River Level data for Water Acre OBH

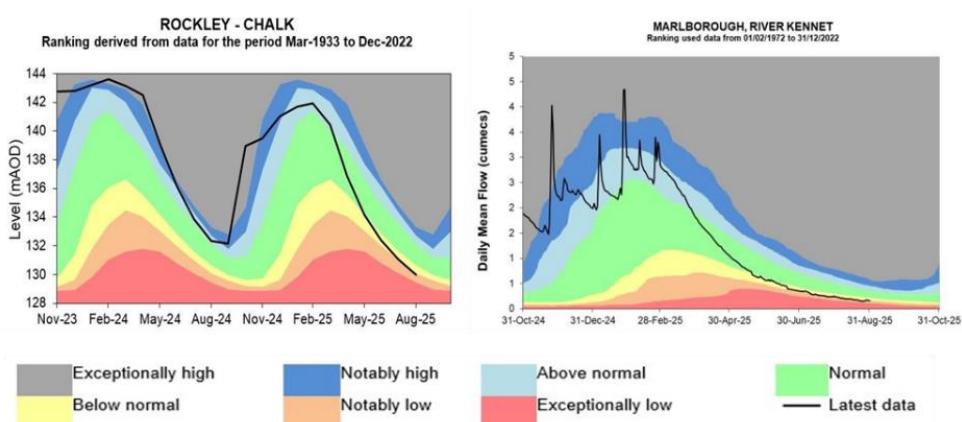

Extract from - [Water Situation Report \(publishing.service.gov.uk\)](https://publishing.service.gov.uk)

Figure 4: Ground Water situation Report

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figure 6.

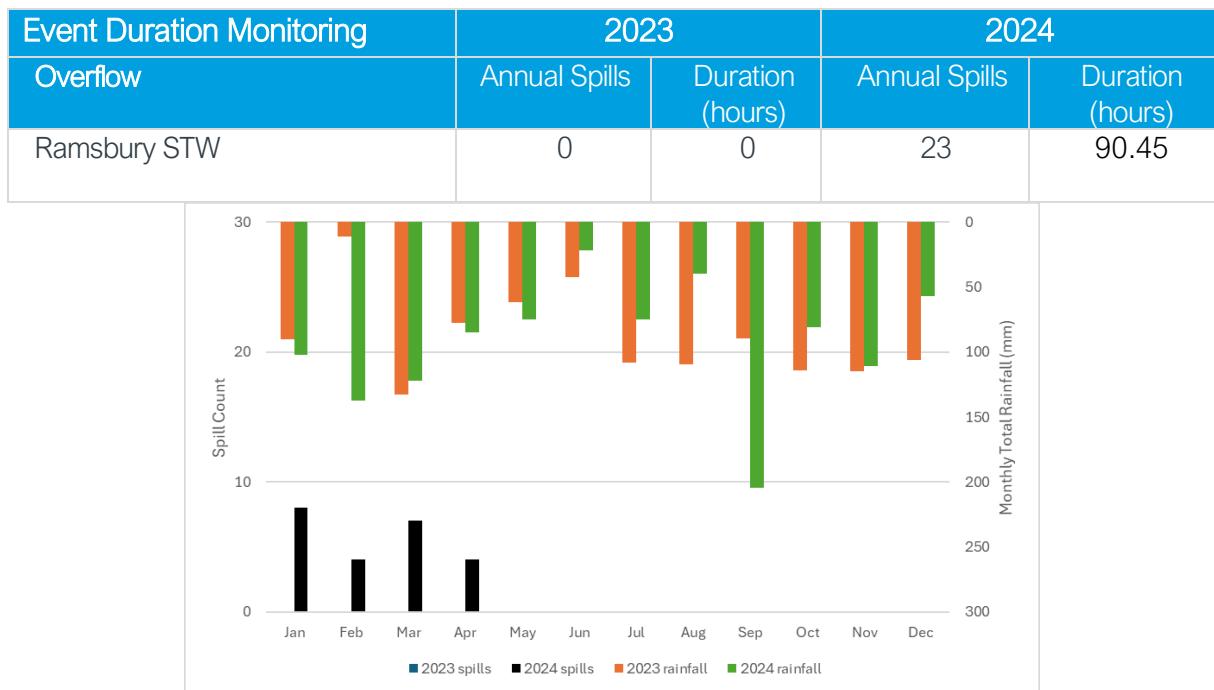


Figure 6: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Ramsbury STW

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	1,665m	3,500m	1,318m
Look and lift surveys	-	-	5	12	-
Sewer lining	-	60m	-	-	-
Patch lining	1	-	-	-	-
Manhole sealing / plates / covers and frames replaced	2	2	-	-	-
ATAC unit deployment	1	-	-	1	1

Summary

A review of river level data over 2023/24 has increased compared to previous years. The number and duration of spills have increased in 2024 compared to 2023. The higher number of annual spills and river levels could be a result of the increased rainfall in 2024 (seen in Figure 6). Moreover, there is a slight drop in groundwater levels for 2024/2025 compared to the groundwater levels of the previous year, but the effect of this decrease will be analysed when 2025 spill data is published.

This year we have completed 1.318km of CCTV in Lottage Road and The Square, there were no major gushers found.

Furthermore, a temporary bio-filter (ATAC) unit was utilized in this catchment during periods of high flows to partially treat flows being discharged to the watercourse. The ATAC unit at Aldbourne was switched on between 14/01/2025 – 10/04/2025. Further details for the ATAC units are available in the standalone groundwater plan for this system.

Reading

Reading is located in in Berkshire, approximately 15 miles east of Newbury.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Reading sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 6 illustrate the relationship between rainfall and spills at CSOs. As can be seen the decrease in rainfall from 2023/24 into 2024/25, shown in Figure 1; shows a correlation with decreased number and duration of spills at the CSOs shown in Figure 6. However, the Groundwater and river levels remain consistent as shown in Figure 2 to Figure 4.

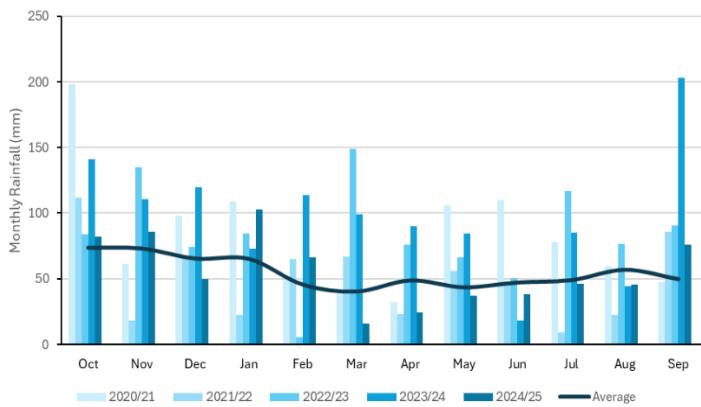


Figure 1: Monthly rainfall data 2020/21 to 2024/25

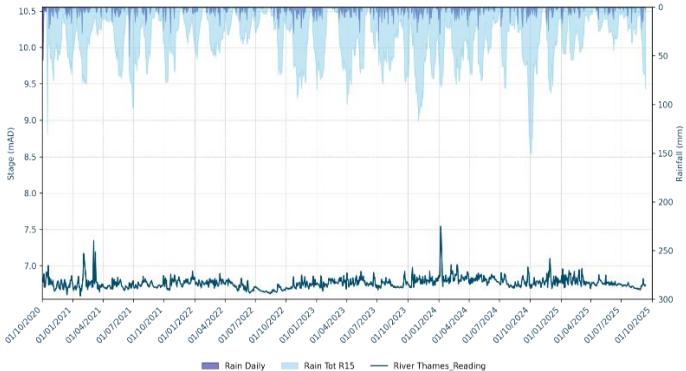
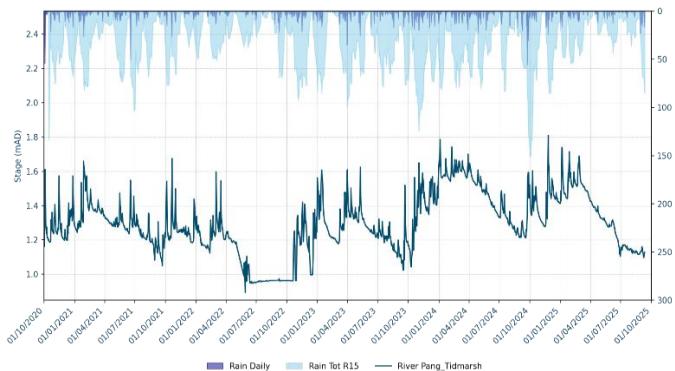


Figure 2: River Level data for River Pang, Tidmarsh/ Figure 3: River Level data for River Thames, Reading

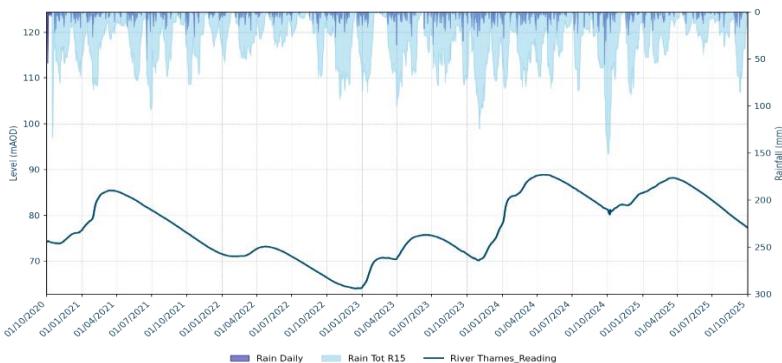


Figure 4: River Level data for Stonor Park OBH

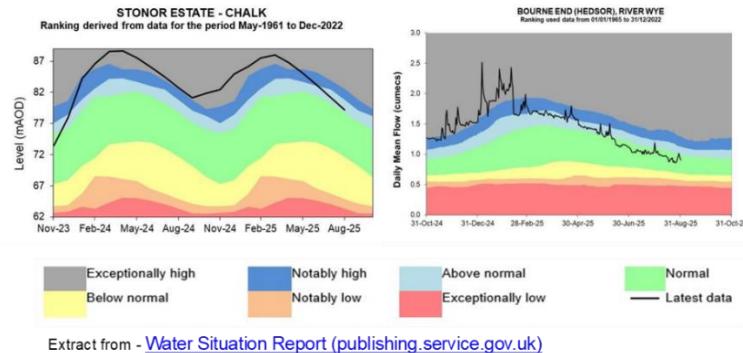


Figure 5: Ground Water situation Report

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figure 6.

Event Duration Monitoring	2023		2024		
	Overflow	Annual Spills	Duration (hours)	Annual Spills	Duration (hours)
Reading STW		24	289.75	47	654



Figure 6: Monthly rainfall data versus monthly spill count for 2023 and 2025 – Reading STW

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	447m	1,253m	500m	1,500m
Look and lift surveys	-	-	10	8	-
Sewer lining	-	-	850m	360m	1,195
Patch lining	-	-	-	-	-
Manhole sealing / plates / covers and frames replaced	-	-	20	15	-
ATAC unit deployment	-	-	-	-	-

Summary

A review of river level data over 2023/24 has increased compared to previous years. The number and duration of spills have increased in 2024 compared to 2023. The higher number of annual spills and river levels could be a result of the increased rainfall in 2024 (seen in Figure 6). Moreover, groundwater levels for 2024/2025 have stayed relatively similar to the groundwater levels of the previous year, but the effect of this will be analysed when 2025 spill data is published.

In the reporting year, we have undertaken CCTV survey of our sewers network, covering some 1,500 metres. These CCTV surveys help us monitor the condition of sewer network as well as identifying potential defects that could allow groundwater infiltration.

In conjunction with the CCTV, we have undertaken 1,100 metres of sewer lining was introduced at Gravel Pits and a further 95m at Aldermaston Wharf.

Silchester

Silchester is located in Hampshire, approximately 9 miles south-west of Reading.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Silchester sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 6 illustrate the relationship between rainfall and spills at CSOs. As can be seen the decrease in rainfall from 2023/24 into 2024/25, shown in Figure 1; shows a correlation with decreased number and duration of spills at the CSOs as shown in Figure 5 and Figure 6. Figure 2 shows a decrease in river levels, while Figure 3 shows a similar trend. However, this observation should be interpreted carefully due to flatlining data, which may affect the reliability of the interpretation.

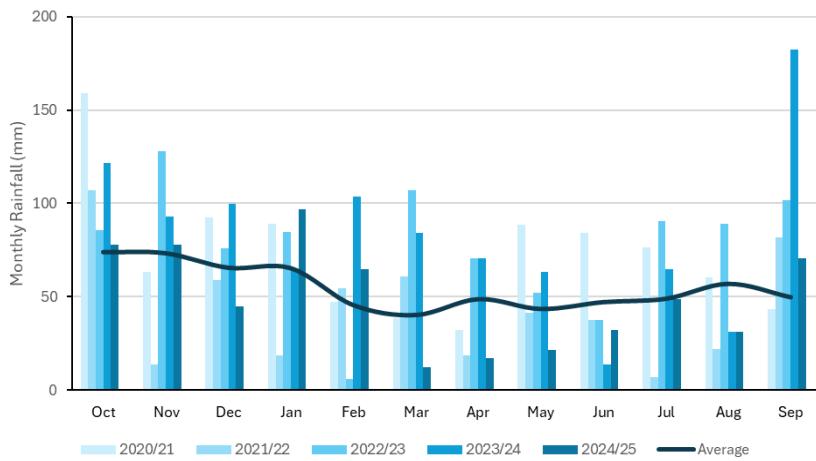


Figure 1: Monthly rainfall data 2020/21 to 2024/25

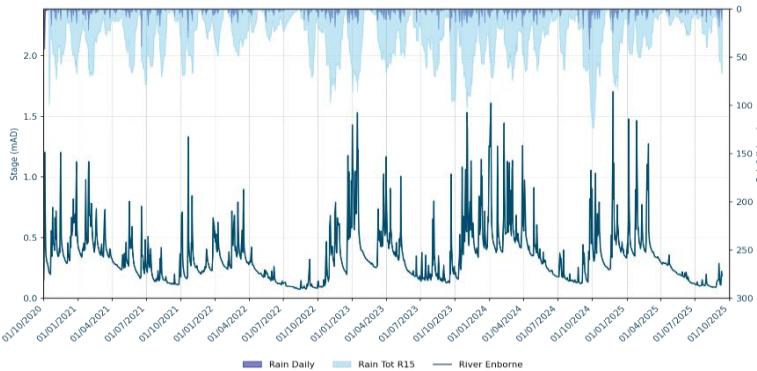


Figure 2: River Level data for River Enborne, Brimpton

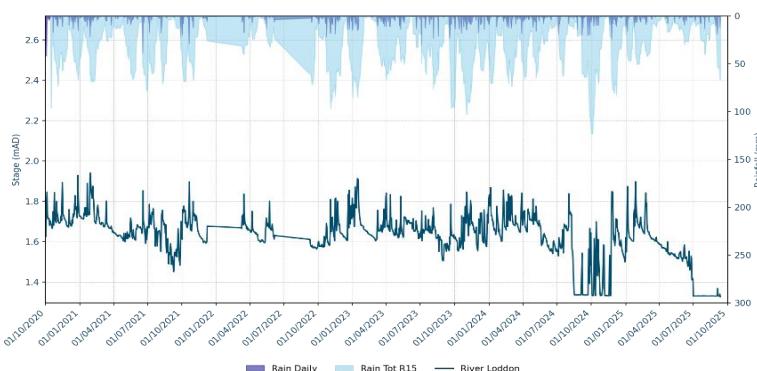


Figure 3: River Level data for River Loddon, Longbridge Mill

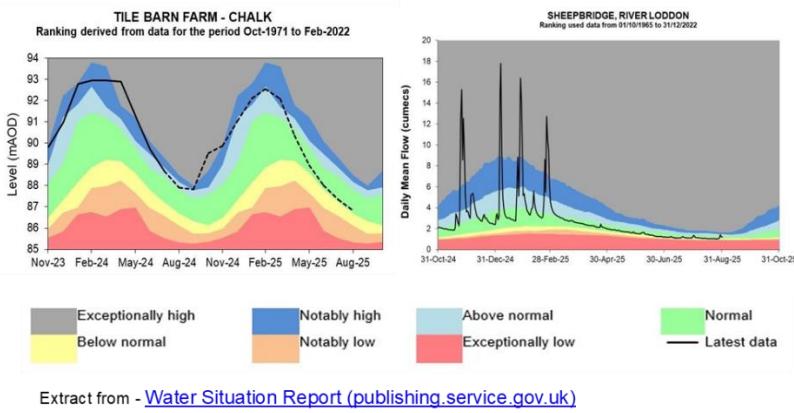


Figure 4: Ground Water situation Report

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figures 5,6 and 7.

Event Duration Monitoring	2023		2024	
	Annual Spills	Duration (hours)	Annual Spills	Duration (hours)
Overflow				
Silchester STW	112	2067	97	1685
Swains Road SPS	2	3.5	2	05.30
Opp St Stephens Hall SPS	60	62.77	72	180.30

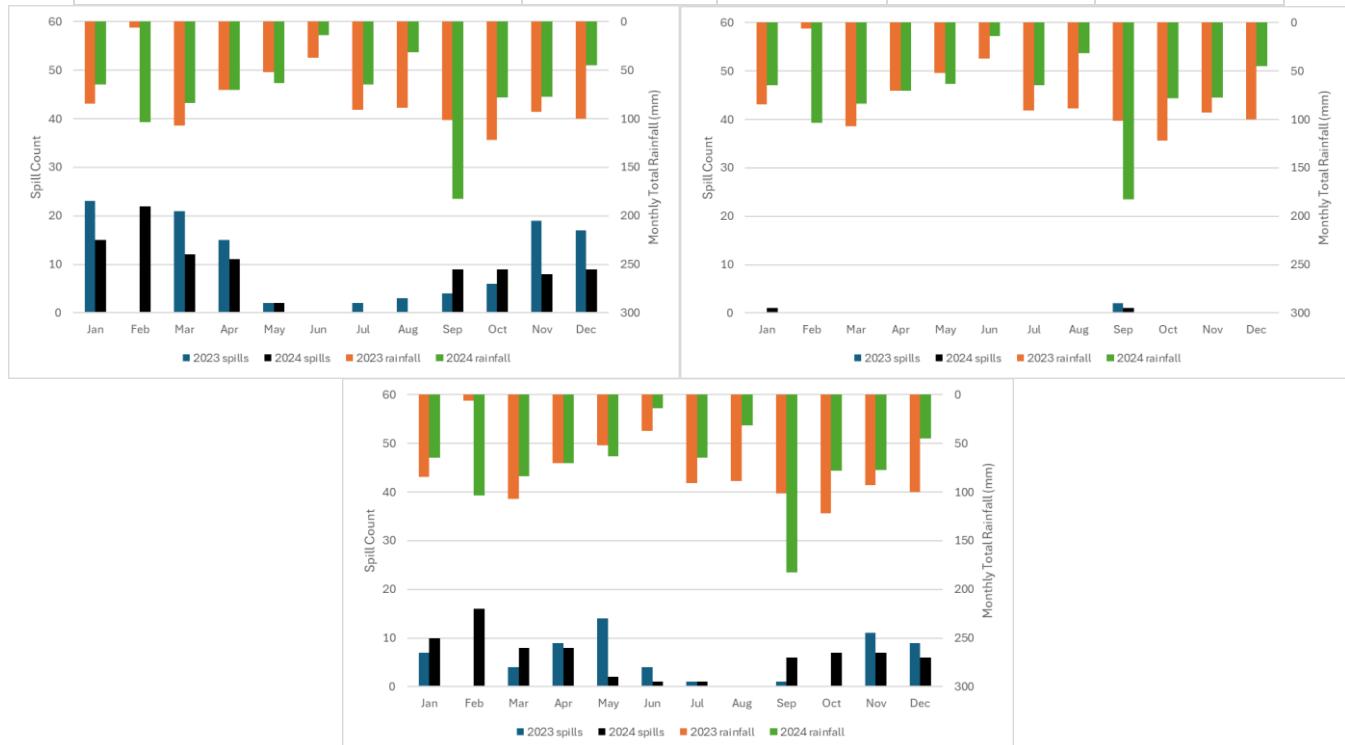


Figure 5: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Silchester STW / Figure 6: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Swains Road SPS / Figure 7: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Opp St Stephens Hall SPS

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	-	4,740m	-
Look and lift surveys	-	-	-	-	-
Sewer lining	-	-	-	-	-
Patch lining	-	-	-	-	-
Manhole sealing / plates / covers and frames replaced	-	-	-	-	-
ATAC unit deployment	-	-	-	-	-

Summary

A review of river level data over 2023/2024 shows a similar pattern being followed compared to previous years. The number and duration of spills have decreased for "Silchester STW" in 2024 compared to 2023, whereas the number of spills increased for "Opp St Stephens Hall SPS" and for "Swains Road SPS" the number of spills remained the same. The higher number of spills could be due to the increased rainfall in 2024 compared to 2023. The lower number of annual spills could be a result of the river levels staying consistent. Moreover, groundwater levels for 2024/2025 have stayed relatively similar to the groundwater levels of the previous year, but the effect of this will be analysed when 2025 spill data is published.

Wash Water

Wash Water is located in Berkshire, approximately 3 miles south-west of Newbury.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Wash Water sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 7 illustrate the relationship between rainfall and spills at CSOs. As can be seen the decrease in rainfall from 2023/24 into 2024/25, shown in Figure 1; shows a correlation with decreased number and duration of spills at the CSOs shown in Figure 5 to Figure 7. However, the river levels remain consistent as shown in Figure 2 and Figure 3.

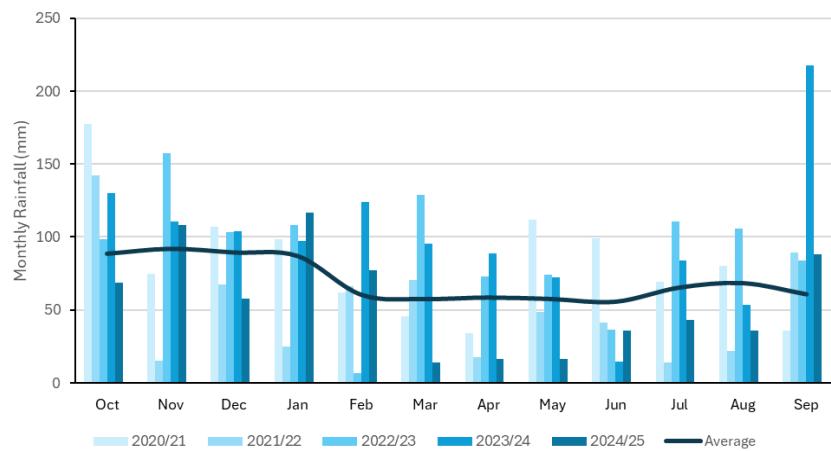


Figure 1: Monthly rainfall data 2020/21 to 2024/25

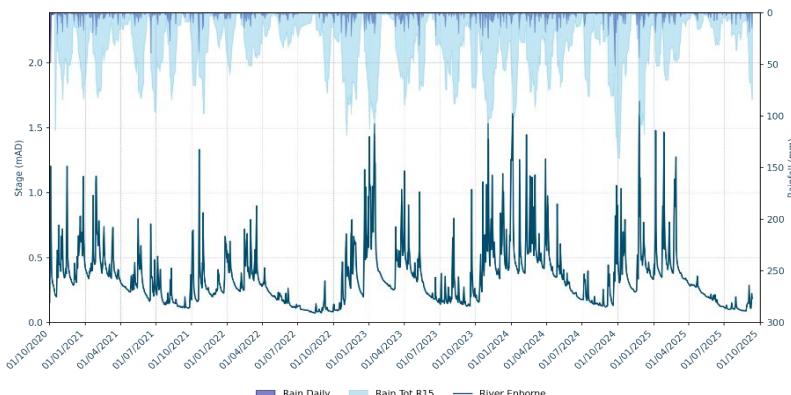


Figure 2: River Level data for River Enborne, Brimpton


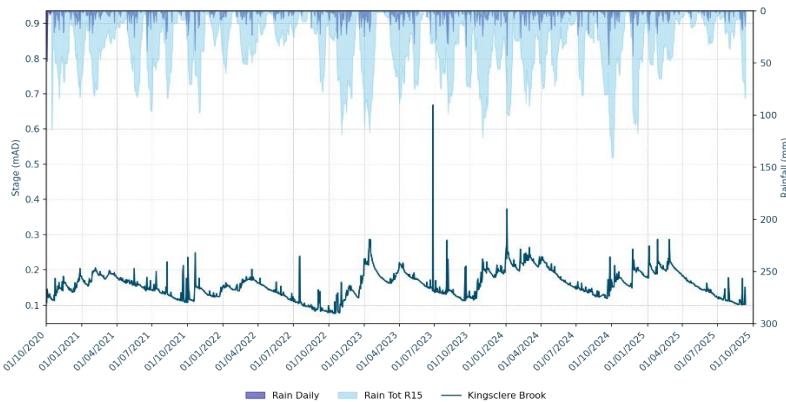


Figure 3: River Level data for Kingsclere Brook, Kingsclere

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figures 5 to 7.

Event Duration Monitoring	2023		2024		
	Overflow	Annual Spills	Duration (hours)	Annual Spills	Duration (hours)
Wash Water STW		111	1731.25	67	1049.45
Blind Mans Gate Highclere SPS		46	521	45	472.45
Knights Lane SPS		50	743.75	59	989.15

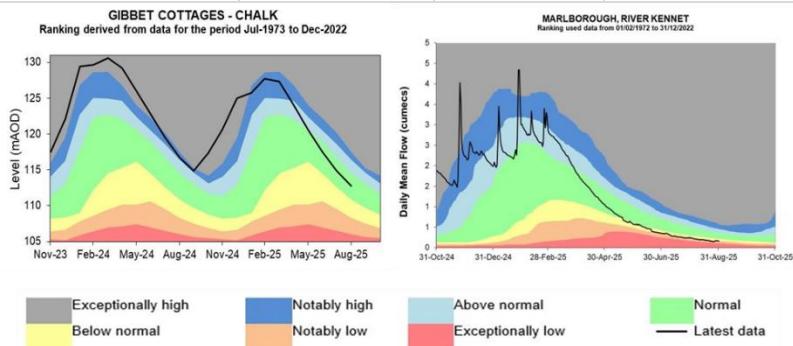

Extract from - [Water Situation Report \(publishing.service.gov.uk\)](https://www.publishing.service.gov.uk)

Figure 4: Ground Water situation Report

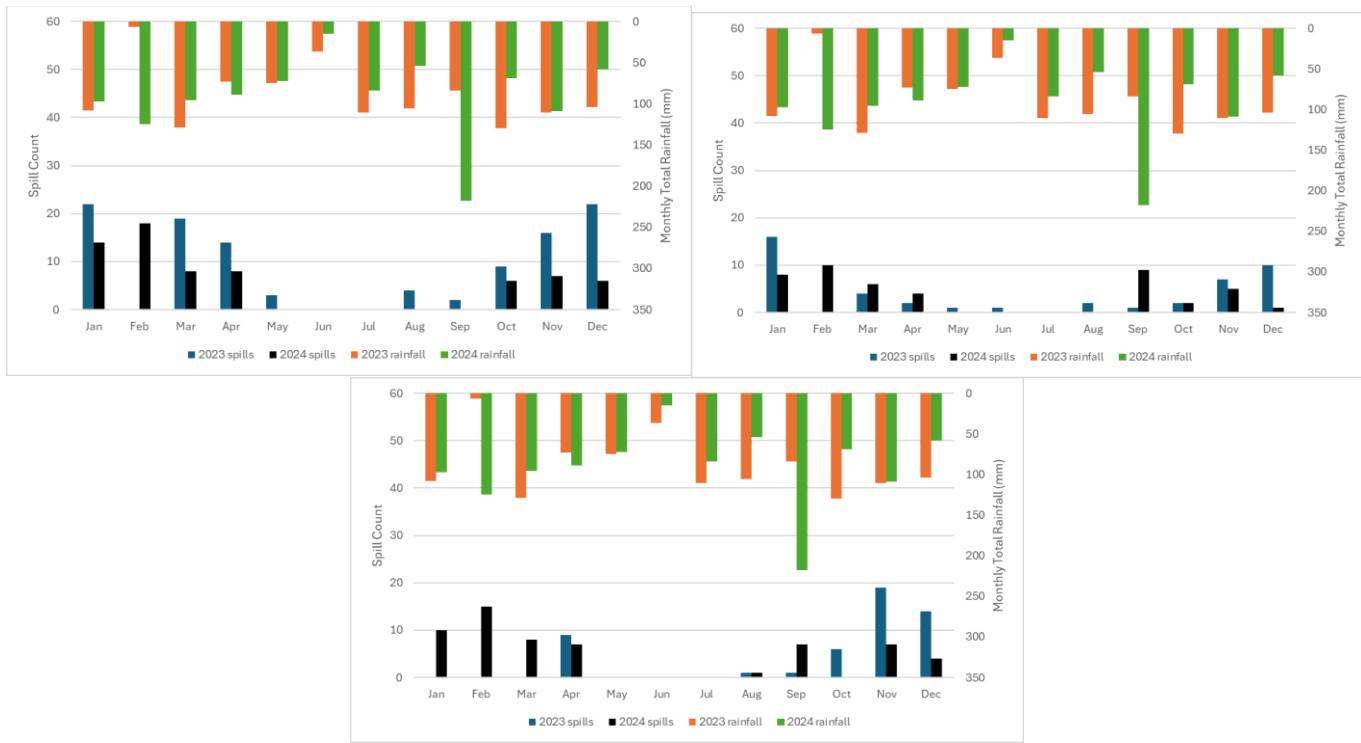


Figure 5: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Wash Water STW / Figure 6: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Blind Mans Gate Highclere SPS / Figure 7: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Knights Lane SPS

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	-	1,256m	-
Look and lift surveys	-	-	-	-	-
Sewer lining	-	-	-	-	-
Patch lining	-	-	-	-	-
Manhole sealing / plates / covers and frames replaced	-	-	-	-	-
ATAC unit deployment	-	-	-	-	-

Summary

A review of river level data over 2023/2024 shows a similar pattern being followed compared to previous years. The number and duration of spills have decreased for “Wash Water STW” and “Blind Mans Gate Highclere SPS” in 2024 compared to 2023, whereas the number of spills increased for “Kings Lane SPS”. The higher number of spills could be due to the increased rainfall in 2024 compared to 2023. The lower number of annual spills could be a result of the river levels staying consistent. Moreover, groundwater levels for 2024/2025 have stayed relatively similar to the groundwater levels of the previous year, but the effect of this will be analysed when 2025 spill data is published. Thames Water delivered wastewater treatment enhancement scheme in 2024 which has increased treatment capacity, reducing the likelihood of storm discharges.

Winterbourne

Winterbourne is located in South Gloucestershire, situated on the north fringe of Bristol.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Winterbourne sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 5 illustrate the relationship between rainfall and spills at CSOs. Figure 1 displays how rainfall has decreased in 2024/25 from 2023/24. While the Chapelwood OBH river level profile in Figure 2 remains similar to the previous year, observing Figure 3, Winterbourne Stream's level has decreased in 2025. Despite this, spills did not significantly decrease until May 2025 in Figure 5.

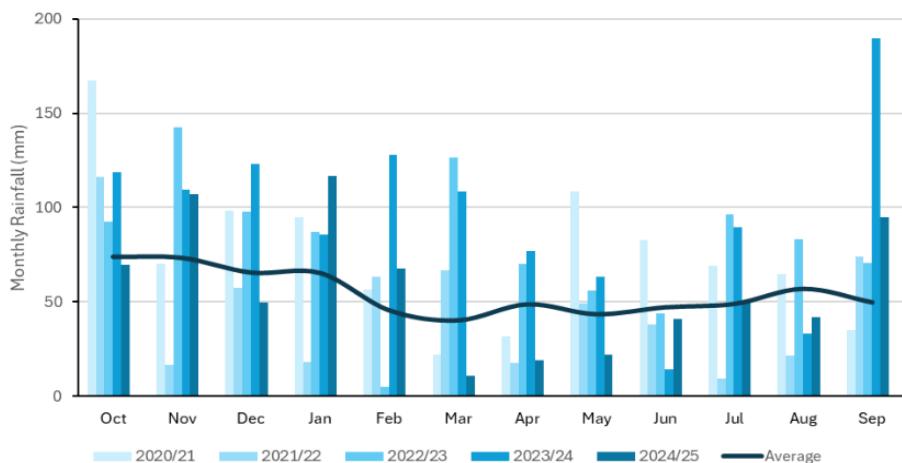


Figure 1: Monthly rainfall data 2020/21 to 2024/25

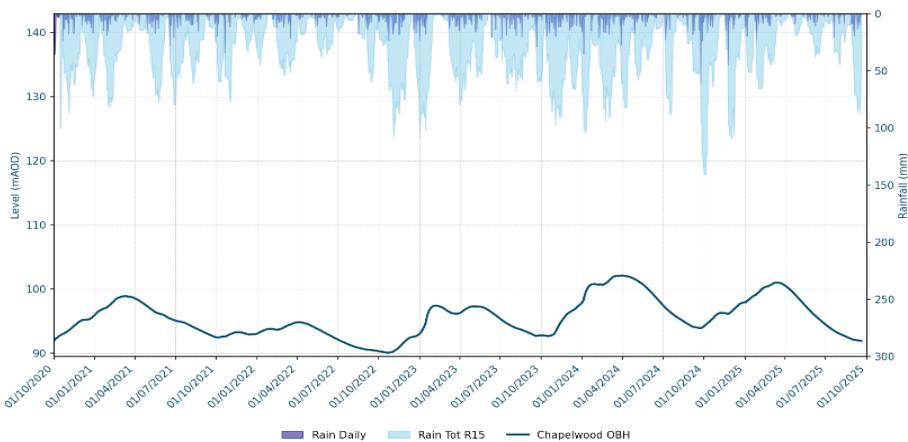


Figure 2: River Level data for Chapelwood OBH


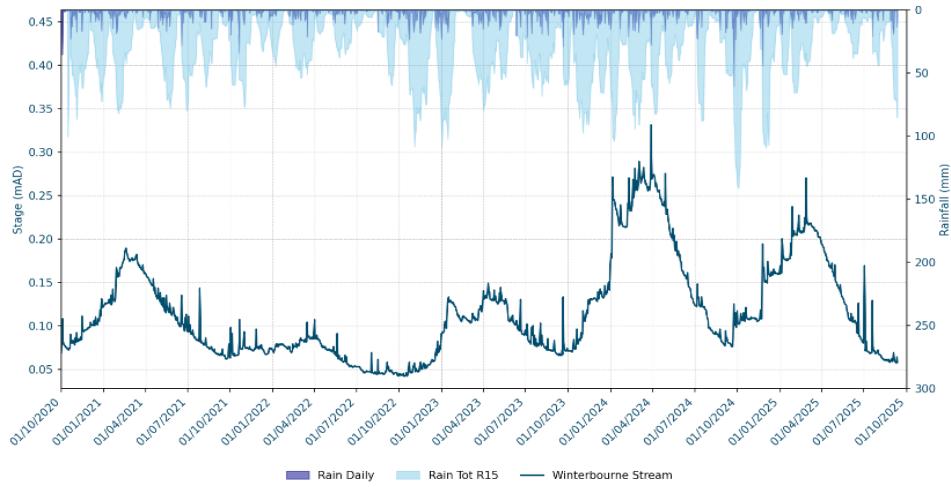


Figure 3: River Level data for Winterbourne Stream, Bagno

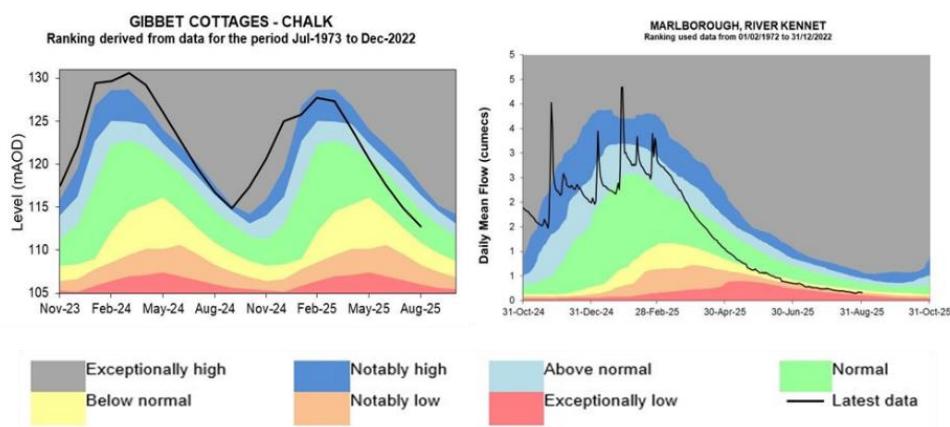

Extract from - [Water Situation Report \(publishing.service.gov.uk\)](https://publishing.service.gov.uk)

Figure 4: Ground Water situation Report

Table 1 below details the last 2 years performance of overflows in the catchment. To assess EDM performance and its relation to groundwater infiltration, a review of the month-on-month spill performance in 2023 and 2024 against the monthly total rainfall values has been undertaken, as observed in Figure 5.

Event Duration Monitoring	2023		2024		
	Overflow	Annual Spills	Duration (hours)	Annual Spills	Duration (hours)
Winterbourne STW		59	1287	219	5062

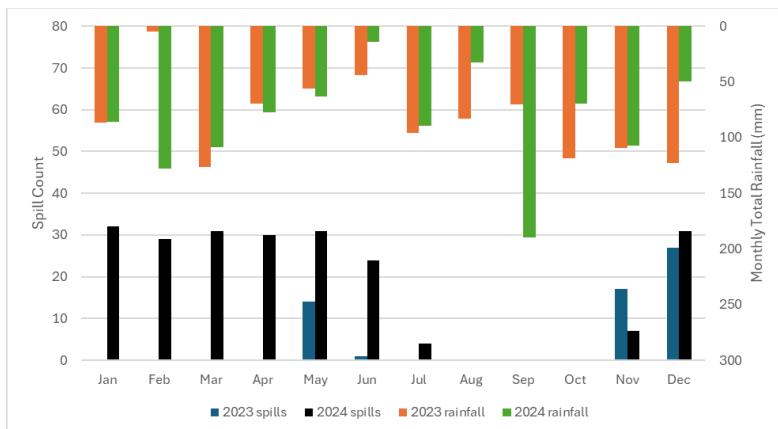


Figure 5: Monthly rainfall data versus monthly spill count for 2023 and 2024 – Winterbourne STW

Table 2 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	-	-	-
Look and lift surveys	-	-	-	-	-
Sewer lining	-	-	-	-	-
Patch lining	-	-	-	-	-
Manhole sealing / plates / covers and frames replaced	-	14	1	-	-
ATAC unit deployment	-	-	-	-	-

Summary

A review of river level data over 2023/24 has increased compared to previous years. The number and duration of spills have increased in 2024 compared to 2023. The higher number of annual spills and river levels could be a result of the increased rainfall in 2024 (seen in Figure 5). Moreover, there is a slight drop in groundwater levels for 2024/2025 compared to the groundwater levels of the previous year, but the effect of this decrease will be analysed when 2025 spill data is published.

Woolhampton

Woolhampton is located in West Berkshire, approximately 6 miles east of Newbury.

This addendum provides an update on work undertaken in the hydrological year October 2024 to September 2025 for the Woolhampton sewerage system. The key points covered include:

- Hydrological conditions
- Performance of the sewerage system
- Mitigation / remedial measures progressed over the last year

Figures 1 to 3 illustrate the relationship between rainfall and river level. As can be seen the decrease in rainfall from 2023/24 into 2024/25, shown in Figure 1; whereas the river levels remain similar to the previous years as shown in Figure 2. Observing Figure 3, groundwater level has decreased in 2025.

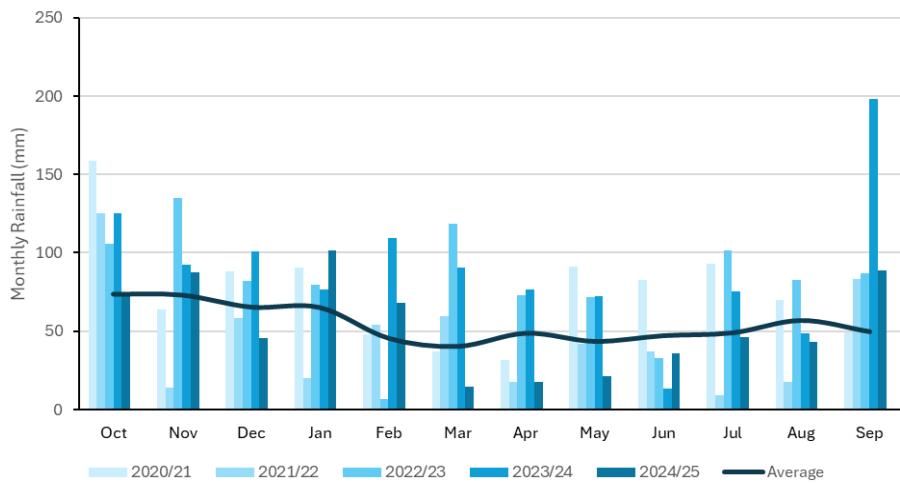


Figure 1: Monthly rainfall data 2020/21 to 2024/25

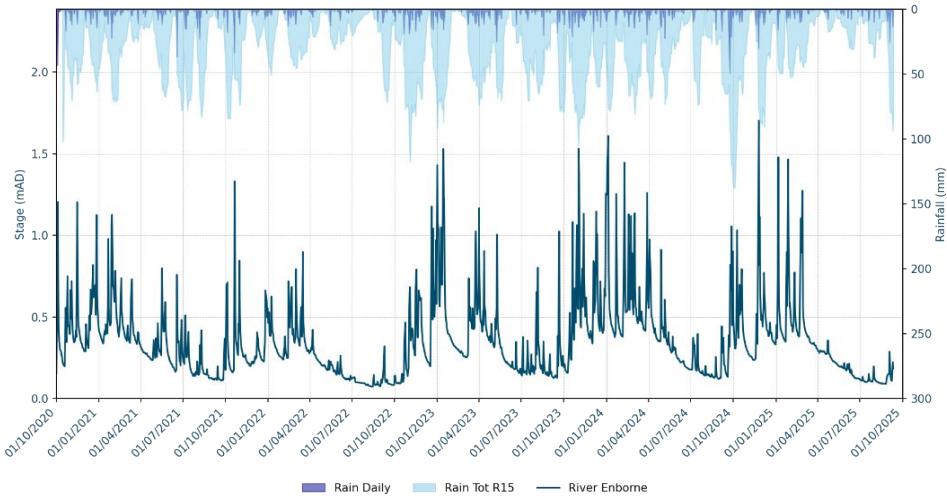


Figure 2: River Level data for River Enborne, Brimpton

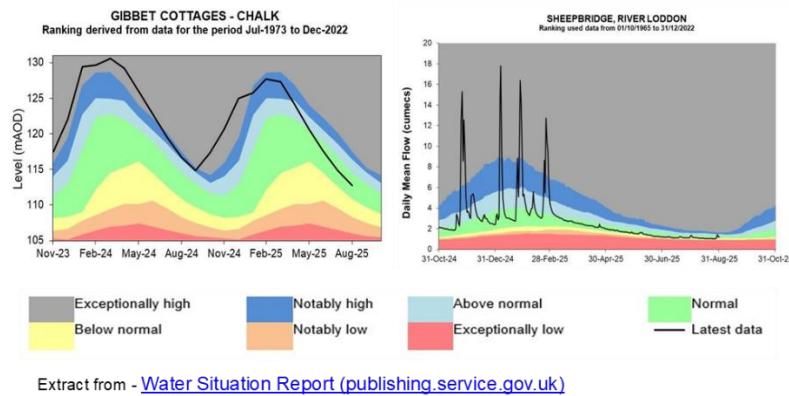


Figure 3: Ground Water situation Report

Woolhampton STW is a 'treat all' site and there are no consented overflows located in the catchment. Therefore, overflow performance for the Woolhampton catchment has not been detailed.

Table 1 below outlines the remediation works undertaken to address infiltration in the catchment, and enhancements to treatment works and/or pumping stations. Please note that this table only refers to work completed in the previous year.

Investigation / remediation type	2020/21	2021/22	2022/23	2023/24	2024/25
CCTV surveys	-	-	-	-	-
Look and lift surveys	-	-	-	-	-
Sewer lining	-	-	-	-	-
Patch lining	-	-	-	-	-
Manhole sealing / plates / covers and frames replaced	-	-	-	-	-
ATAC unit deployment	-	-	-	-	-

Summary

A review of river level data over 2023/2024 shows a similar pattern being followed compared to previous years. As mentioned above, STW is a 'treat all' site and there are no consented overflows located in the catchment. Therefore, overflow performance for the Woolhampton catchment has not been detailed. Moreover, groundwater levels for 2024/2025 have stayed relatively similar to the groundwater levels of the previous year, but the effect of this will be analysed when 2025 spill data is published.

